

NOTES

- 1. ALL SIGNING AND PAVEMENT MARKINGS SHALL CONFORM WITH THE CURRENT EDITION OF THE MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES FOR STREETS AND HIGHWAYS AND THE FLORIDA DEPARTMENT OF TRANSPORTATION
- 2. ALL EXISTING SIGNS ARE TO REMAIN UNLESS OTHERWISE SPECIFIED. BEFORE STARTING THE PROJECT, THE CONTRACTOR WILL REVIEW EXISTING SIGNS SHOWN ON THE PLANS TO BE RELOCATED OR TO REMAIN. THE CONTRACTOR WILL NOTIFY IN WRITING TO THE PROJECT ENGINEER OF ANY MISSING SIGNS BEFORE CONSTRUCTION STARTS. SIGNS DAMAGED BY THE CONTRACTOR'S OPERATIONS WILL BE REPLACED AT NO COST TO THE DEPARTMENT. IF EXISTING SIGNS TO BE RELOCATED HAVE A DAMAGED POLE OR A POLE NOT MEETING HEIGHT SPECIFICATION REQUIREMENTS, THE COST OF A NEW POLE WILL BE INCLUDED IN THE RELOCATION BID ITEM.
- 3. ALL PAVEMENT MARKINGS, MESSAGES, AND ARROWS SHALL BE THERMOPLASTIC UNLESS OTHERWISE NOTED.
- 4. REFLECTIVE PAVEMENT MARKERS ARE TO BE PLACED ALONG THE ENTIRE LENGTH OF THE PROJECT.
- 5. MATCH EXISTING PAVEMENT MARKINGS AT THE BEGINNING AND AT THE END OF THE PROJECT AND AT ALL SIDE STREETS WITHOUT JOGS OR OFFSETS.
- 6. THE CONTRACTOR SHALL REMOVE EXISTING MARKINGS BY FDOT APPROVED METHOD WITHOUT DAMAGE TO THE FRICTION COURSE.
- 7. SIGN ASSEMBLY LOCATIONS SHOWN ON PLANS WHICH ARE IN CONFLICT WITH LIGHTING, UTILITIES, DRIVEWAYS, WHEELCHAIR RAMPS, ETC. MAY BE ADJUSTED SLIGHTLY AS DIRECTED BY THE ENGINEER. EXTREME LOCATION CHANGES MUST BE APPROVED BY MIAMI-DADE SIGNALS AND SIGNS DIVISION.

8. THE CONTRACTOR SHALL RELOCATE ALL EXISTING POST-MOUNTED STREET NAME AND STOP SIGNS TO A VISIBLE AREA UNDISTURBED BY THE CONSTRUCTION SO AS TO MINIMIZE DAMAGE TO THE SIGNS. NEW STREET NAME SIGNS WILL BE ATTACHED AT THE TOP OF THE NEW STOP SIGNS ON MINOR SIDE STREETS AT THE END OF CONSTRUCTION.

MARKINGS


MATCH EXIST. PAVEMENT


- EXTRUDED ALUMINUM SIGN SUPPORT CLAMPS ARE NOT ACCEPTABLE. ALL
 RELOCATED SIGNS MUST COMPLY WITH THE LATEST FDOT DESIGN STANDARDS
 AS IF THEY WERE NEW SIGNS. IF EXISTING CLAMPS, BRACKETS, POLES, ETC.
 NEED TO BE REPLACED THE COST SHALL BE INCLUDED IN THE RELOCATION
- 10. Any signing materials, including supports, to be removed as noted on plan sheets, shall be delivered by the contractor in existing condition, in care of the storekeeper at the miami-dade county MAINTENANCE YARD, 7100 NW 36 STREET, MIAMI, FL 33166.
- 11. SCHOOL CROSSING SIGNAGE AND SCHOOL SPEED ZONE SIGNAGE TO CONFORM WITH MUTCD/FDOT STANDARDS (FLUORESCENT YELLOW-GREEN BACKGROUNDS).
- 12 REFLECTIVE PAVEMENT MARKERS AS PER FDOT STANDARD INDEX NO 706-001 (INCLUDING BLUE RPMS FOR FIRE HYDRANTS).



the Contractor shall verify and be esponsible for all dimensions, DO NOT		NAME	DATE		NAME	DATE
cale the drawing - any errors or amissions hall be reported to Stantec without delay. The Copyrights to all designs and drawings		CMH	07/29/2020	DRAWN By	MS	07/29/2
are the property of Stantec, Reproduction or use for any purpose other than that	CHECKED BY	СМН		CHECKED BY	CMH	
authorized by Stantec is forbidden.	SUPERVISED B	Y:				



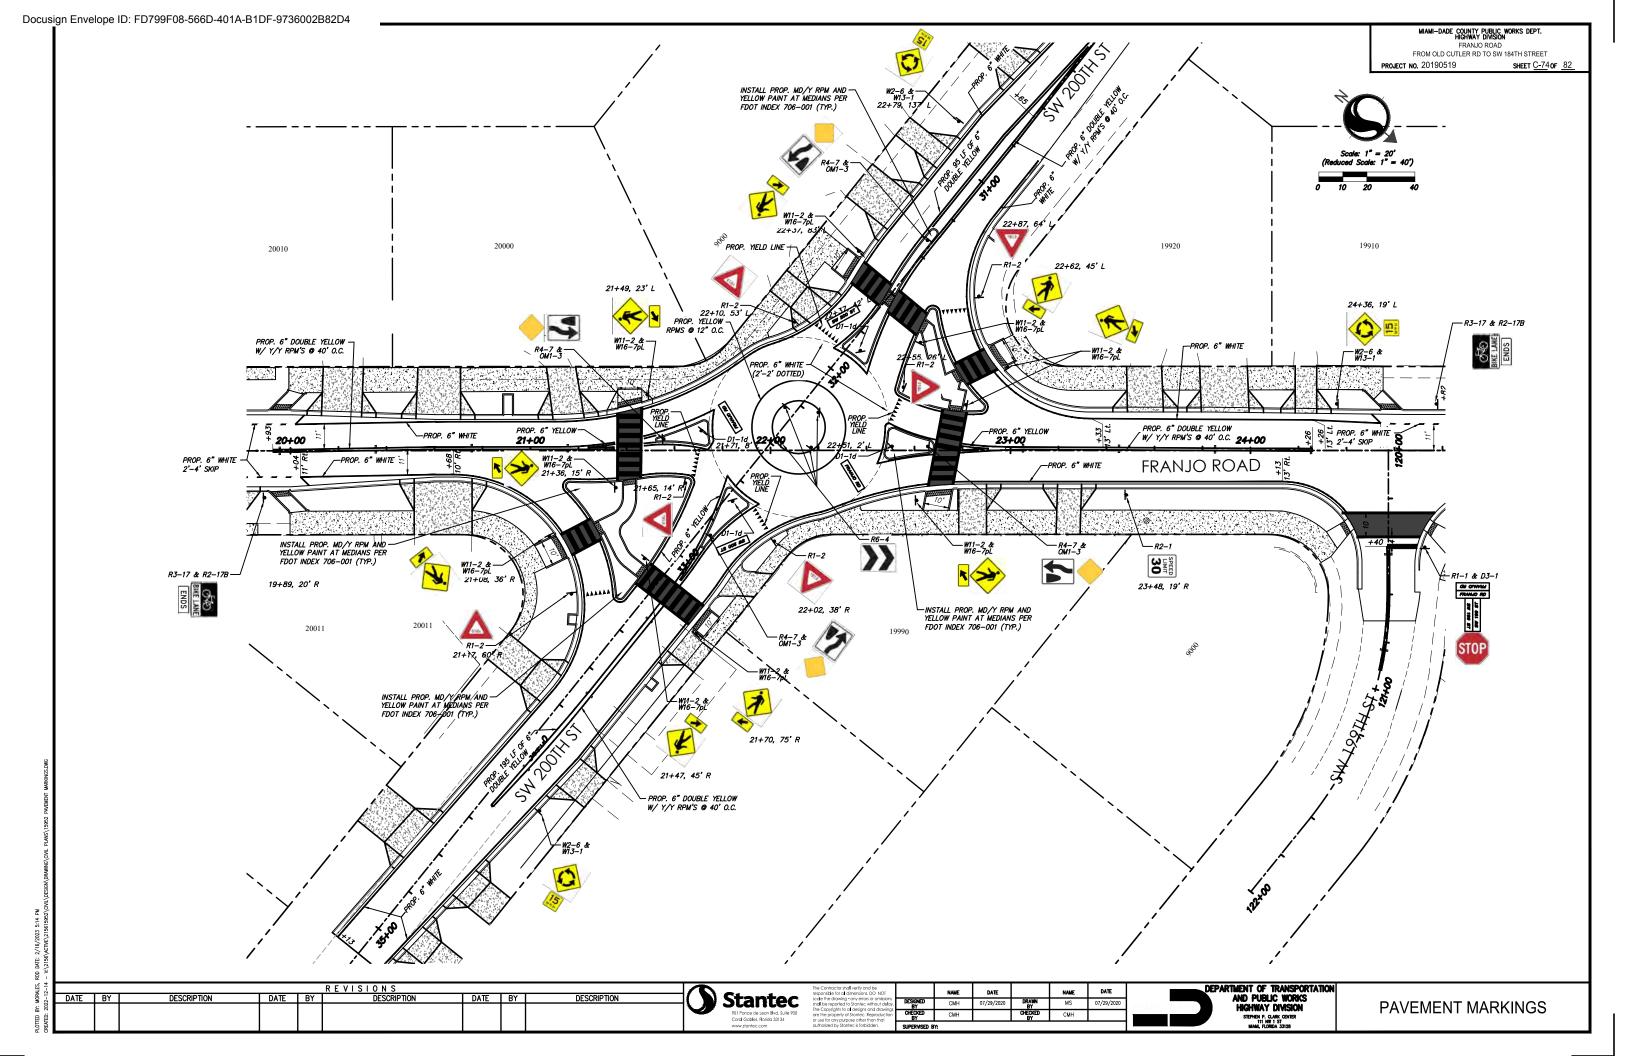

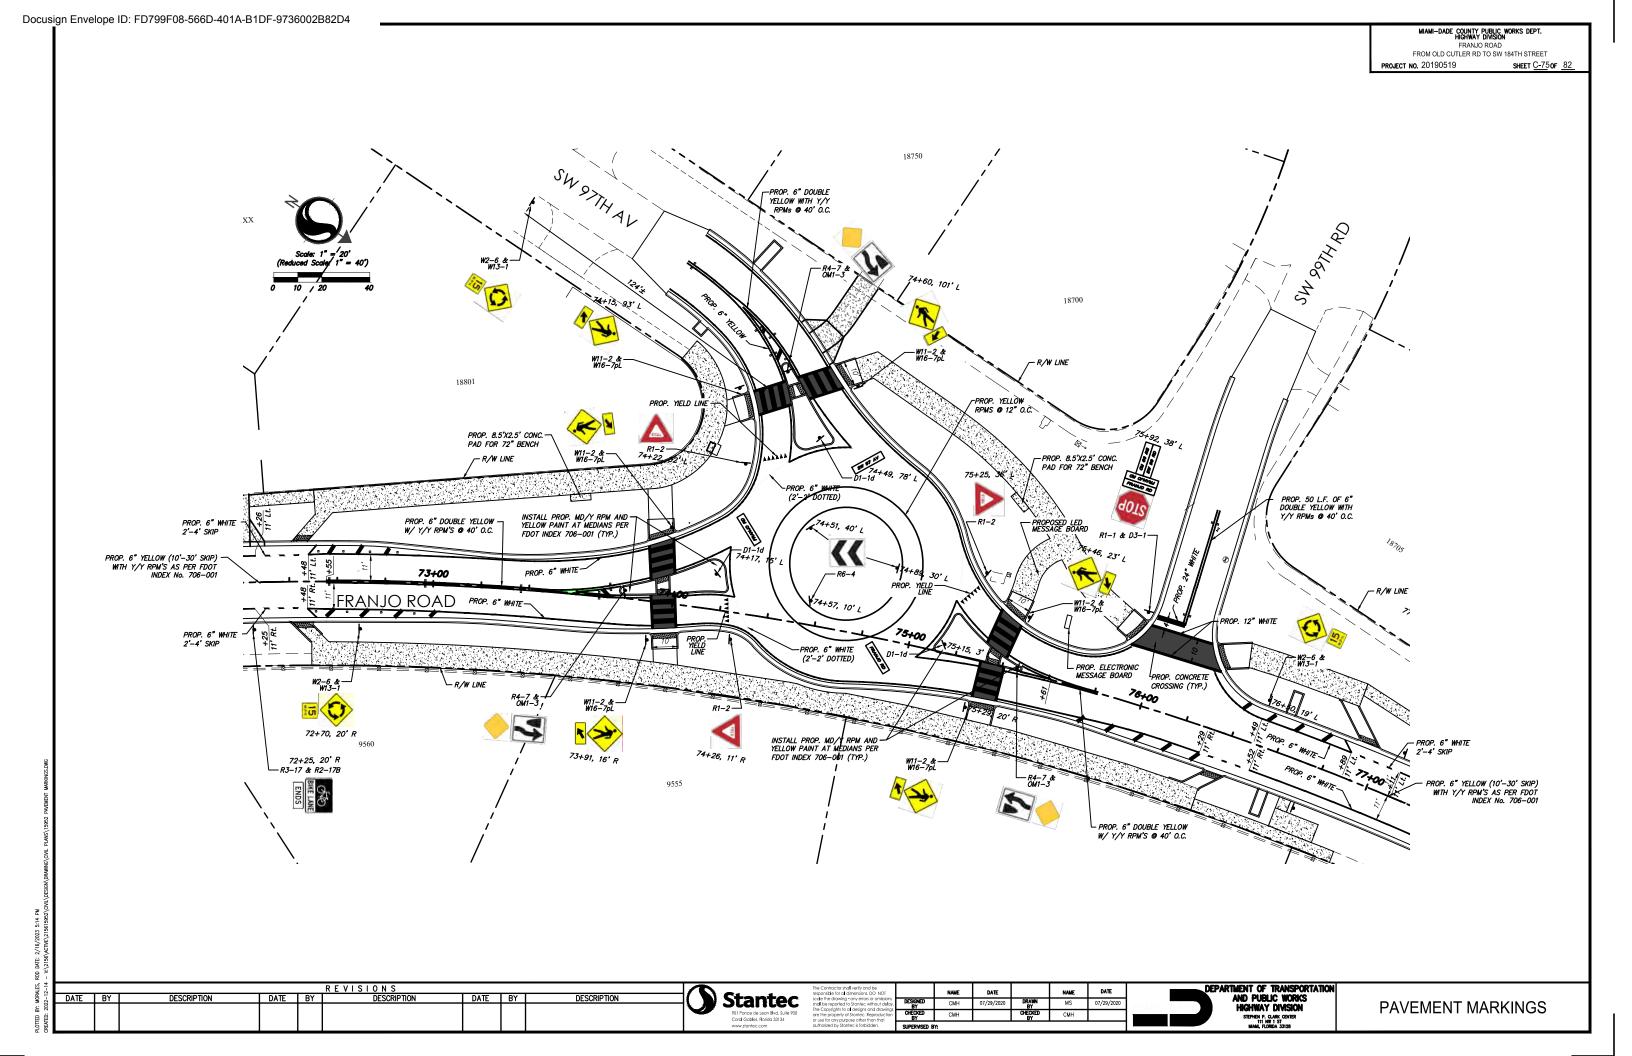

-× 778'±

18500


- R/W LINE


92+00

EXISTING FP&L SERVICE POINT— (WOOD POWER POLE) W/ SERVICE DISCONNECT. MUST BE REPLACED IF THEY DON'T MEET MIAMI DADE COUNTY STANDARD 639.

FRANJO ROAD


DETAIL OF SIGNAL HEADS






PEDESTRIAN COUNTDOWN SIGNAL (2 EXISTING, TO REMAIN)





R10-3N TO BE INCLUDED IN THE COST OF ITEM NO. 665-11 (2 REQ'D)





R/W LINE

89+00

6

CONTROLLER OPERATIONS

- 1. MAJOR STREET IS: FRANJO RD, PHASE 1 (MOVEMENTS 2 & 6) MINOR STREET: PEDESTRIAN MOVEMENT PHASE 2 (P4)
- 2. STANDARD SIGNAL OPERATING PLAN NO. 17 WITH THE FOLLOWING:
- (A) COORDINATION ON PHASE 1 (MOVEMENTS 2 & 6).
- (B) ACTUATED PEDESTRIANS FOR PHASE 2 (P4)

(-)				_		_		
(C)	FLASHING	OPERATION:	MOVEMENTS	2	åc	6	_	YELLOW

	CONTROLLER TIMING REFERENCE TABLE								
,	VEHICLE MOVEMENT	1	2	3	4	5	6	7	8
	APPROACH DIRECTION	-	SB	-	-	-	NB	-	-
<u>N</u>	APPROACH POSTED SPEED	-	30	-	-	-	30	-	-
-UNCTION	ALL RED DISTANCE	-	40	-	-	-	118	-	-
E	YELLOW CLEARANCE	-	4.0	-	-	-	4.0	-	-
	ALL RED CLEARANCE	-	2.0	-	-	-	2.0	-	-
			P2		P4		P6		
NO.	PED. CROSSING DISTANCE	-	_	-	30	_	-	-	-
UNCTION	PEDESTRIAN WALK	-	_	_	10	_	-	-	_
\Box	PEDESTRIAN CLEARANCE	_	_	_	8	_	_	_	_

SIGNAL TIMINGS ARE APPROXIMATE AND FINAL TIMINGS SHALL BE PROVIDED BY D.C.P.W. SIGNALS & SIGN DIVISION

Q	Stantec 901 Ponce de Leon Bird, Sulle 900 Cord Gables, Florida 33134 www.stantec.com	The C responsion scale shall b The C ore the or use author

The Contractor shall verify and be responsible for all dimensions, DO NOT		NAME	DATE		NAME	DATE	
scale the drawing - any errors or omissions shall be reported to Stantec without delay. The Capyrights to all designs and drawings		СМН	07/29/2020	DRAWN BY	RM	07/29/2020	L
ore the property of Stantec. Reproduction or use for any purpose other than that	CHECKED BY	CMH		CHECKED BY	CMH		
outhorized by Stantec is forbidden.	SUPERVISED B	Y:					

EXISTING

-630-2-12

630-2-12

L₆₃₀₋₂₋₁₂

PROPOSED

B PED

~635-2-11(13"X24") NEW TO BE INSTALLED

-EXIST. SIGNAL TRAFFIC CABINET TO REMAIN

P4

A

MA

EXISTING

18455 HOLY ROSARY - ST RICHARD

CATHOLIC SCHOOL

-EXIST. MAST ARM TO REMAIN (647-11-40) EXIST. PEDESTRIAN SIGNAL HEAD ASSEMBLY TO REMAIN, PEDESTRIAN DETECTOR TO BE REMOVED. NEW PEDESTRIAN DETECTOR WILL BE INSTALLED ON NEW PEDESTAL.

— EXISTING AT&T (MH) SERVICE POINT

W.S

85TH

Ŧ

└ R/W LINE

EXIST. ALUMINUM PEDESTRIAN - POST & EXIST. PEDESTRIAN SIGNAL HEAD ASSEMBLY TO REMAIN. EXIST. PEDESTRIAN DETECTOR TO BE REMOVED. NEW PEDESTRIAN DETECTOR WILL BE INSTALLED ON NEW PEDESTAL.

NEW TO BE INSTALLED 646-1-12 665-1-11

NEW TO BE INSTALLED — 646-1-12 665-1-11

INSTALLED

635-2-11(13"X24") -NEW TO BE

(PED) B

PROPOSED

Ø2

TF 2

SIGNAL OPERATION PLAN

Ø1

TF 1

90+00

PEPARTMENT OF TRANSPORTATION AND PUBLIC WORKS HIGHWAY DIVISION

SIGNALIZATION PLANS

CONTROLLER TIMING REFERENCE TABLE									
١	VEHICLE MOVEMENT	1	2	3	4	5	6	7	8
	APPROACH DIRECTION	-	SB	_	-	-	NB	-	-
NO	APPROACH POSTED SPEED	-	30	-	-	-	30	-	-
1CT	ALL RED DISTANCE	-	40	-	-	-	118	-	-
ALL RED DISTANCE - 40 11 YELLOW CLEARANCE - 4.0 4	-	-	4.0	-	-				
	2.0	-	-						
			P2		P4		P6		
NOI	PED. CROSSING DISTANCE	-	-	-	30	-	-	-	-
FUNCTION	PEDESTRIAN WALK	-	-	-	10	-	-	-	-
FUI	PEDESTRIAN CLEARANCE	-	-	-	8	-	-	-	_

FRANJO RD. BET. SW 184 186 ST SIGNALIZATION PLAN INT. ID# 3416


					REVISIONS			
DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION




LED ILLUMINATED 5 SECTION , 1 WAY (2 PROPOSED)



LED ILLUMINATED 3 SECTION , 1 WAY (4 EXISTING, TO REMAIN)



LED ILLUMINATED 3 SECTION , 1 WAY (2 EXISTING, TO BE RELOCATED) ITEM NO. 650-1-74



REMOVAL ITEMS								
ITEM NO.	ITEM NO. ITEM DESCRIPTION							
650-1-60	TRAFFIC SIGNAL HEAD ASSEMBLY	2						

CARIBBEAN BLVD. (4 EXISTING)


DON'T CROSS

TO CROSS



LED ILLUMINATED STREET SIGN (2 EXISTING)

LED ILLUMINATED STREET SIGN (2 EXISTING)





DETEC	DETECTORS FOR LOOPS										
M∨M'T	NO. OF	NO. OF									
NO.	L00PS	DETS.									
L-3	1	1									
L-4	1	1									
L-7	1	1									
L-8	1	1									

	CONTROLLER TIMING REFERENCE TABLE								
VEHICLE MOVEMENT 1 2 3 4 5 6 7 8								8	
	APPROACH DIRECTION	-	WB	-	NB	-	EB	-	SB
$\frac{8}{2}$	APPROACH POSTED SPEED	-	30	-	30	-	30	-	30
FUNCTION	ALL RED DISTANCE	_	52	_	61	_	51	-	61
E	YELLOW CLEARANCE	_	3.7	_	3.7	_	3.7	_	3.7
	ALL RED CLEARANCE	_	2	_	2	_	2	_	2
			P2		Р4		P6		P8
NO	PED. CROSSING DISTANCE	-	57	-	65	-	57	-	64
INCTION	PEDESTRIAN WALK	-	7	-	7	-	7	-	7
Ē	PEDESTRIAN CLEARANCE	-	14	_	16	-	14	-	16

SIGNAL TIMINGS ARE APPROXIMATE AND FINAL TIMINGS SHALL BE PROVIDED BY D.C.P.W. SIGNALS & SIGN DIVISION

- 1. MAJOR STREET IS CARIBBEAN BLVD, MINOR STREET IS FRANJO RD
- 2. SIGNAL OPERATING PLAN AS SHOWN

MA) P6

EXISTING

EXIST. R/W LINE-

635-2-11(1)

ROAD

FRANJÓ

630-2-12-

EXIST. MAST ARM REMAIN 647-11-36

EXISTING

CARIBBEAN BLVD

EXIST. MAST ARM T REMAIN 647-11-36

EXIST. R/W LINE-

6

- PHASE(S) ____2__ ___ACTUATED, PHASE ___1 RECALL
- 4. MOVEMENT(S) N/A IS(ARE) PROTECTED/PERMISSIVE
- 5. SIGNAL COORDINATION PHASE IS 1
- 6. FLASHING OPERATION: 2,6 YELLOW; 4 & 8 RED

NOTES:

EXISTING

EXIST. PEDESTAL TO

635-2-11(13"X24") NEW TO BE INSTALLED

REMAIN 647-11-30

└635-2-11(13"X24") NEW TO BE INSTALLED

EXIST. R/W LINE

EXISTING FP&L SERVICE POINT — (WOOD POWER POLE) W/ SERVICE DISCONNECT. MUST BE REPLACED IF THEY DON'T MEET MAMI DADE COUNTY STANDARD 639.

2

- 1. THE DEMAND WATTAGE FOR THIS INTERSECTION IS XXX WATTS.
- 2. REMOVE ALL PAVEMENT MARKINGS, RAISED PAVEMENT MARKERS AND SIGNS IN CONFLICT WITH THIS PLAN.
- REMOVE EXISTING SIGNAL EQUIPMENT AND RETURN UNDAMAGED TO MIAMI-DADE COUNTY PUBLIC WORKS DEPARTMENT, SIGNAL AND SIGNS DIVISION (7100 N.W. 36 ST)
- 4. SIGNAL TIMING SHALL BE PROVIDED BY MIAMI-DADE COUNTY PUBLIC WORKS DEPARTMENT.
- 5. PAVEMENT MARKING ARE SHOWN FOR INFORMATION ONLY. SEE SIGNING & PAVEMENT MARKING PLANS.

FRANJO RD. & CARIBBEAN BLVD SIGNALIZATION PLAN INT. ID# 3968

DESCRIPTION



The Contractor shall verify and be responsible for all dimensions. DO NOT		NAME	DATE		NAME	DATE
scale the drawing - any errors or omissions shall be reported to Stantec without delay. The Copyrights to all designs and drawings	DESIGNED BY	CMH	07/29/2020	DRAWN BY	RM	07/29/2020
ore the property of Stantec, Reproduction or use for any purpose other than that	CHECKED BY	СМН		CHECKED BY	СМН	
authorized by Stantec is forbidden.	SUPERVISED BY	Y:				



AND PUBLIC WORKS HIGHWAY DIVISION

SIGNALIZATION PLANS

TABULATION OF SIGNALIZATION QUANTITIES

			SHEET NUMBER									TAL SHEET	GRAND TOTAL	
PAY ITEM	DESCRIPTION			- <i>76</i>		-77					THIS	SHEET	TO	TAL
NO.	DESCRIPTION	UNIT	ORIG	FINAL		FINAL	ORIG	FINAI	ORIG	FINAL	ORIG	FINAL	ORIG	FINAL
			10/1/0.	THAL	0/1/0.	THAL	0/1/0.		0/1/0.	/ /////L	0/1/0.	1 11 VAL	10/1/0.	111111
													+	
670 0 10	CONDUIT (HIDED DAVENEDIT) CUDIICU A INCTALL DIDECTORAL DODE		00		700		-						757	
630-2-12	CONDUIT (UNDER PAVEMENT) FURNISH & INSTALL DIRECTIONAL BORE	LF	28		329		-						357	
	THE PARTY WHEN A WARRY AND				<u> </u>									
635-2-11	PULL BOXES, FURNISH & INSTALL, 13"X24" COVER SIZE.	EA	2		3								5	
646-1-11	ALUMINUM SIGNAL PEDESTRIAN POLE, FURNISH & INSTALL	EA	2		0								2	
646-1-12	ALUMINUM SIGNAL POLE, FURNISH & INSTALL	EA	2		0								2	
650-1-18	FURNISH AND INSTALL TRAFFIC HEAD (1 WAY, 5 SECTIONS) (BACKPLATES INCLUDED)	AS	0		2								2	
660-2-106	LOOP ASSEMBLY, FURNISH & INSTALL (TYPE F, 6'X30')	EA	0		4								4	
650-1-60	REMOVE TRAFFIC HEAD (1 WAY, 3 SECTIONS)	AS	0		2								2	
650-1-74	RELOCATE TRAFFIC HEAD (1 WAY, 3 SECTIONS)	AS	0		2								2	
665-1-60	REMOVE PEDESTRIAN DETECTOR	EA	2		0								2	
													1	
													+	
													+	
													+	
													+	
													+	
													+	
					-		-						+	
					-		-						+	
													1	
			1											
			+											
			+											
			+										+	
			+	1	-	1	-					+	+	
			+										+	
			+										+	
			+	-	-	-	-					-	+	
			+										+	
			+										+	
			1	1	1	1	1	I .	1	1	1	1	1	1

MIAMI-DADE COUNTY PUBLIC WORKS DEPT. HIGHWAY DIVISION

FROM OLD CUTLER RD TO SW 184TH STREET PROJECT NO. 20190519 SHEET <u>C-77</u>**&**F <u>82</u>

NOTES

- ALL TRAFFIC SIGNALIZATION CONDUIT AND WIRING SHALL BE IN ACCORDANCE WITH SIGNALIZATION PLANS AND SHALL BE SUFFICIENT QUANTITY FOR COMPLETE INSTALLATION.
- ALL HARDWARE INCIDENTAL TO THE COMPLETE SIGNALIZATION AS INDICATED ON PLAN SHEETS AND SUMMARY OF QUANTITIES SHEET SHALL BE INCLUDED IN THE COST OF ITEMS SUPPLIED.
- 3. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING A COMPLETE ASSEMBLY WHEN SPECIFIED IN THE TABULATION OF QUANTITIES.
- 4. WHEN TWO, THREE, AND FOUR WAY SIGNAL HEAD BRACKETS ARE SPECIFIED, THE TOP BRACKET SHALL BE CONSTRUCTED OF HOLLOW CAST ALUMINUM AND THE BOTTOM BRACKET SHALL BE CAST ALUMINUM, BOTH WITH STAINLESS STEEL STUDS, WASHERS, AND NUTS.
- SIGNAL HEADS SHALL BE OF CAST ALUMINUM AND SHALL HAVE FLAT BLACK BODIES WITH FLAT BLACK TUNNEL VISORS AND DOORS. THE SIGNAL LENSES SHALL BE GLASS.
- 6. ALL GROUND RODS SHALL BE COPPER CLAD $\%^{\circ}$ X10'-0" SECTIONS WITH BONDING WIRE AND CLAMP.
- 7. LOOP DETECTORS SHALL BE TWO-CHANNEL "SCANNING" TYPE SHELF MODEL WITH RELAY FAIL CALL OUTPUT PER MIAMI-DADE COUNTY SPECIFICATIONS.
- 8. THE CONTRACTOR SHALL BE RESPONSIBLE FOR COMPENSATING AT&T FOR PROVIDING AND CONNECTING SERVICE PICK-UP. THE CONTRACTOR SHALL ALSO PROVIDE PULL WIRE FOR AT&T SERVICE CONDUIT.
- THE CONTRACTOR SHALL CONTACT FP&L AND AT&T REPRESENTATIVE PRIOR TO INSTALLING CONDUITS TO THEIR MANHOLES. THE SERVICE CONDUIT SHALL BE BROUGHT TO THE MANHOLES FROM THE SIDES AND NOT THE TOP.
- 10. CONTRACTOR SHALL REPLACE ENTIRE SIDEWALK FLAG WHEN SIDEWALK IS DISTURBED BY CONSTRUCTION. CONTRACTOR SHALL RESTORE EXISTING PAVEMENT MARKINGS DISTURBED BY TRENCHING OF SAW CUTTING.
- 11. INSTALL SPARE CONDUIT OF EQUAL LENGTH TO SIGNAL CONDUIT WITHIN SAME TRENCH.










FRANJO ROAD FROM OLD CUTLER RD TO SW 184TH STREET **PROJECT NO.** 20190519 SHEET C-78 OF 82



(REDUCED SCALE: 1" = 800')

LEGEND: PHASE 1 DETOUR -> PHASE 2 DETOUR

PHASE 3 DETOUR -PHASE 4 DETOUR

* PHASING CONSTRUCTION NOTE:


PHASING ORDER IS TO BE DETERMINED AND IS NOT REQUIRED TO BE AS NOTED ABOVE. CONTRACTOR TO SUBMIT TO MIAMI-DADE COUNTY PUBLIC WORKS AND WASTE MANAGEMENT DEPARTMENT HIGHWAY DIVISION AND TOWN OF CUTLER BAY FOR



CONSTRUCTION NOTE:

CONSTRUCTION NOTE:

LOCATION OF EXISTING FACILITIES AS SHOWN ON CONSTRUCTION DRAWINGS ARE FROM AVAILABLE RECORDS. THE ENGINEER ASSUMES NO RESPONSIBILITY FOR THE ACCURACY OF THE FACILITIES SHOWN OR FOR ANY FACILITY NOT SHOWN. VERIFY THE ELEVATION, TYPE OF PIPES AND LOCATION OF EXISTING FACILITIES PRIOR TO CONSTRUCTION. IF AN EXISTING FACILITY IS FOUND TO CONFLICT WITH THE PROPOSED CONSTRUCTION UPON EXCAVATION THE CONTRACTOR SHALL IMMEDIATELY NOTIFY THE ENGINEER OF RECORD SO THAT APPROPRIATE MEASURES CAN BE TAKEN TO RESOLVE THE PROBLEM. CONTRACTOR TO NOTIFY MIAMI-DADE COUNTY AND SUNSHINE STATE ONE CALL OF FLORIDA, INC. © 811 AT LEAST FORTY EIGHT (48) HOURS PRIOR TO EXCAVATING. EVIDENCE OF SUCH NOTICE SHALL BE FURNISHED TO ENGINEER OF RECORD PRIOR TO EXCAVATING.

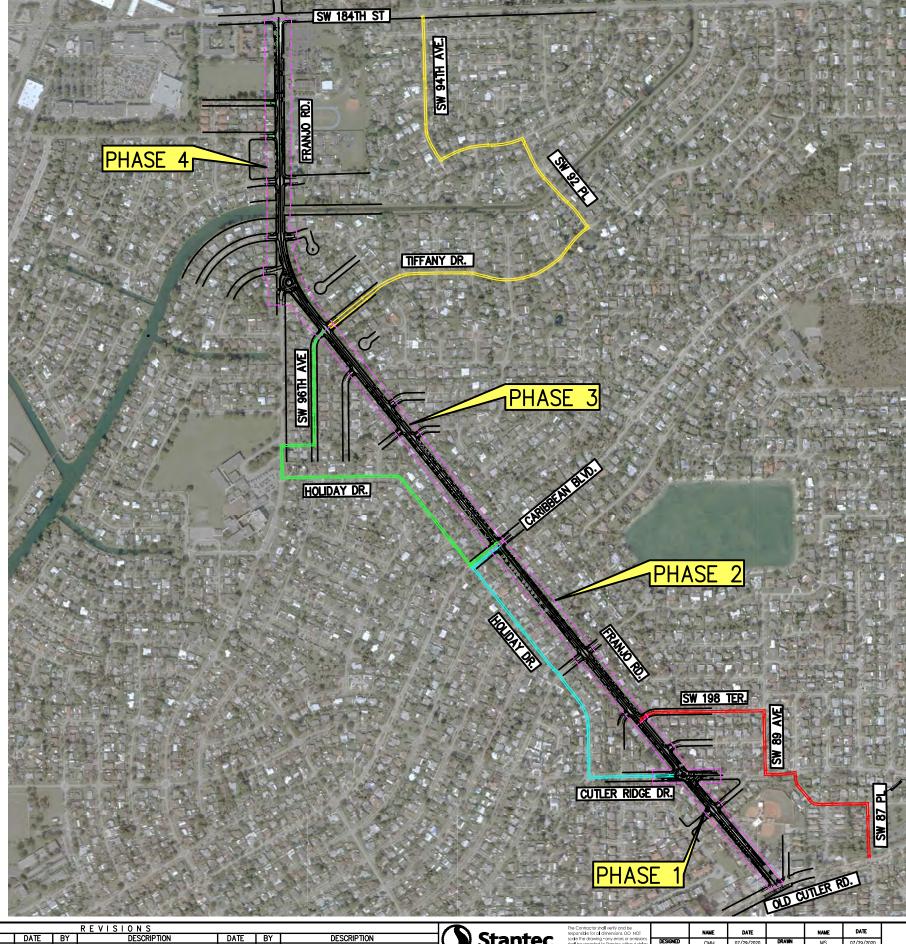

DESCRIPTION

GENERAL NOTES

- TRAFFIC CONTROLS SHALL BE IN ACCORDANCE WITH THE PROJECT PLANS, THE MIAMI-DADE COUNTY PUBLIC WORKS MANUAL AS PERTAINS TO MAINTENANCE OF TRAFFIC, THE 2023-24 EDITION OF THE FLORIDA DOT DESIGN STANDARDS (102-600 SERIES), THE STANDARD SPECIFICATION FOR ROAD AND BRIDGE CONSTRUCTION, AND THE MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES AS MINIMUM CRITERIA
- THE CONTRACTOR SHALL DEVELOP MAINTENANCE OF TRAFFIC PLAN OF HIS OWN, MEETING THE REQUIREMENTS SPECIFIED IN THE MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES LATEST EDITION AND THE FDOT INDEX 102-600 SERIES. THE CONTRACTOR'S MAINTENANCE OF TRAFFIC PLANS SHALL BE SUBMITTED TO THE TRAFFIC ENGINEERING DIVISION FOR REVIEW AND APPROVAL PRIOR TO START OF CONSTRUCTION. THE PLANS SHALL BE SIGNED AND SEALED BY A PROFESSIONAL ENGINEER REGISTERED IN THE STATE OF FLORIDA.
- TEMPORARY PAVEMENT SHALL CONSIST OF A MINIMUM OF 6 INCH LIMEROCK BASE, PRIME COAT AND HMA. THE BASE LAYER SHALL BE PLACED OVER A FIRM, UNYIELDING, WELL-COMPACTED SUBGRADE. COST OF CONSTRUCTION AND REMOVAL OF TEMPORARY PAVEMENT TO BE INCLUDED IN PAY ITEM 339-1 TEMPORARY PAVEMENT.
- NOTIFICATION OF LANE CLOSURES OR TEMPORARY DETOURS SHALL BE ACCOMPLISHED 14 WORKING DAYS PRIOR TO CLOSURE OR DETOUR BY COORDINATING WITH MIAMI-DADE COUNTY PUBLIC WORKS DEPARTMENT'S TRAFFIC ENGINEERING DIVISION AND TRAFFIC CONTROL CENTER.
- AT THE DISCRETION OF THE TRAFFIC ENGINEER, IF A LANE CLOSURE CAUSES EXTENDED CONGESTION OR DELAY, THE CONTRACTOR SHALL BE DIRECTED TO REOPEN THE CLOSED LANE(S) UNTIL SUCH TIME THAT THE TRAFFIC FLOW HAS RETURNED TO AN ACCEPTABLE LEVEL.
- THE TRAFFIC AND TRAVEL WAYS SHALL NOT BE ALTERED BY THE CONTRACTOR TO CREATE A WORK ZONE UNTIL ALL LABOR AND MATERIAL ARE AVAILABLE FOR THE CONSTRUCTION IN THAT
- LANE CLOSURE SHALL OCCUR ONLY DURING NON-PEAK HOURS ON NONEVENT DAYS/NIGHTS. NO INTERRUPTION TO TRAFFIC IS PERMITTED FROM MONDAY-FRIDAY 7-9 A.M. AND 4-6 P.M. OR ON WEEKENDS AND HOLIDAYS OR DURING SCHOOL ARRIVAL OR DISMISSAL PERIODS IN THE VICINITY OF SCHOOLS.
- REGULATORY SPEED ESTABLISHED WITHIN THE WORK ZONE TRAVEL WAYS SHALL BE 20 M.P.H. REDUCED SPEED AND REGULATORY SPEED SIGNS SHALL BE INSTALLED ON SEPARATE POSTS IN ACCORDANCE WITH THE STANDARD INDEXES AND MUTCD.
- CONTRACTOR SHALL MAINTAIN ACCESS TO PRIVATE PROPERTY DURING ALL PHASES OF CONSTRUCTION. LOCAL RESIDENTS WITHIN THE AREA OF CONSTRUCTION SHALL BE GIVEN ACCESS TO THEIR PROPERTY DURING ALL PHASES OF CONSTRUCTION. LOCAL RESIDENTS INCLUDE ALL COMMERCIAL ESTABLISHMENTS AND BUSINESSES.
- SIGNS ARE TO BE LOCATED BEFORE EACH BUSINESS OR SHOPPING PLAZA ENTRANCE WHERE CONSTRUCTION NEGATIVELY IMPACTS THE ACCESS TO THE BUSINESS OR SHOPPING PLAZA OR AS DIRECTED BY THE ENGINEER. TWO SIGNS WILL TYPICALLY BE REQUIRED AT EACH ENTRANCE. SIGNS ARE TO BE DISPLAYED AS DESCRIBED IN INDEX 102-600 OF THE ROADWAY AND TRAFFIC DESIGN STANDARDS.
- AS DETERMINED BY THE ENGINEER, THE CONTRACTOR SHALL COVER WORK ZONE SIGNS WHEN CONDITIONS NO LONGER WARRANT THEIR USE. COST OF COVERING AND UNCOVERING THE SIGNS SHALL BE INCLUDED IN PAY ITEM 102-1. MAINTENANCE OF TRAFFIC.
- CONTRACTOR SHALL REMOVE, RELOCATE, OR COVER ANY EXISTING OR PROPOSED SIGNS THAT CONFLICT WITH THE TRAFFIC CONTROL PLANS. WHEN THE CONFLICT NO LONGER EXISTS, THE CONTRACTOR SHALL RESTORE THE SIGNS TO THEIR ORIGINAL POSITION. COST OF TEMPORARILY REMOVING, RELOCATING, COVERING, AND RESTORING THE SIGNS SHALL BE INCLUDED IN THE PAY ITEM 102-1, MAINTENANCE OF TRAFFIC.
- EACH EXISTING STREET NAME AND TRAFFIC SIGN AFFECTED BY CONSTRUCTION SHALL BE RELOCATED AND MAINTAINED IN AN APPROPRIATE LOCATION FOR THE DURATION OF THE PROJECT. WHEN NO LONGER AFFECTED BY CONSTRUCTION, THESE SIGNS SHALL BE RESTORED IN 26. THEIR ORIGINAL POSITION AND CONDITION. IF DAMAGED, SIGNS ARE TO BE REPLACED. COST OF TEMPORARILY RELOCATING AND RESTORING THE SIGNS SHALL BE INCLUDED IN PAY ITEM 102-1, MAINTENANCE OF TRAFFIC.
- THE CONTRACTOR SHALL NOT PROPOSE ANY ALTERNATIVE TRAFFIC CONTROL PLAN THAT REDUCES THE NUMBER OF TRAVEL LANES SHOWN ON THE CONTRACT TRAFFIC CONTROL PLANS.
- ARROWS ON THE TRAFFIC CONTROL PLAN DENOTE THE DIRECTION OF TRAFFIC ONLY AND DO NOT REFLECT PAVEMENT MARKINGS UNLESS SPECIFICALLY NOTED.

- FOR DROP-OFF, THE CONTRACTOR'S ATTENTION IS DIRECTED TO FDOT STANDARD INDEX NO. 102-600, SHEET 8 OF 11. THE CONTRACTOR SHALL USE SHOULDER TREATMENT DETAIL WHEN NO BARRIERS ARE REQUIRED IN THE PLANS.
- DURING ASPHALT CONSTRUCTION OPERATIONS, NO MORE THAN $1\frac{1}{4}$ " DROP-OFF BETWEEN ADJACENT TRAVEL LANES OR AT TRANSVERSE JOINTS SHALL BE ALLOWED WHEN LANES ARE OPEN TO TRAFFIC. WHERE DROP OFF CONDITIONS EXIST, THE SIGNING FOR UNEVEN PAVEMENT SHALL BE INSTALLED FOR THE DURATION OF THE CONDITION (W8-9AP).
- THE CONTRACTOR IS TO PLACE TEMPORARY OR REMOVABLE PAVEMENT MARKINGS BETWEEN 30. EACH LAYER OF PAVEMENT, AND IS RESPONSIBLE FOR THE TEMPORARY RELOCATION OF STOP BARS & STOP SIGNS AS APPLICABLE. PAVEMENT MARKINGS AND BARRICADES PLACEMENT SHALL BE APPROPRIATELY COORDINATED.
- 19. THE CONTRACTOR SHALL REMOVE ANY EXISTING OR TEMPORARY PAVEMENT MARKINGS THAT CONFLICT WITH THE TRAFFIC CONTROL PLANS. GRINDING OR MILLING SHALL ONLY BE PERMITTED IN NON-TRAFFIC AREAS. COST OF REMOVAL OF TEMPORARY PAVEMENT MARKINGS, REGARDLESS OF METHOD, IS INCLUDED IN THE RELATED PAY ITEMS. USE OF BLACK PAINT TO COVER EXISTING AND/OR TEMPORARY PAVEMENT MARKINGS IS PROHIBITED.
- TEMPORARY RAISED PAVEMENT MARKERS (RPMS) SHALL BE INSTALLED ON THE EDGE, CENTER, AND LANE LINES OF ALL CROSS-OVERS, TRANSITIONS, AND TANGENT SECTIONS WITHIN THE WORK ZONE WHERE THE VEHICLE PATHS ARE ALTERED. THE SPACING FOR THESE RPMS SHALL BE 40 FT. ON CENTERS FOR TANGENT SECTIONS AND 5 FT. FOR TRANSITIONS, CURVES, AND CROSSOVERS. THE RPMS SHALL EXTEND 100 FT. ON THE TANGENT SECTION BEYOND EACH END OF THESE CROSSOVERS OR TRANSITION AREAS. COST OF THE TEMPORARY RPMS SHALL BE INCLUDED IN THE PAY ITEM 102-1, MAINTENANCE OF TRAFFIC.
- 21. CONTRACTOR SHALL NOTIFY MIAMI-DADE COUNTY TRAFFIC SIGNS AND SIGNALS DIVISION LOCATED AT 7100 NW 36 STREET, MIAMI, FLORIDA 33166 AND PHONE NO. (305) 592-3470, AND FDOT PHONE NO. (305) 640-7249, 48 HOURS PRIOR TO ANY MODIFICATION OF AN EXISTING TRAFFIC SIGNAL SYSTEM. THE CONTRACTOR SHALL HAVE FULL RESPONSIBILITY FOR THE MAINTENANCE OF THE EXISTING OR TEMPORARY TRAFFIC SIGNAL(S) WITHIN THE PROJECT LIMITS. COST OF RELOCATING TRAFFIC SIGNAL HEADS, PROVIDING AND REMOVING TEMPORARY SIGNALS, AND MAINTAINING THE EXISTING TEMPORARY TRAFFIC SIGNAL SHALL BE INCLUDED IN PAY ITEM 102-1, MAINTENANCE OF TRAFFIC. CONTRACTOR TO SUBMIT A DETAILED LANE CLOSURE FORM, NOTING WORK AND TIME PHASES TO THE DEPARTMENT AT LEAST TWO (2) WEEKS PRIOR TO ACTUAL LANE CLOSURE WORK WITHIN THE FDOT RIGHT OF WAY. THERE SHALL BE NO LANE CLOSURES BETWEEN THANKSGIVING AND NEW YEAR'S EVE. WORKING HOURS WITHIN THE FDOT RIGHT OF WAY SHALL BE BETWEEN THE HOURS OF 9:30 AM AND 3:30 PM.. MOT MUST BE IN ACCORDANCE WITH THE CURRENT EDITION OF THE FDOT ROADWAY AND TRAFFIC DESIGN STANDARDS- INDEX 102-600 SERIES AND M.U.T.C.D. AS A MINIMUM.
- WHEN CONSTRUCTION ACTIVITIES INVOLVE SIDEWALKS ON BOTH SIDES OF THE STREET. 22. EFFORTS SHOULD BE MADE TO STAGE THE CONSTRUCTION SO BOTH SIDEWALKS ARE NOT OUT OF SERVICE AT THE SAME TIME.
- IN THE EVENT THAT SIDEWALKS ON BOTH SIDES OF THE STREET ARE CLOSED, PEDESTRIANS SHALL BE GUIDED AROUND THE CONSTRUCTION ZONE.
- THE PROPOSED SIGNALS SHALL BE INSTALLED AND OPERATIONAL PRIOR TO THE REMOVAL OF THE EXISTING SYSTEM AND SHALL BE ADJUSTED TO THE TRAFFIC NEEDS FOR EACH CONSTRUCTION PHASE.
- THE CONTRACTOR SHALL MAINTAIN ON-LINE COMMUNICATION OF EXISTING OR TEMPORARY SIGNALIZATION VIA INTERCONNECT OR PHONE LINE CONSTRUCTION. CONTRACTORS SHALL PROVIDE TEMPORARY LINES AND CONNECTIONS IF NECESSARY. COST OF MAINTAINING COMMUNICATION, INCLUDING TEMPORARY LINES AND CONNECTIONS SHALL BE INCLUDED IN PAY ITEM 102-1, MAINTENANCE OF TRAFFIC.
- INTERSECTIONS SHALL BE RECONSTRUCTED WORKING ON A CONTINUOUS DAILY BASIS UNTIL COMPLETE AND UNTIL STRUCTURAL COURSE IS IN PLACE.
- AT ALL INTERSECTING STREETS, NO LESS THAN ONE "ROAD CONSTRUCTION AHEAD" SIGN AND ONE "END CONSTRUCTION" SIGN MUST BE INSTALLED. (TWO EACH FOR STREETS WITH MEDIAN).
- 28. ADJACENT INTERSECTIONS SHALL NOT BE CONSTRUCTED SIMULTANEOUSLY UNLESS DIRECTED BY THE ENGINEER. FOR EVERY BLOCK, CONSTRUCTION OF DRAINAGE AND SIDEWALK SHOULD BE CONCURRENT WITH ROADWAY CONSTRUCTION.

MIAMI-DADE COUNTY PUBLIC WORKS DEPT.

FROM OLD CUTLER RD TO SW 184th STREET SHEET <u>C-78</u>6F 82 PROJECT NO. 20190519

- MOT TRANSITIONS AND TEMPORARY INTERSECTION CROSSOVERS WHERE CONSTRUCTION HAS CAUSED GRADE DIFFERENCES BETWEEN THE EXISTING AND NEW ROADWAYS SHALL BE CONSTRUCTED USING A 1:20 TYPE HMA SLOPE TO ACCOMMODATE VEHICULAR TRAFFIC FROM ANY DIRECTION. ALL MATERIAL, WORK, INCLUDING ITS REMOVAL, SHALL BE INCLUDED IN PAY ITEM 102-1 AND 339-1, MAINTENANCE OF TRAFFIC AND TEMPORARY PAVEMENT.
 - COORDINATION WITH DADE COUNTY PUBLIC WORKS AND WASTE MANAGEMENT DEPARTMENT WILL BE REQUIRED.
- PAVED TEMPORARY CONNECTIONS SHALL BE PROVIDED AT INTERSECTIONS AS DIRECTED BY THE ENGINEER.
- TRAFFIC SHALL BE MAINTAINED ON A PAVED, DUST-FREE SURFACE AT ALL TIMES.
- 33. THE CONTRACTOR MUST MAINTAIN TWO LANES OF TRAFFIC AT ALL TIMES. ALL LANES TO BE A MINIMUM OF 10 FT. IN WIDTH.
- PLANS INDICATE ONLY THE PHASES FOR CONSTRUCTION. MILLING AND RESURFACING OPERATIONS MUST FOLLOW THE SAME FDOT 102-600 INDEX SERIES, AND MUST BE ACCOMPLISHED AT HOURS APPROVED BY THE ENGINEER.
- CONTRACTOR SHALL BE RESPONSIBLE FOR MAINTAINING ROADWAY LIGHTING ILLUMINATION LEVELS DURING CONSTRUCTION. THE CONTRACTOR SHALL MAINTAIN EXISTING LIGHTING OR SUPPLY TEMPORARY LIGHTING UNTIL THE PROPOSED SYSTEM IS IN OPERATION. THE CONTRACTOR SHALL SUBMIT A COMPLETE PROPOSED METHOD OF MAINTAINING LIGHTING FOR APPROVAL BY COUNTY ENGINEER PRIOR TO BEGINNING WORK. REFER TO ROADWAY LIGHTING PLANS AND OTHER APPLICABLE DRAWINGS FOR INFORMATION ON EXISTING AND PROPOSED ROADWAY LIGHTING AND DETAIL OF ROADWAY CONSTRUCTION. IF ANY PART OF THE SYSTEM IS OWNED BY F.P.&L, COORDINATE CLOSELY WITH F.P.&L.
- CONTRACTOR SHALL BE RESPONSIBLE TO PROVIDE EROSION CONTROL MEASURES TO PREVENT CLOG OF PROPOSED DRAINAGE STRUCTURES AND SEDIMENT INTRUSION ON WATERWAYS DURING CONSTRUCTION. THESE MEASURES SHALL BE APPROVED BY THE ENGINEER AND CONFORM WITH CURRENT EDITION OF THE FDOT DESIGN STANDARDS FOR EROSION CONTROL (100 SERIES).
- 37. CONTRACTOR MUST MAINTAIN DRAINAGE AT ALL TIMES. THE EXISTING DRAINAGE SYSTEM SHALL BE KEPT OPERATIONAL OR TEMPORARY DRAINAGE PROVIDED WHILE THE PROPOSED DRAINAGE SYSTEM IS BEING CONSTRUCTED. THE CONTRACTOR SHALL PROVIDE THE NECESSARY TEMPORARY DRAINAGE AS APPROVED BY THE ENGINEER. ALL COSTS SHALL BE INCLUDED IN THE PAY ITEM 102-1. MAINTENANCE OF TRAFFIC.
- AT THE END OF EACH WORK DAY OR WHENEVER THE WORK ZONE BECOMES INACTIVE, ANY DROP OFF GREATER THAN 6 INCHES (150 MM) ADJACENT TO THE PEDESTRIAN, BICYCLE, AND WHEELCHAIR TRAVEL PATHS SHALL BE BACKFILLED FLUSH WITH SAID PATHS OR PROTECTED WITH TEMPORARY FENCE, CONCRETE BARRIER WALL OR APPROVED HANDRAIL. COST SHALL BE INCLUDED IN THE PAY ITEM 102-1, MAINTENANCE OF TRAFFIC.
- PEDESTRIAN, BICYCLE, AND WHEELCHAIR TRAFFIC SHALL BE MAINTAINED AND GUIDED USING APPROVED WARNING LIGHTS, SIGNING, AND DELINEATION DEVICES ON AT LEAST ONE SIDE OF THE PROJECT AT ALL TIMES THROUGHOUT THE PROJECT LIMITS. THE TRAVEL PATH SHALL BE A MINIMUM OF 4 FT. WIDE WITH A SMOOTH SURFACE THAT IS NOT SLICK AND IT SHOULD BE RAMPED AS NECESSARY FOR CONTINUITY. COST SHALL BE INCLUDED IN THE PAY ITEM 102-1, MAINTENANCE OF TRAFFIC. MIDBLOCK CROSSWALKS SHALL BE MAINTAINED WITH ADA ACCESSIBLE PATH CONNECTING BOTH SIDES OR A PEDESTRIAN M.O.T. SHALL BE SUBMITTED AND APPROVED BY TRAFFIC ENGINEERING DIVISION FOR ALTERNATE ROUTE.
- THE CONTRACTOR SHALL FURNISH AND MAINTAIN VARIABLE MESSAGE SIGNS AS DIRECTED BY THE ENGINEER. MESSAGES FOR THE VMS SHALL BE AS DIRECTED BY THE ENGINEER. THE VMS SHALL BE IN PLACE ONE WEEK BEFORE THE START OF ANY WORK ITEMS AFFECTING THE EXISTING VEHICULAR AND PEDESTRIAN TRAFFIC. VMS INSTALLATION, OPERATION, AND REMOVAL TO BE INCLUDED IN THE PAY ITEM 102-1, MAINTENANCE OF TRAFFIC.
- THE CONTRACTOR MUST PROVIDE FLASHING ARROW BOARD FOR ANY LANE THAT IS CLOSED OR DIVERTED.

GENERAL NOTES

REVISIONS DESCRIPTION DATE BY DESCRIPTION DATE BY

Stantec

DATE DATE DESIGNED BY CHECKED BY

DEPARTMENT OF TRANSPORTATION AND PUBLIC WORKS HIGHWAY DIVISION MIAMI-DADE

COUNTY

MAINTENANCE OF TRAFFIC TYPICAL SECTIONS

Stantec

Stip Force de Leon Blvd. Sulle 900

Ord Godden, Blrdinds 3014

or use

R E V I S I O N S
DESCRIPTION

DATE BY


DESCRIPTION

DATE BY

responsible for al dimensions, DO NOT scale the clowing- on- years or anissions stall be reported to Stantec without delay. The Copyrights to al designs and drawings are the property of Stantec, Reproduction or use for any purpose other than that outhorized by Stantec is forbidden.


DEPARTMENT OF TRANSPORTATION
AND PUBLIC WORKS
HIGHWAY DIVISION
SEPHOL P. CLARK CORDER
111 NOT 15 TO
MAR, TORRON 201209

MAINTENANCE OF TRAFFIC TYPICAL SECTIONS



MIAMI-DADE COUNTY PUBLIC WORKS DEPT. HIGHWAY DIVISION

FRANJO ROAD FROM OLD CUTLER RD TO SW 184th STREET PROJECT NO. 20190519 SHEET C-800F

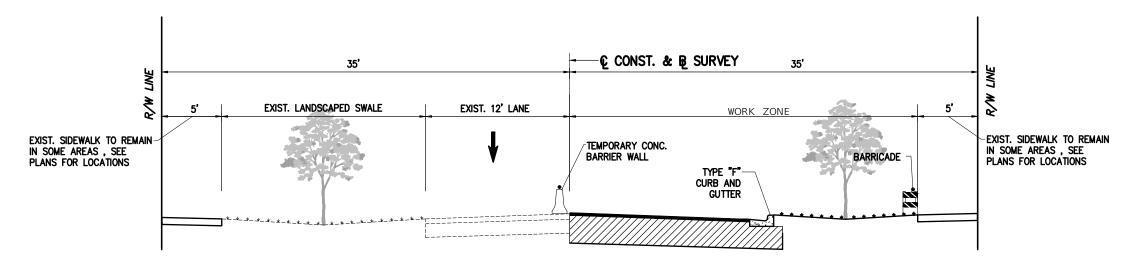

NOTE:

R E V I S I O N S DESCRIPTION

DESCRIPTION

DATE BY

SEE SHEET C-78 FOR NORTHBOUND TRAFFIC DETOUR ROUTE

PHASE 2


SUB-PHASE "A"

FROM STA 27+94 TO STA 46+55

N.T.S.

CONSTRUCTION SEQUENCE

PHASE 2: FROM STA 27+94 TO STA 46+55 REMOVE EXIST. PAVEMENT, CONSTRUCT EXFILTRATION TRENCH, PROPOSED PAVEMENT, SIDEWALK, CURB AND GUTTER, DRAINAGE SYSTEM AND LIGHTING. MAINTAIN 1-11' (MIN) TRAFFIC LANES IN THE EXISTING PAVEMENT AS SHOW IN TYPICAL SECTION. PROVIDE TEMPORARY SIGNAL AND PAVEMENT MARKINGS, AND BARRICADES.

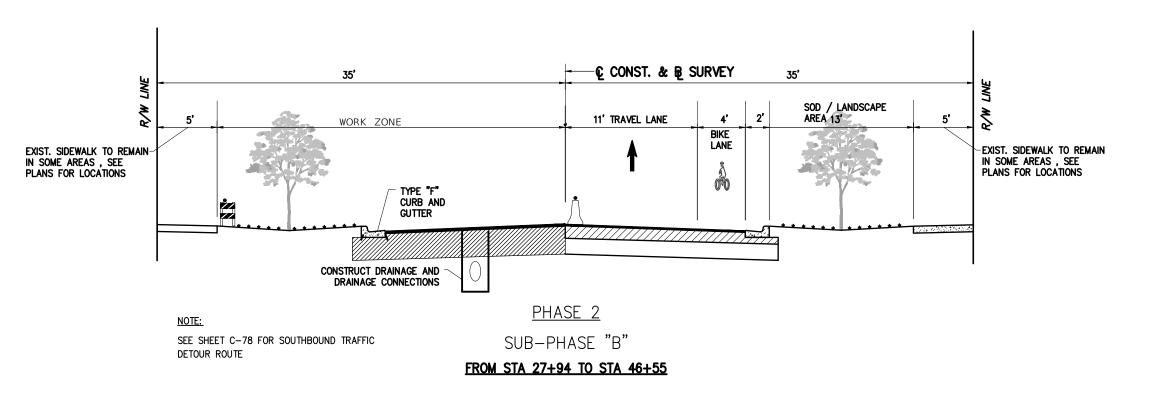

Stantec DATE BY

MIAMI-DADE COUNTY

DEPARTMENT OF TRANSPORTATION AND PUBLIC WORKS HIGHWAY DIVISION

MAINTENANCE OF TRAFFIC TYPICAL SECTIONS

PHASE 2

DESCRIPTION

DATE BY

MIAMI-DADE COUNTY PUBLIC WORKS DEPT.

FRANJO ROAD
FROM OLD CUTILER RD TO SW 184th STREET
20190519 SHEET C-81 OF 82 PROJECT NO. 20190519

PHASE 3


MAINTENANCE OF TRAFFIC

TYPICAL SECTIONS

DEPARTMENT OF TRANSPORTATION AND PUBLIC WORKS HIGHWAY DIVISION

MIAMI-DADE

COUNTY

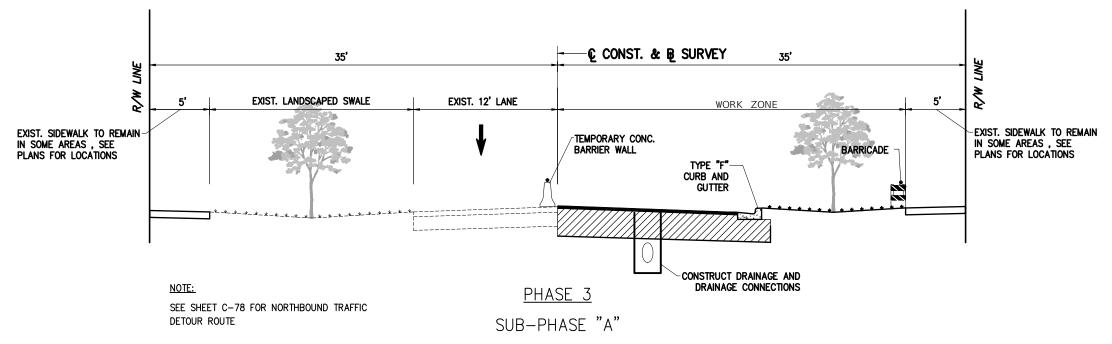


FROM STA 46+95 TO STA 69+72

N.T.S.

CONSTRUCTION SEQUENCE

PHASE 3 FROM STA 46+95 TO STA 69+72 REMOVE EXIST. PAVEMENT, CONSTRUCT EXFILTRATION TRENCH, PROPOSED PAVEMENT, SIDEWALK, CURB AND GUTTER, DRAINAGE SYSTEM AND LIGHTING. MAINTAIN 1-11' (MIN) TRAFFIC LANES IN THE EXISTING PAVEMENT AS SHOW IN TYPICAL SECTION. PROVIDE TEMPORARY SIGNAL AND PAVEMENT MARKINGS, AND BARRICADES.

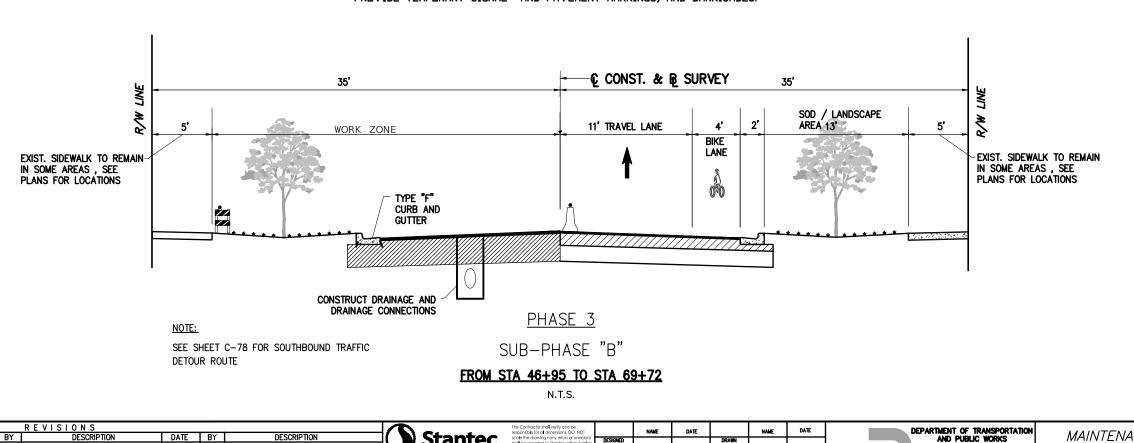

Stantec

DATE BY

DESCRIPTION

DATE BY


MIAMI-DADE COUNTY PUBLIC WORKS DEPT. FRANJO ROAD FROM OLD CUTLER RD TO SW 184th STREET

PROJECT NO. 20190519 SHEET <u>C-82</u> of 82

PHASE 4

TYPICAL SECTIONS


COUNTY

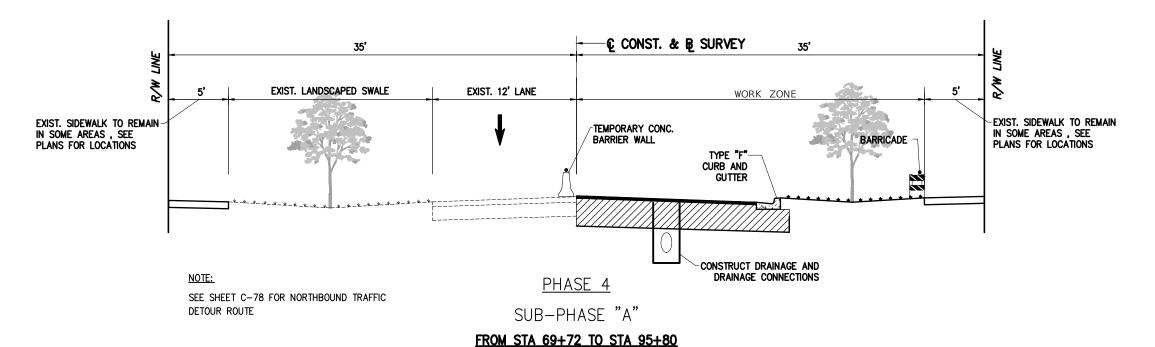

CONSTRUCTION SEQUENCE

PHASE 4: FROM STA 69+72 TO STA 95+80 REMOVE EXIST. PAVEMENT, CONSTRUCT EXFILTRATION TRENCH, PROPOSED PAVEMENT, SIDEWALK, CURB AND GUTTER, DRAINAGE SYSTEM AND LIGHTING. MAINTAIN 1-11' (MIN) TRAFFIC LANES IN THE EXISTING PAVEMENT AS SHOW IN TYPICAL SECTION. PROVIDE TEMPORARY SIGNAL AND PAVEMENT MARKINGS, AND BARRICADES.

N.T.S.

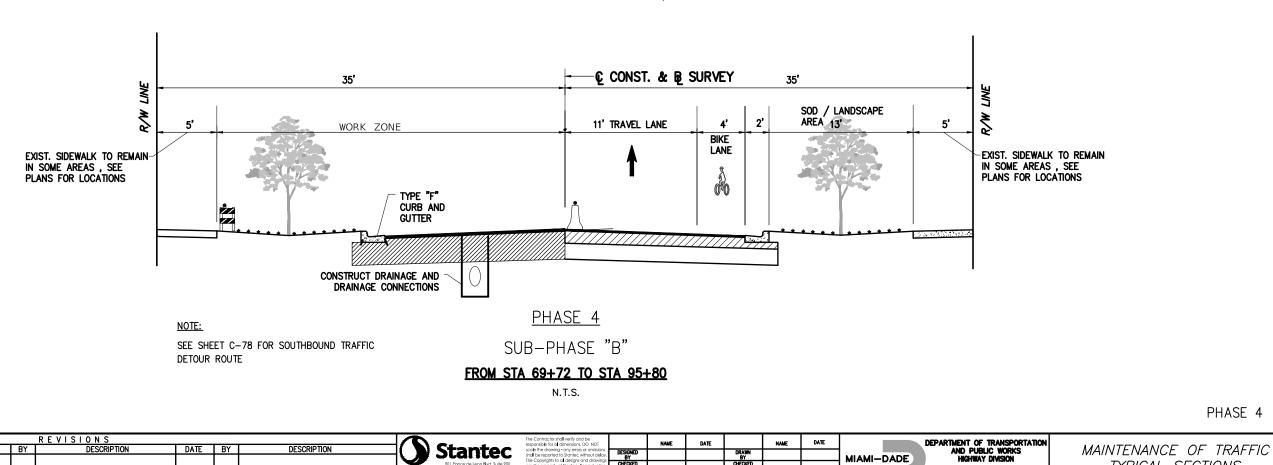

LEGEND

SYMBOLS DESCRIPTION

LIGHT POLE COMPLETE WITH LED LUMINAIRE. ONE PULL BOX AT BASE OF POLE, SINGLE ARM, AND FRANGIBLE BASE.

EXISTING LIGHT POLE TO BE DEMOLISHED.

1-2" HIGH DENSITY POLYETHYLENE (HDPE) CONDUIT (UNDER PAVEMENT, DIRECTIONAL BORE), UL EPEC-80, WITH RHW-2/XLP CONDUCTORS INSIDE EACH CONDUIT:

LIGHTING CIRCUIT (480V) - ONE WITH BROWN INSULATION, ONE WITH ORANGE INSULATION, AND ONE GROUND WITH GREEN INSULATION. (NUMBER AND SIZE OF CONDUCTORS AS SHOWN ON SCHEMATIC SHEETS)

● ● 1-2" SCHEDULE 40 PVC CONDUITS WITH RHW-2/XLP CONDUCTORS INSIDE EACH CONDUIT:

LIGHTING CIRCUIT (480V) - ONE WITH BROWN INSULATION, ONE WITH ORANGE INSULATION, AND ONE GROUND WITH GREEN INSULATION. (NUMBER AND SIZE OF CONDUCTORS AS SHOWN ON SCHEMATIC SHEETS)

SIGN CIRCUIT - ONE WITH BLACK INSULATION, ONE NEUTRAL WITH WHITE INSULATION, AND ONE GROUND WITH GREEN INSULATION. (NUMBER AND SIZE OF CONDUCTORS AS SHOWN ON SCHEMATIC SHEETS)

SERVICE POINT

■ PULL BOX

PULL BOXES REQUIRED AT EACH:

1. ONE (1) PULL BOXES AT BASE OF SERVICE POLE.

2. ONE (1) PULL BOXES AT BASE AT EACH POLE.

3. AS NECESSARY FOR COMPLETION OF THE PROJECT

LIGHTING DESIGN CRITERIA

SOURCE: MIAMI-DADE ROADWAY LIGHTING DESIGN MANUAL 2016

DESIGN SPEED: 30 MPH

AVERAGE: 0.6fc

AVERAGE/MIN: 4:1 OR LESS

MAX/MIN: 10:1 OR LESS

VEILING LUMINANCE RATIO: 0.3:1 OR LESS

POUNDABOUT AVERAGE: 0.79fc TO 1.2fc (1.2x TO 2x APPROACE)

MAX/MIN: 10:1 OR LESS

VEILING LUMINANCE RATIO: 0.3:1 OR LESS

ROUNDABOUT AVERAGE: 0.78fc TO 1.2fc (1.3x TO 2x APPROACH)

ROUNDABOUT AVG/MIN: 3:1 OR LESS

MIDBLOCK CROSSWALK: 2.3fc VERTICAL

CARIBBEAN INTERSECTION: 1.7fc

		FIXTURE	SCHEDULE			
TAG	MFGR	MODEL	DISTRIBUTION	VOLTAGE	WATTS	NOTES
А	HALOPHANE	ESL2 P20S 30K HVOLT BK TG3 LTHSS180	TYPE III	480V	83	LED LUMINAIRE, INCLUDES 180 DEGREE DEFLECTOR SHIELD AND UBICQUIA UBICELL SMART NODE MODULE IN 7-PIN RECEPTACLE AND SPARE SHORTING CAP.
В	HALOPHANE	ESL2 P40S 30K HVOLT BK TG3 LTHSS180	TYPE III	480V	140	LED LUMINAIRE, INCLUDES 180 DEGREE DEFLECTOR SHIELD AND UBICQUIA UBICELL SMART NODE MODULE IN 7-PIN RECEPTACLE AND SPARE SHORTING CAP.
С	HALOPHANE	ESL2 P10S 30K HVOLT BK SG3	TYPE III	480V	57	LED LUMINAIRE, INCLUDES UBICQUIA UBICELL SMART NODE MODULE IN 7-PIN RECEPTACLE AND SPARE SHORTING CAP.

MIAMI-DADE COUNTY PUBLIC WORKS DEPT. HIGHWAY DIVISION FRANJO ROAD

FROM OLD CUTLER RD TO SW 184TH STREET
PROJECT NO. 215615952 SHEET E-01 OF 19

GENERAL NOTES

- 1. POWER COMPANY SHALL PROVIDE INCOMING SERVICE AT LOCATION SPECIFIED IN ACCORDANCE WITH THE PLANS.
 THE DATE REQUIRED FOR INCOMING SERVICE TO BE COMPLETED MUST BE COORDINATED BY THE CONTRACTOR WITH
 THE POWER COMPANY AT THE PRE CONSTRUCTION MEETING.
- 2. ALL EXPOSED CONDUIT OR SURFACE MOUNTED CONDUIT SHALL BE GALVANIZED STEEL AND GROUNDED.
- 3. CONTRACTOR SHALL BE RESPONSIBLE FOR LOCATING AND AVOIDING ALL UNDERGROUND AND STRUCTURAL CONFLICTS IN COOPERATION WITH THE UTILITY COMPANY(S).
- 4. STATIONING MAY BE ADJUSTED AS DIRECTED TO AVOID UTILITY OR STRUCTURAL CONFLICTS NOT INDICATED IN THE PLANS.
- SIDEWALK SLABS DAMAGED DURING CONSTRUCTION SHALL BE REPLACED IN FULL AND COLORED WHEN NECESSARY TO MATCH THE EXISTING SIDEWALK.
- CONTRACTOR MUST MAINTAIN THE EXISTING LIGHTING SYSTEM IN OPERATION OR SUPPLY A TEMPORARY ONE UNTIL THE NEW LIGHTING SYSTEM CAN BE ACTIVATED. IF THE EXISTING LIGHTING SYSTEM IS OWNED BY F.P.&L, SEE FDOT SPECIFICATION FOR ROADWAY LIGHTING SPECIAL PROVISIONS, SECTION 715.
- 7. ALL MATERIAL, UNLESS OTHERWISE SPECIFIED, SHALL BE UNDERWRITERS LABORATORY APPROVED.
- 8. POLES, BRACKET ARMS, AND TRANSFORMER BASES SHALL BE ALUMINUM AND DESIGNED IN ACCORDANCE WITH LOCAL DESIGN CRITERIA USING THE APPLICABLE EQUATIONS FOUND IN THE AASHTO PUBLICATION "STANDARD SPECIFICATIONS FOR HIGHWAY, SIGNS, LUMINAIRES, AND TRAFFIC SIGNALS," CURRENT EDITION.
- 9. THE WIRES AT THE POLE, HANDHOLE, AND PULL BOXES SHALL BE LOOPED AS INDICATED IN THE PLAN DETAIL WITH SUFFICIENT LENGTH TO COMPLETELY REMOVE CONNECTORS TO THE OUTSIDE, TO MAKE THEM ACCESSIBLE FOR CHANGING FUSES AND TROUBLE SHOOTING THE SYSTEM.
- 10. THE LUMINAIRE MANUFACTURER SHALL PLACE A PERMANENT TAG ON THE LUMINAIRE HOUSING ON WHICH IS IMPRINTED THE FOLLOWING INFORMATION: WATTAGE, BALLAST TYPE, LAMP SHOWN ON DESIGN PLANS, LAMP SETTING (POSITION IN LUMINAIRE), I.E.S., LIGHT DISTRIBUTION WITH THIS LAMP IN THE POSITION SPECIFIED, INPUT VOLTAGE AND POWER FACTOR, LUMINAIRE PHOTOMETRIC SUBMITTALS REQUIRED.
- 11. GROUND RODS SHALL HAVE A RESISTANCE TO GROUND NOT TO EXCEED 25 OHMS. WHERE THE RESISTANCE IS NOT AS LOW AS 25 OHMS, TWO OR MORE GROUND RODS CONNECTED IN PARALLEL SHALL BE USED.
- 12. CONTRACTOR WILL INCLUDE IN THE COST OF THE LIGHTING POLE ANY LEVELING AND GRADING REQUIRED TO INSURE THAT ALL POLES ARE INSTALLED AT THE PROPER ELEVATION.
- 13. ALL SALVAGEABLE MATERIALS AND ALL MATERIALS TO BE FURNISHED BY THE CONTRACTOR SHALL BE TRANSPORTED AND OFF LOADED TO THE FOLLOWING LOCATION FOR INSPECTION AND ACCEPTANCE BY THE COUNTY:
 MIAMI-DADE COUNTY MAINTENANCE YARD

7100 NW 36th STREET MIAMI, FL 33166

TELEPHONE: (305) 592-3580

- 14. CONTRACTOR MUST CONTACT BELL SOUTH, FP&L, AND OTHER UTILITY COMPANIES PRIOR TO THE COMMENCEMENT OF CONSTRUCTION AND MUST NOTIFY ENGINEER AND MIAMI-DADE COUNTY IF FIELD CONDITIONS DIFFER FROM CONDITIONS INDICATED ON THESE DRAWINGS.
- 15. IN ACCORDANCE WITH THE NATIONAL ELECTRIC CODE (N.E.C.) OR WITH THE MIAMI-DADE COUNTY STANDARDS, THE CONTRACTOR MUST IDENTIFY ALL CIRCUITS AND EQUIPMENT INCLUDING THE PROPOSED LIGHT POLE ASSEMBLIES.
- 16. PULL BOXES, JUNCTION BOXES, AND ALL ELECTRICAL WORK MUST CONFORM TO N.E.C. (LATEST REQUIREMENTS), THE NATIONAL ELECTRICAL SAFETY CODE AND MIAMI-DADE COUNTY STANDARDS.
- 17. USE PVC SCHEDULE 40 CONDUIT THROUGHOUT THE ENTIRE UNDERGROUND SYSTEM UNLESS OTHERWISE NOTED, AT STREET CROSSINGS THE CONDUIT SHOULD BE EMBEDDED IN 1:10 CONCRETE MIXTURE.
- 18. ANY INCIDENTAL ITEMS OR ACCESSORIES REQUIRED TO COMPLETE THE WORK FOR A GIVEN BID ITEM, SHALL BE INCLUDED IN THE CONTRACT UNIT PRICE BID FOR THAT SPECIFIC ITEM AS INDICATED IN THE BID FORM. INCIDENTAL ITEMS MAY INCLUDE, BUT ARE NOT LIMITED TO: ELBOWS, SPLIT BOLT CONNECTORS, FUSES AND FUSE HOLDERS, ELECTRICAL TAPE, SCOTCHKOTE, PVC GLUE, TRENCHING, BACKFILLING, PAVEMENT RESTORATION, CONCRETE SLAB REPLACEMENT, ETC.
- 19. POLES SHALL HAVE A FRANGIBLE TRANSFORMER BASE.
- 20. ALL GROUNDING CONNECTIONS SHALL BE EXOTHERMICALLY WELDED FOLLOWING THE MANUFACTURER'S GUIDELINES.
- 21. CONTRACTOR MUST MINIMIZE TRENCHING ACROSS STREETS BY COORDINATING THE LIGHT PLANS WITH THE SIGNALIZATION INTERCONNECT CONDUIT/WIRING AS DEPICTED ON THESE DRAWINGS.
- 22. MAINTAINING AGENCY FOR LIGHTING IS MIAMI-DADE COUNTY. CONTRACTOR MUST CONTACT/COORDINATE WITH APPLICABLE COUNTY OFFICIALS AND INSPECTORS PRIOR TO CONSTRUCTION.
- 23. CONTRACTOR SHALL MAINTAIN SAFE ACCESS TO SIDE STREETS, PRIVATE, AND COMMERCIAL DRIVEWAYS AT ALL TIMES DURING CONSTRUCTION.
- 24. ALL CONDUIT TRENCHING MUST BE PROPERLY BACKFILLED TO PROVIDE SAFE CROSSING AT THE END OF EACH WORK DAY OR WHENEVER THE WORK ONE BECOMES INACTIVE.
- 25. THE CONTRACTOR MUST EXERCISE EXTREME CAUTION WHEN WORKING THE VICINITY OF EXISTING AND PROPOSED UNDERGROUND AND OVERHEAD UTILITIES.
- 26. STREET LIGHTS MUST COMPLY WITH OSHA REQUIRED MINIMUM CLARENCE SEPARATION FROM FPL LINES AND COMMUNICATION LINES.
- 27. THE CONTRACTOR SHALL FURNISH SIGNED AND SEALED AS-BUILT DRAWINGS, SENT ELECTRONICALLY, WHICH ARE TO INCLUDE THE GPS COORDINATES FOR ALL INSTALLED POLES AND SERVICE POINT LOCATIONS.



The Contractor shall verify and be responsible for all dimensions, DO NOT		NAME	DATE		NAME	DATE
scale the drawing - any errors or omissions shall be reported to Stantec without delay. The Copyrights to all designs and drawings	DESIGNED BY	BB	3/26/2021	DRAWN BY		
are the property of Stantec. Reproduction or use for any purpose other than that	CHECKED BY	JN		CHECKED BY		
authorized by Stantec is forbidden.	SUPERVISED B	Y:				



DEPARTMENT OF TRANSPORTATION

AND PUBLIC WORKS

HIGHWAY DIVISION

STEPHEN P. CLARK CENTER

111 NW 1 ST

MIAMI, FLORIDA 33128

LEGEND, DESIGN CRITERIA, & GENERAL NOTES

Point Number	Station	Offset	Latitude	Longitude	Description	MTG HT	Arm Length	Circuit #
1	11+00.67	21.79'	N25° 34' 44.61"	W80° 20' 08.71"	А	39 FT	6	3
2	12+12.68	21.59'	N25° 34' 45.47"	W80° 20' 09.49"	А	39 FT	6	3
3	13+20.06	21.59'	N25° 34' 46.29"	W80° 20' 10.24"	А	39 FT	6	2
4	14+19.97	-21.08'	N25° 34' 46.78"	W80° 20' 11.29"	А	39 FT	6	2
5	15+00.10	34.40'	N25° 34' 47.74"	W80° 20' 11.38"	А	39 FT	6	3
6	15+86.81	-21.42'	N25° 34' 48.05"	W80° 20' 12.45"	А	39 FT	6	2
7	16+95.08	21.09'	N25° 34' 49.15"	W80° 20' 12.85"	А	39 FT	6	3
8	17+95.27	-21.97'	N25° 34' 49.64"	W80° 20' 13.91"	А	39 FT	6	2
9	18+87.31	21.11'	N25° 34' 50.62"	W80° 20' 14.18"	А	39 FT	6	3
10	19+81.47	-21.06'	N25° 34' 51.07"	W80° 20' 15.19"	А	39 FT	6	2
11	20+44.30	18.92'	N25° 34' 51.80"	W80° 20' 15.29"	А	39 FT	6	3
12	21+31.03	-21.07'	N25° 34' 52.21"	W80° 20' 16.23"	А	39 FT	6	2
13	21+57.33	93.09'	N25° 34' 53.13"	W80° 20' 15.46"	А	39 FT	6	3
14	21+94.47	-49.74'	N25° 34' 52.52"	W80° 20' 16.92"	A	39 FT	6	2
15	22+27.75	34.33'	N25° 34' 53.30"	W80° 20' 16.44"	A	39 FT	6	3
16	22+39.86	-91.49'	N25° 34' 52.60"	W80° 20' 17.58"	A	39 FT	6	2
17	23+26.70	-23.97'	N25° 34' 53.69"	W80° 20' 17.62"	A	39 FT	6	2
18	24+11.44	-22.87'	N25° 34' 54.34"	W80° 20' 18.20"	A	39 FT	6	2
19	25+02.54	21.14'	N25° 34' 55.32"	W80° 20' 18.46"	A	39 FT	6	3
20	26+12.19	-21.18'	N25° 34' 55.89"	W80° 20' 19.58"	A	39 FT	6	2
21	27+32.19	21.62'	N25° 34' 57.08"	W80° 20' 20.05"	A	39 FT	6	3
22	28+32.26	-21.12'	N25° 34' 57.57"	W80° 20' 21.11"	A	39 FT	6	2
23	29+32.06	21.50'	N25° 34' 58.60"	W80° 20' 21.44"	A	39 FT	6	3
24	30+32.04	-21.17'	N25° 34' 59.10"	W80° 20' 22.50"	A	39 FT	6	2
25	31+47.28	21.24'	N25° 35' 00.26"	W80° 20' 22.92"	A	39 FT	6	3
26	32+46.98	-21.14'	N25° 35' 00.77"	W80° 20' 23.96"	A	39 FT	6	2
27	33+58.37	21.66'	N25° 35' 01.89"	W80° 20' 24.35"	A	39 FT	6	3
28	34+57.36	-21.37'	N25° 35' 02.40"	W80° 20' 25.39"	A	39 FT	6	2
29	35+59.35	21.34'	N25° 35' 03.45"	W80° 20' 25.72"	A	39 FT	6	3
30	36+47.05	-21.12'	N25° 35' 03.87"	W80° 20' 26.68"	A	39 FT	6	2
31	37+47.95	21.13'	N25° 35' 04.91"	W80° 20' 27.00"	A	39 FT	6	3
32	38+64.70	-21.40'	N25° 35' 05.55"	W80° 20' 28.16"	A	39 FT	6	2
33	39+74.99	21.14'	N25° 35' 06.67"	W80° 20' 28.55"	A	39 FT	6	3
34	40+94.66	-21.13'	N25° 35' 07.34"	W80° 20' 29.72"	A	39 FT		2
35	41+94.46	21.09'	N25° 35' 08.37"	W80° 20' 30.04"	A	39 FT	6	3
36	42+92.69	-21.12'	N25° 35' 08.87"	W80° 20' 31.07"	A	39 FT	6	2
37	43+94.54	21.13'	N25° 35' 09.92"	W80° 20' 31.40"	A	39 FT	6	3
38	44+99.75	-29.14'	N25° 35' 10.43"	W80° 20' 32.54"	A	39 FT	6	2
39	46+24.02	26.82'	N25° 35' 11.74"	W80° 20' 32.91"	В	39 FT	6	1
40	47+31.05	26.82'	N25° 35' 12.57"	W80° 20' 33.64"	В	39 FT	6	1
41	48+30.21	-29.51'	N25° 35' 12.99"	W80° 20' 34.79"	A	39 FT	6	4
42	49+14.93	23.77'	N25° 35' 13.98"	W80° 20' 34.79	A	39 FT	6	1
43	50+16.89	-21.13'	N25° 35' 14.49"	W80° 20' 35.99"	A	39 FT	6	4
44	51+24.98	21.13	N25° 35' 15.59"	W80° 20' 36.36"	A	39 FT	6	4 1
45	51+24.98	-23.16'	N25° 35' 16.21"	W80° 20' 37.52"	A	39 FT 39 FT	6	
46		21.09'		W80° 20' 37.52"		39 FT 39 FT	6	1
	53+24.63		N25° 35' 17.14"		A		6	
47	54+24.65	-24.77'	N25° 35' 17.63"	W80° 20' 38.79"	A	39 FT	6	4
48	55+19.19	21.24'	N25° 35' 18.65"	W80° 20' 39.04"	A	39 FT	6	1
49	56+23.07	-33.79'	N25° 35' 19.11"	W80° 20' 40.22"	A	39 FT	6	4
50	57+26.62	21.38'	N25° 35' 20.25"	W80° 20' 40.45"	A	39 FT	6	1
51	58+26.55	-21.12'	N25° 35' 20.77"	W80° 20' 41.49"	А	39 FT		4

REVISIONS

DESCRIPTION

DATE BY

DATE BY

Point Number	Station	Offset	Latitude	Longitude	Description	MTG HT	Arm Length	Circuit #
52	59+26.44	22.97'	N25° 35' 21.81"	W80° 20' 41.79"	Α	39 FT	6	1
53	60+05.87	-25.67'	N25° 35' 22.13"	W80° 20' 42.75"	А	39 FT	6	4
54	61+37.01	-25.46'	N25° 35' 23.15"	W80° 20' 43.64"	А	39 FT	6	4
55	62+30.77	23.61'	N25° 35' 24.18"	W80° 20' 43.86"	Α	39 FT	6	1
56	63+36.51	-23.74'	N25° 35' 24.70"	W80° 20' 44.98"	Α	39 FT	6	4
57	64+37.23	23.49'	N25° 35' 25.78"	W80° 20' 45.26"	Α	39 FT	6	1
58	65+22.24	-24.39'	N25° 35' 26.14"	W80° 20' 46.25"	Α	39 FT	6	4
59	66+26.76	21.10'	N25° 35' 27.23"	W80° 20' 46.57"	А	39 FT	6	1
60	67+22.18	-24.39'	N25° 35' 27.69"	W80° 20' 47.61"	Α	39 FT	6	4
61	68+16.66	21.12'	N25° 35' 28.70"	W80° 20' 47.86"	Α	39 FT	6	1
62	69+35.45	-25.11'	N25° 35' 29.34"	W80° 20' 49.06"	Α	39 FT	6	4
63	70+37.01	25.87'	N25° 35' 30.44"	W80° 20' 49.32"	Α	39 FT	6	1
64	71+32.23	-25.69'	N25° 35' 30.86"	W80° 20' 50.41"	А	39 FT	6	4
65	72+31.65	25.77'	N25° 35' 31.95"	W80° 20' 50.62"	А	39 FT	6	1
66	73+32.00	-18.71'	N25° 35' 32.54"	W80° 20' 51.62"	Α	39 FT	6	4
67	73+83.08	18.80'	N25° 35' 33.17"	W80° 20' 51.53"	Α	39 FT	6	1
68	74+18.01	-52.01'	N25° 35' 33.16"	W80° 20' 52.39"	А	39 FT	6	4
69	74+10.11	-99.57'	N25° 35' 32.88"	W80° 20' 52.82"	А	39 FT	6	4
70	74+69.87	28.35'	N25° 35' 33.97"	W80° 20' 51.83"	А	39 FT	6	1
71	75+09.03	-64.51'	N25° 35' 33.98"	W80° 20' 52.94"	Α	39 FT	6	4
72	75+54.14	-21.74'	N25° 35' 34.56"	W80° 20' 52.68"	Α	39 FT	6	4
73	76+43.96	25.04'	N25° 35' 35.55"	W80° 20' 52.47"	А	39 FT	6	1
74	77+32.73	-21.46'	N25° 35' 36.30"	W80° 20' 53.18"	Α	39 FT	6	4
75	78+19.47	-31.19'	N25° 35' 37.16"	W80° 20' 53.42"	А	39 FT	6	4
76	79+19.72	23.77'	N25° 35' 38.19"	W80° 20' 52.89"	Α	39 FT	6	1
77	80+29.54	23.87'	N25° 35' 39.27"	W80° 20' 52.89"	Α	39 FT	6	1
78	81+29.23	23.87'	N25° 35' 40.26"	W80° 20' 52.90"	А	39 FT	6	1
79	82+48.22	22.37'	N25° 35' 41.44"	W80° 20' 52.92"	А	39 FT	6	1
80	83+61.14	22.40'	N25° 35' 42.56"	W80° 20' 52.92"	А	39 FT	6	1
81	84+49.77	30.10'	N25° 35' 43.43"	W80° 20' 52.84"	Α	39 FT	6	1
82	85+69.74	30.10'	N25° 35' 44.62"	W80° 20' 52.85"	А	39 FT	6	1
83	86+65.92	30.10'	N25° 35' 45.58"	W80° 20' 52.85"	А	39 FT	6	1
84	87+69.87	35.81'	N25° 35' 46.61"	W80° 20' 52.79"	А	39 FT	6	1
85	88+65.30	23.70'	N25° 35' 47.55"	W80° 20' 52.93"	А	39 FT	6	1
86	89+69.13	21.46'	N25° 35' 48.58"	W80° 20' 52.96"	Α	39 FT	6	1
87	90+35.19	21.08'	N25° 35' 49.23"	W80° 20' 52.97"	С	15 FT	6	1
88	90+66.87	-24.75'	N25° 35' 49.54"	W80° 20' 53.47"	С	15 FT	6	4
89	90+98.61	-26.02'	N25° 35' 49.86"	W80° 20' 53.48"	А	39 FT	6	4
90	91+69.74	21.14'	N25° 35' 50.57"	W80° 20' 52.97"	А	39 FT	6	1
91	92+69.69	-25.88'	N25° 35' 51.55"	W80° 20' 53.49"	Α	39 FT	6	4
92	93+78.94	27.04'	N25° 35' 52.64"	W80° 20' 52.91"	А	39 FT	6	1
93	94+81.08	-32.67'	N25° 35' 53.65"	W80° 20' 53.57"	Α	39 FT	6	4
94	95+99.46	33.68'	N25° 35' 54.82"	W80° 20' 52.85"	Α	39 FT	6	1
STREET LIGHTING SERVICE POINT ND LOAD CENTER	45+52.99	33.47'	N25° 35' 10.82"	W80° 20' 32.94"				
MESSAGE BOARD SERVICE POINT	75+48.65	46.85'	N25° 35' 34.43"	W80° 20' 52.92"				

MIAMI-DADE COUNTY PUBLIC WORKS DEPT.
HIGHWAY DIVISION
FRANJO ROAD
FROM OLD CUTLER RD TO SW 184TH STREET
PROJECT NO. 215615952
SHEET E-02 OF 19

DATE BY

DESCRIPTION

MIAMI-DADE COUNTY PUBLIC WORKS DEPT. HIGHWAY DIVISION

FRANJO ROAD FROM OLD CUTLER RD TO SW 184TH STREET PROJECT NO. **215615952** SHEET **E-03** OF **19**


QUANTITIES


TABULATION OF LIGHTING QUANTITIES


			SHEET NUMBER																GRAND	
			E-04		E-05		E-06		E-07		E-08		E-09		E-10		E-11		TOTAL	
PAY ITEM NO.	DESCRIPTION	UNIT	ORIG	FINAL	ORIG	FINAL	ORIG	FINAL	ORIG	FINAL	ORIG	FINAL	ORIG	FINAL	ORIG	FINAL	ORIG	FINAL	ORIG	FINAL
630-2-11	CONDUIT, FURNISH & INSTALL, OPEN TRENCH	LF	456	х	1954	х	2215	х	2216	х	2107	х	1906	х	2057	х	510	х	13421	X
630-2-12	CONDUIT, FURNISH & INSTALL, DIRECTIONAL BORE	LF	307	X	407	Х	190	х	272	Х	300	Х	592	Х	264	X	0	Х	2332	Х
635-2-11	PULL & SPLICE BOX, F&I, 13" x 24" COVER SIZE	EA	12	X	19	X	13	X	17	X	18	X	23	X	21	X	3	Х	126	X
639-1-121	ELECTRICAL POWER SERVICE, F&I, UNDERGROUND, METER FURNISHED BY POWER COMPANY	AS	0	X	0	X	0	X	1	X	0	X	1	X	0	X	0	X	2	X
639-2-16	ELECTRICAL SERVICE WIRE, FURNISH & INSTALL	LF	0	х	0	х	0	х	150	х	0	х	750	х	0	х	0	х	900	Х
639-3-12	ELECTRICAL SERVICE DISCONNECT, FURNISH & INSTALL	EA	0	х	0	х	0	х	1	х	0	х	1	х	0	х	0	х	2	х
641-2-11	PRESTRESSED CONCRETE POLE, F&I, TYPE P-II PEDESTAL	EA	0	х	0	х	0	х	1	Х	0	Х	1	х	0	х	0	Х	2	Х
715-1-11	LIGHTING CONDUCTORS, F&I, INSULATED, NO. 10 OR SMALLER	LF	0	X	0	X	0	X	0	X	0	Х	0	X	0	X	0	X	0	X
715-1-12	LIGHTING CONDUCTORS, F&I, INSULATED, NO. 8 TO NO. 6	LF	5529	х	7947	х	7935	х	8328	Х	8985	Х	8502	х	7827	х	1626	Х	56679	Х
715-7-11G	LOAD CENTER, F&I, SECONDARY VOLTAGE	EA	0	X	0	X	0	X	1	Х	0	Х	0	X	0	X	0	х	1	х
700-7-212	DYNAMIC MESSAGE SIGN, FURNISH & INSTALL- WO UPS, MONOCHROME	EA	0	X	0	Х	0	X	0	X	0	х	2	X	0	Х	0	х	2	Х
715-500-1C	POLE CABLE DISTRIBUTION SYSTEM, FURNISH AND INSTALL	EA	11	x	15	X	11	x	11	х	12	х	16	x	14	x	3	x	93	х
715-516-115	LIGHT POLE COMPLETE, SPECIAL DESIGN (FURNISH & INSTALL, POLE TOP MOUNT, ALUMINUM AND 15 FEET MOUNTING HEIGHT)	EA	0	Х	0	Х	0	х	0	х	0	х	0	X	2	X	0	Х	2	Х
715-511-140	LIGHT POLE COMPLETE - SPECIAL DESIGN, F&I, SINGLE ARM SHOULDER MOUNT, ALUMINUM, 40'	EA	11	X	15	х	11	X	11	Х	12	х	16	X	12	X	3	X	92	Х
715-521-140	SPARE LIGHT POLE ASSEMBLY	EA		X		X		X		X		X		X		X		x	18	x

PAY ITEM NOTES:


- 1. INCIDENTAL ITEMS OR ACCESSORIES REQUIRED TO COMPLETE THE WORK FOR EACH ITEM BID SHALL BE INCLUDED IN THE CONTRACT UNIT PRICE BID FOR THAT SPECIFIC ITEM AS INDICATED IN THE BID FORM; SUCH AS, BUT NOT LIMITED TO: ELBOWS, SPLIT BOLT CONNECTORS, FUSES & FUSE HOLDER, ELECTRICAL TAPE, SCOTCHKOTE, P.V.C. GLUE, TRENCHING, BACKFILLING, PAVEMENT RESTORATION, CONCRETE SLAB REPLACEMENT, ETC.
- 2. PAY ITEM NO. 630-2-11 AND 630-2-12 FOR CONDUIT SHALL BE BASED ON THE HORIZONTAL PATH OF THE INSTALLED CONDUIT AS MEASURED BETWEEN THE CENTER OF PULL BOXES, CABINETS, ETC.. NO ALLOWANCE SHALL BE MADE FOR SWEEPS OR VERTICAL DISTANCES ABOVE OR BELOW GROUND. INCLUDES CONDUIT, ELBOWS, SWEEPS, CONNECTING HARDWARE, TRENCHING AND BACKFILLING AS PER THE PLANS AND STANDARD INDEXES. ALSO INCLUDES THE COST OR RESTORING CUT PAVEMENT, SIDEWALKS, SOD, AND ETC. TO ITS ORIGINAL CONDITION.
- 3. PAY ITEM 639-1-121 INCLUDES THE COST OF FURNISHING AND INSTALLING NEW SERVICE. INCLUDES THE COST ESTABLISHING NEW SERVICE WITH LOCAL ELECTRIC UTILITY.
- 4. PAY ITEM 639-2-16 INCLUDES THE COST OF FURNISHING AND INSTALLING THE SERVICE CONDUCTOR BETWEEN THE SERVICE CONNECTION POINT, UTILITY METER, AND SERVICE DISCONNECT SWITCH.
- 5. PAY ITEM 639-3-12 INCLUDES THE COST OF FURNISHING AND INSTALLING NEW SERVICE EQUIPMENT. INCLUDES THE COST OF FURNISHING AND INSTALLING A NEMA 4X S.S. SERVICE DISCONNECT, SPD, METER SOCKET, AND MOUNTING HARDWARE.
- 6. PAY ITEM NO. 715-1-## FOR CONDUCTOR SHALL BE BASED ON THE LINEAR FEET OF EACH CONDUCTOR IN HORIZONTAL MEASUREMENT. NO ALLOWANCE SHALL BE MADE FOR CONNECTION IN PULL BOXES AND CABINETS. ALL CONDUCTOR USE/RHW-XLP AS SPECIFIED IN FDOT SECTION 992 AND AS PER MIAMI-DADE COUNTY MAINTENANCE AGENCY SPECIFICATIONS. OTHER TYPE OF CABLE SHALL NOT BE ALLOWED (EXCEPT GROUND WIRE WHICH SHALL BE THWN).
- 7. PAY ITEM 715-7-11G PAYMENT FOR LOAD CENTER SHALL INCLUDE FURNISHING AND INSTALLING ALL ITEMS AS DEPICTED ON MIAMI-DADE COUNTY SERVICE POINT DETAILS. TRANSFORMER CONNECTION AND ALL WORK RELATED TO ELECTRICAL POWER SERVICE SHALL BE COORDINATED WITH THE F.P.&L. REPRESENTATIVE. INCLUDES THE COST OF THE GROUNDING ELECTRODE AND GROUND RODS, INCIDENTAL TO NEW SERVICE
- 7' PAY ITEM 700-7-212 INCLUDES THE COST OF FURNISHING AND INSTALLING THE MESSAGE BOARD, INCLUDING MOUNTING HARDWARE AND OPTIONAL FEATURES AS DESCRIBED ON PLAN. INCLUDE FEES TO SETUP REMOTE COMMUNICATION INCLUDING ACTIVATION OF CELLULAR RADIO.
- 8. PAY ITEM 715-500-1C INCLUDES THE SURGE PROTECTOR, FUSE HOLDERS WITH FUSES, WATERPROOF CONNECTORS AND WATERPROOF WIRING CONNECTION TO THE THE LUMINAIRE, GROUNDING ELECTRODE, AND GROUND ROD. (MG SQUARE LIGHT POLE DISTRIBUTION SYSTEM)
- 9. PAY ITEM NO. 715-516-115 AND 715-511-140 INCLUDES THE COST OF FURNISHING AND INSTALLING 20 FT. OF GROUND ROD AT EACH PULL BOX, EACH LIGHT POLE PULL BOX, AND AT EACH SERVICE POINT PER MIAMI-DADE COUNTY DESIGN REQUIREMENTS, INCLUDING GROUND ROD, GROUND WIRE, ROCKS AND CLAMPS. INCLUDES THE COST OF FURNISHING AND INSTALLING THE POLE, POLE BRACKET ARM, LUMINAIRE WITH UBICQUIA UBICELL SMART NODE MODULE AND SPARE SHORTING CAP, FOUNDATION AND ALL MOUNTING HARDWARE. CONTRACTOR TO INCLUDE IN BID PRICE THE COST FOR TRIMMING TREES AS REQUIRED.
- 10. PAY ITEM NO. 715-521-140 INDICATES THE COST OF FURNISHING 20% ADDITIONAL SPARE POLE ASSEMBLIES TO TSS.

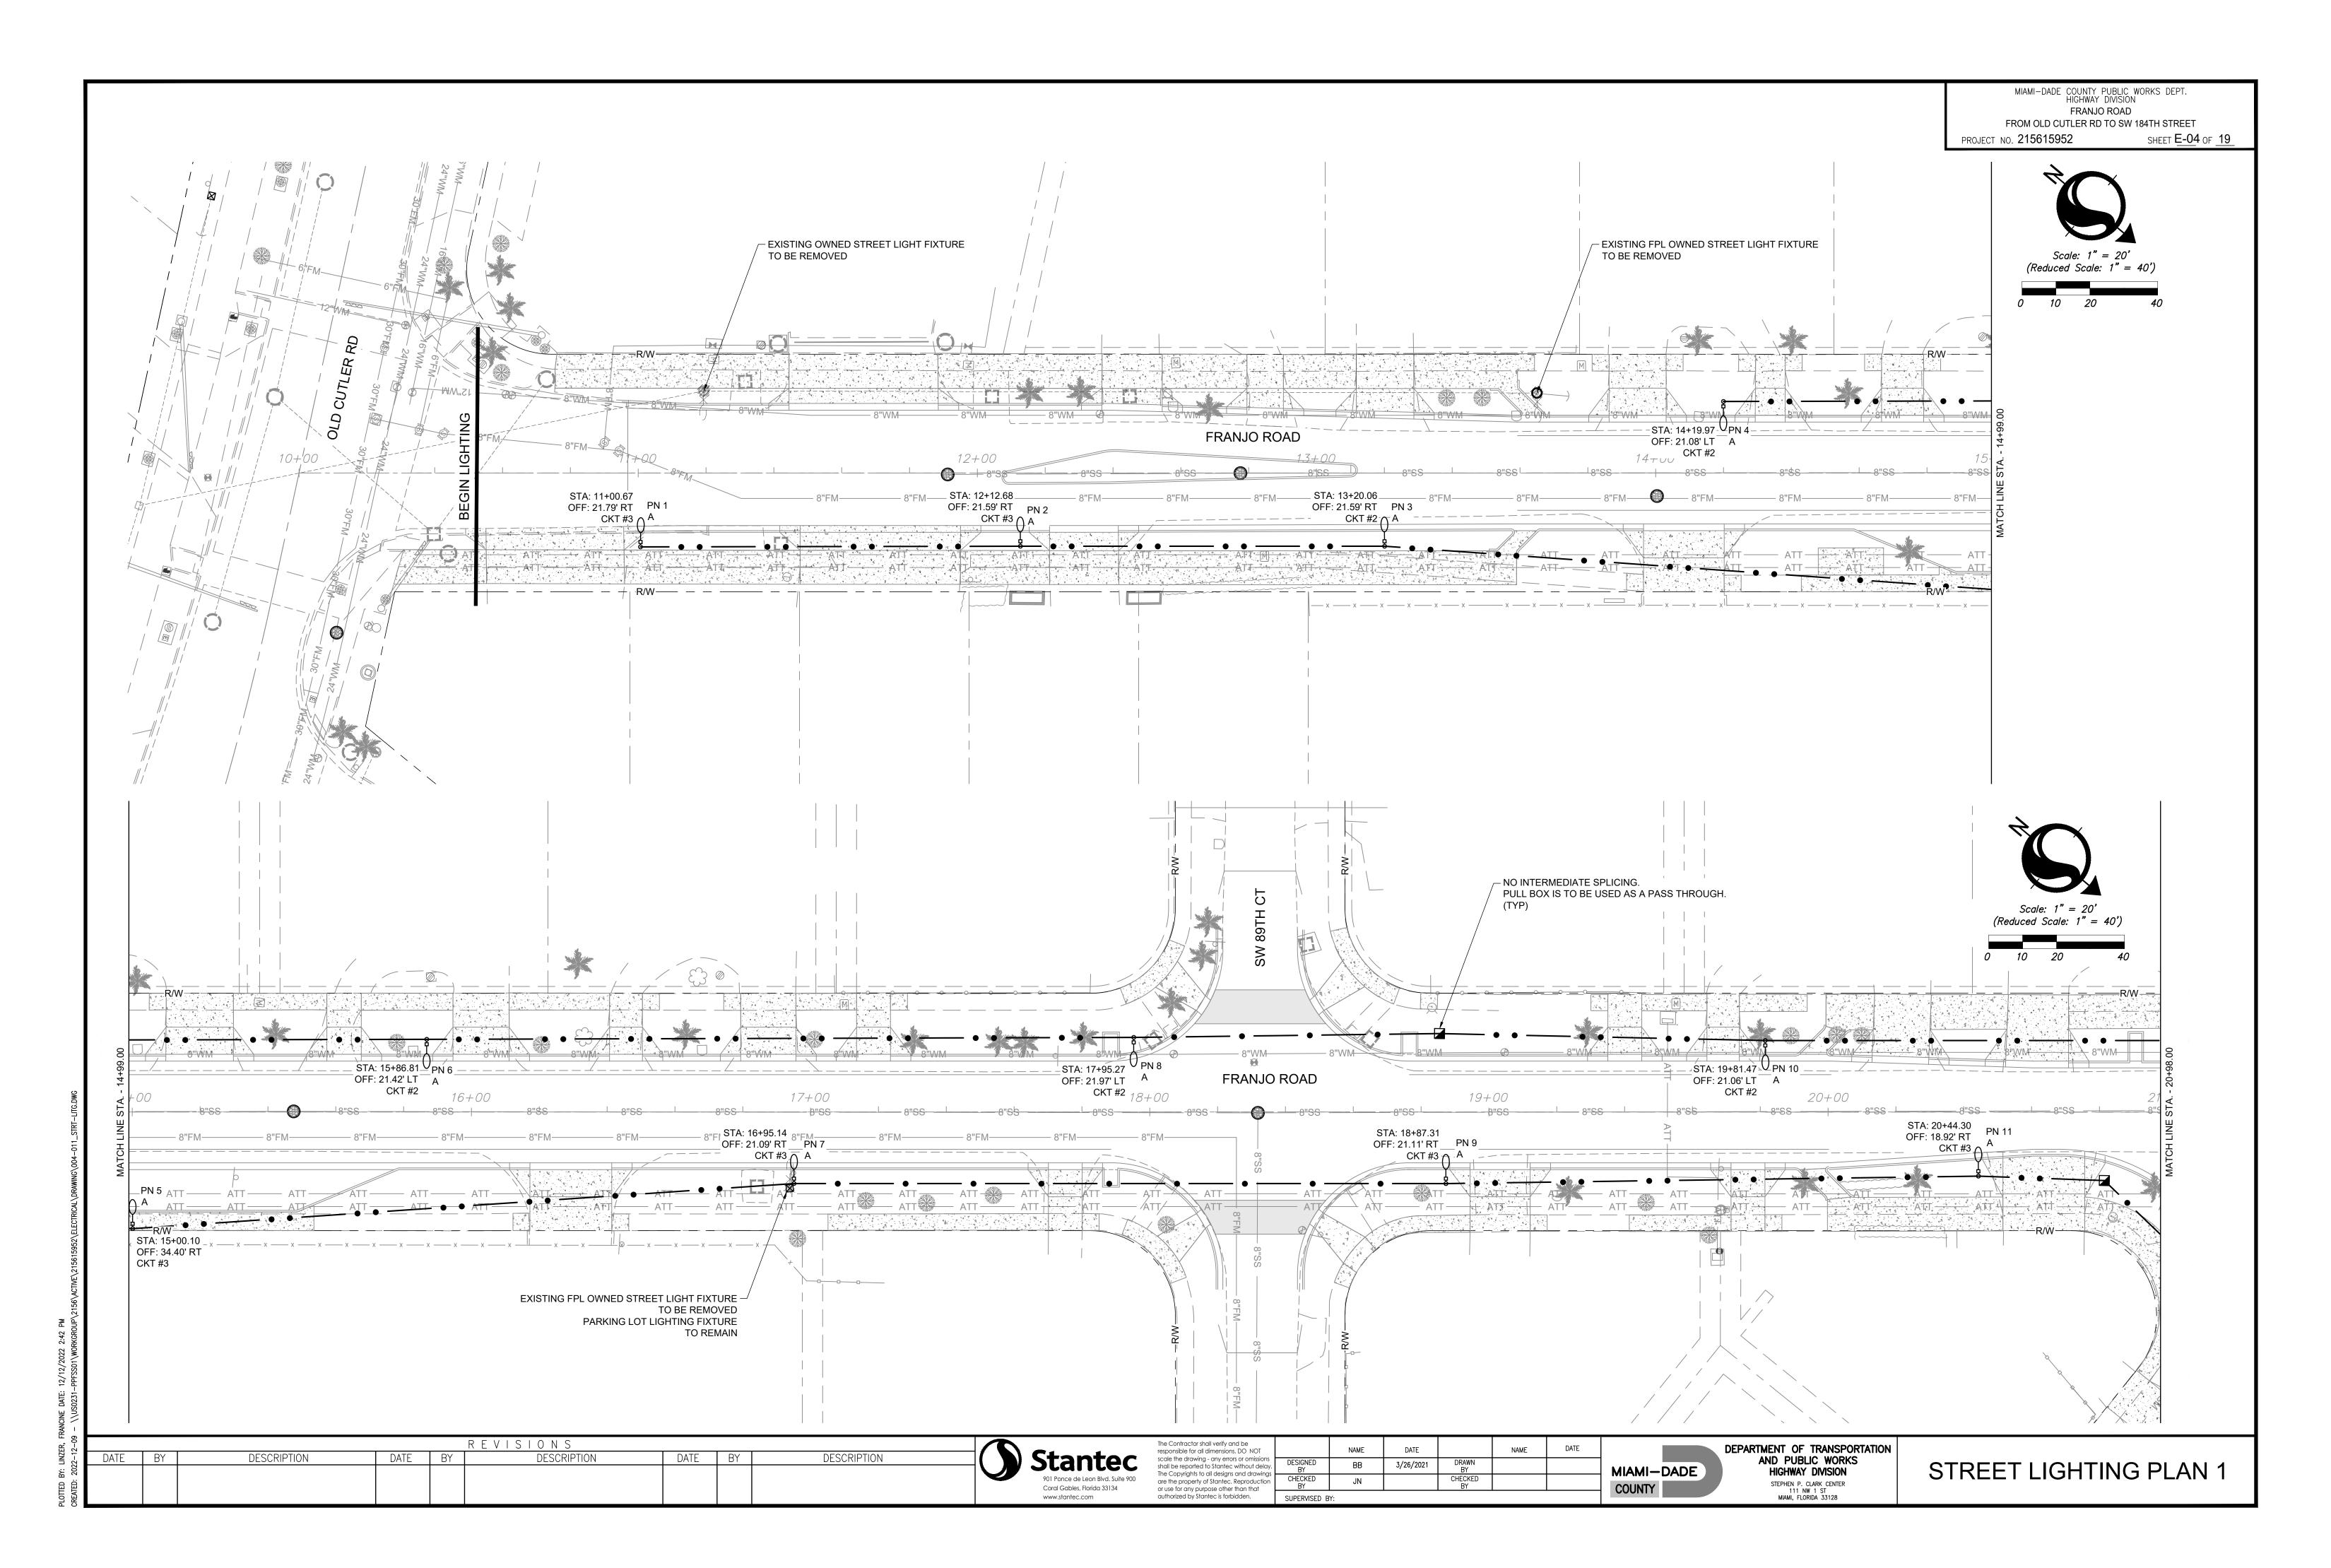


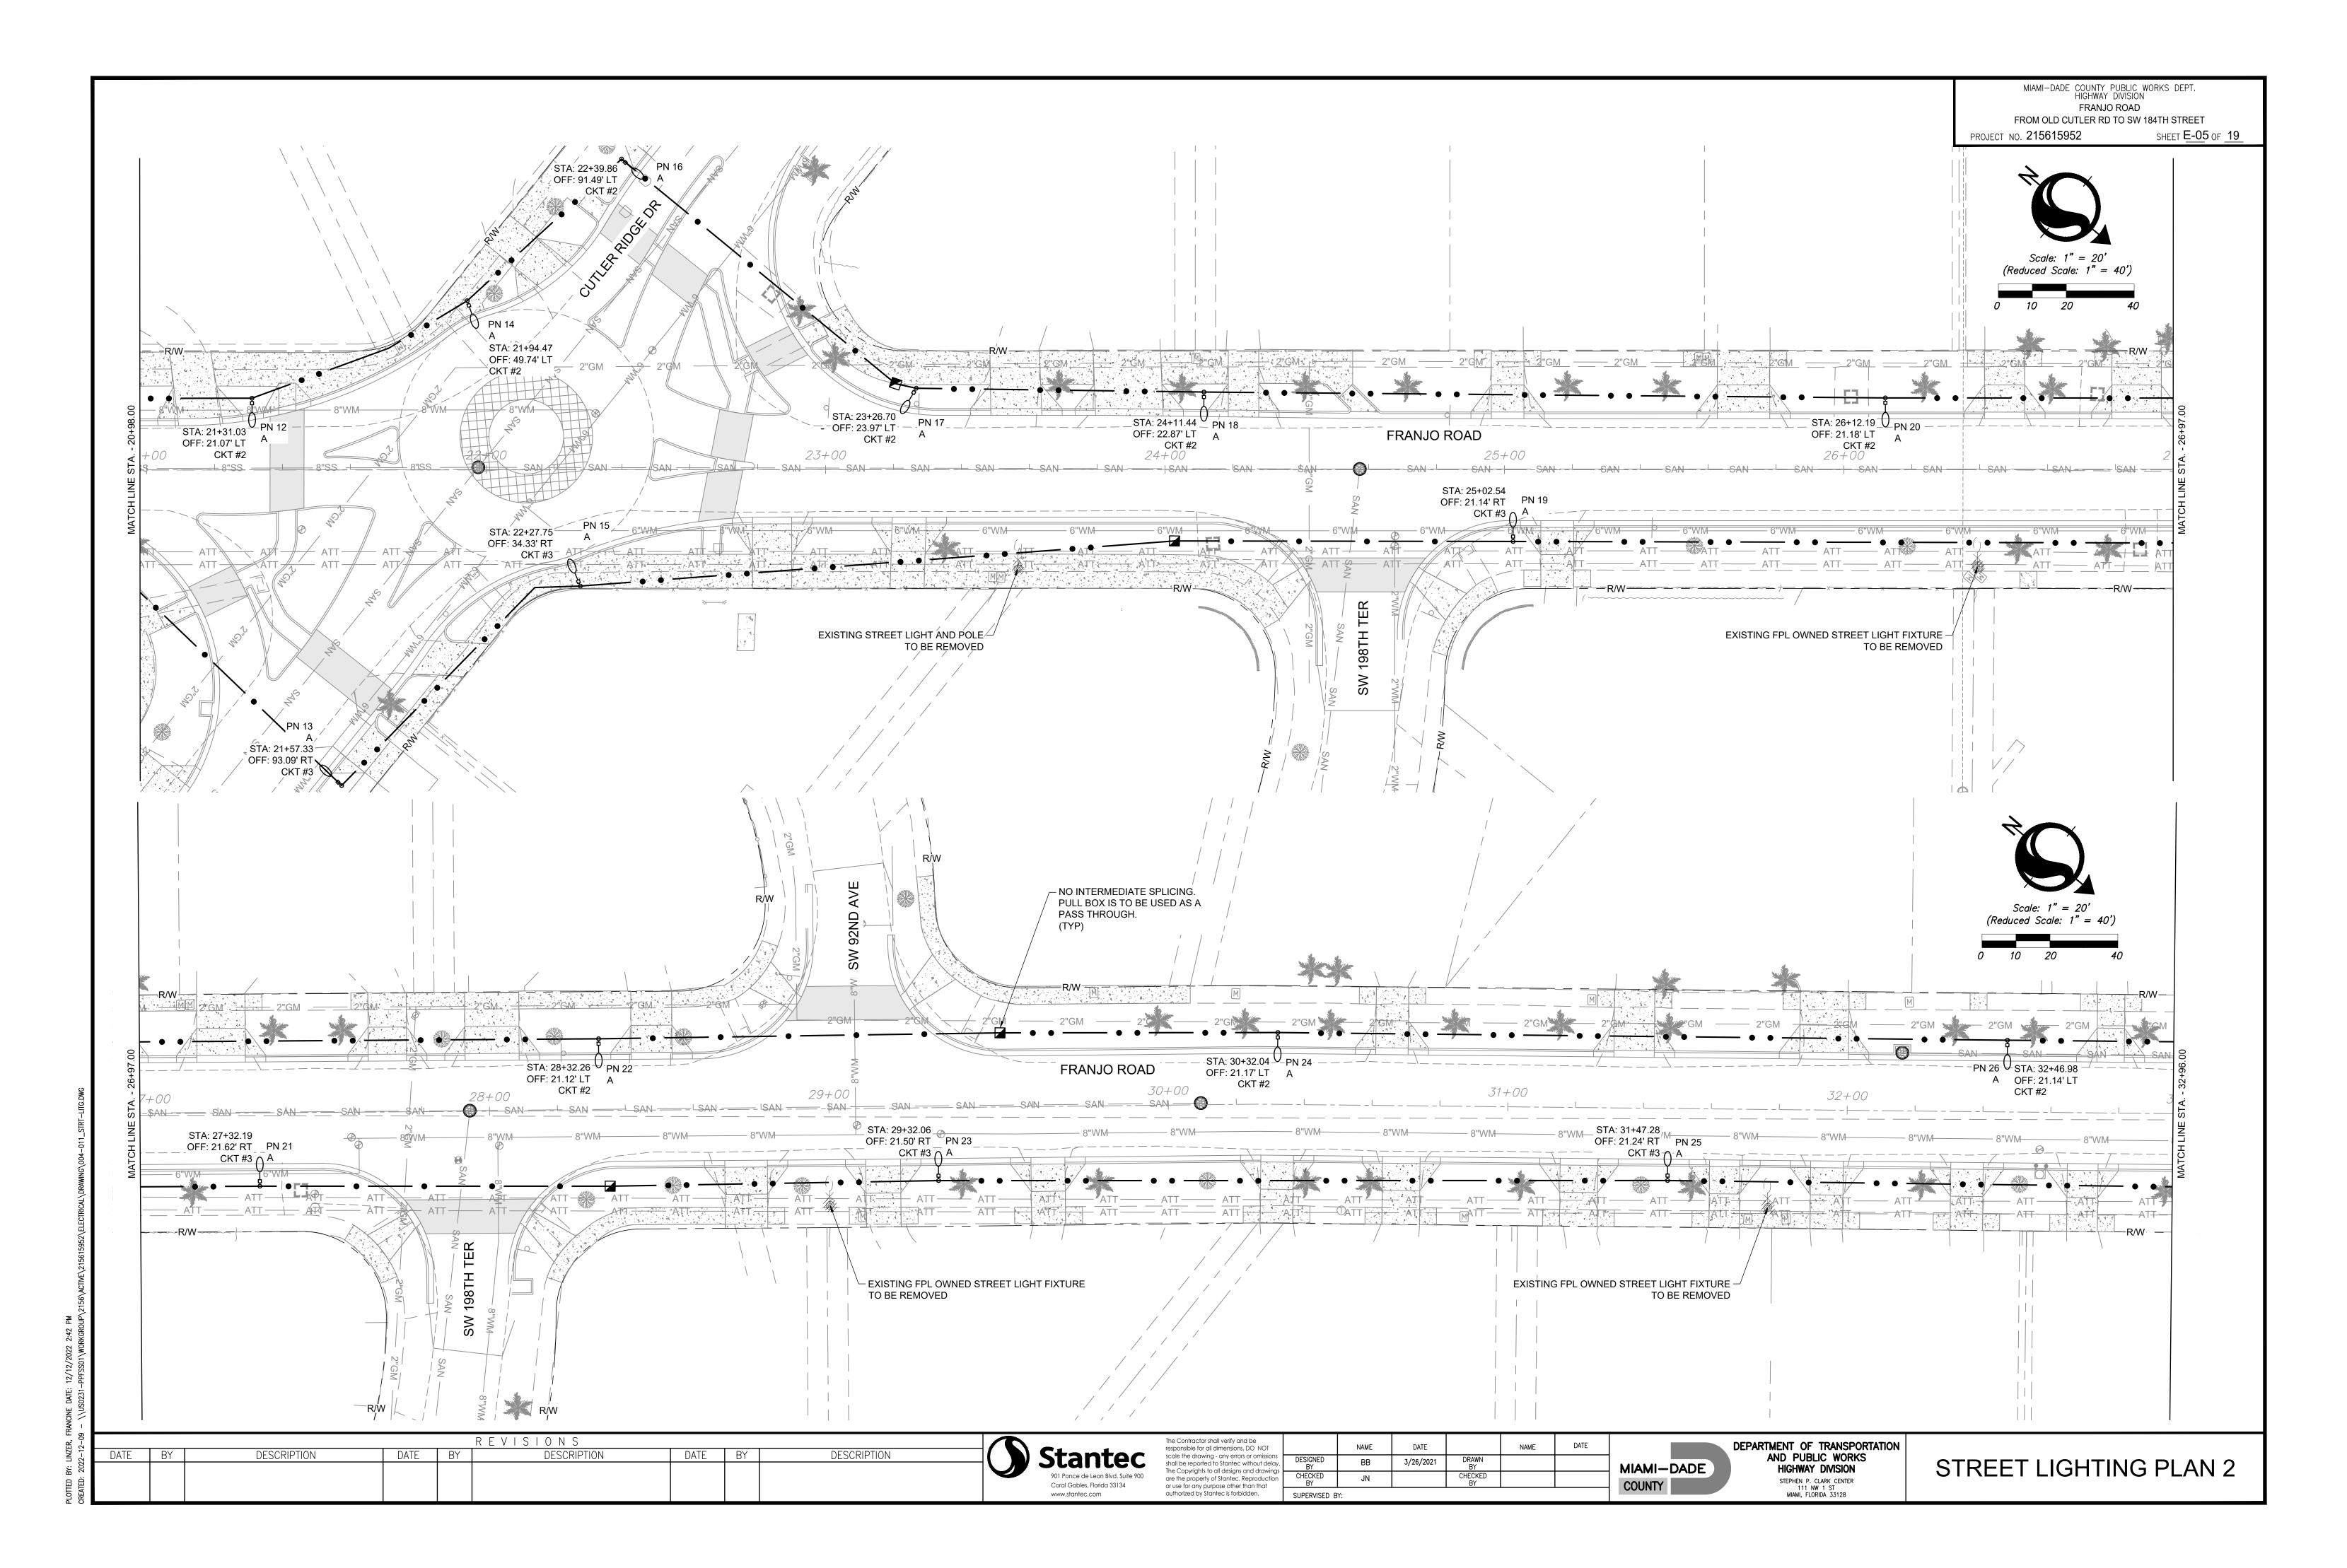


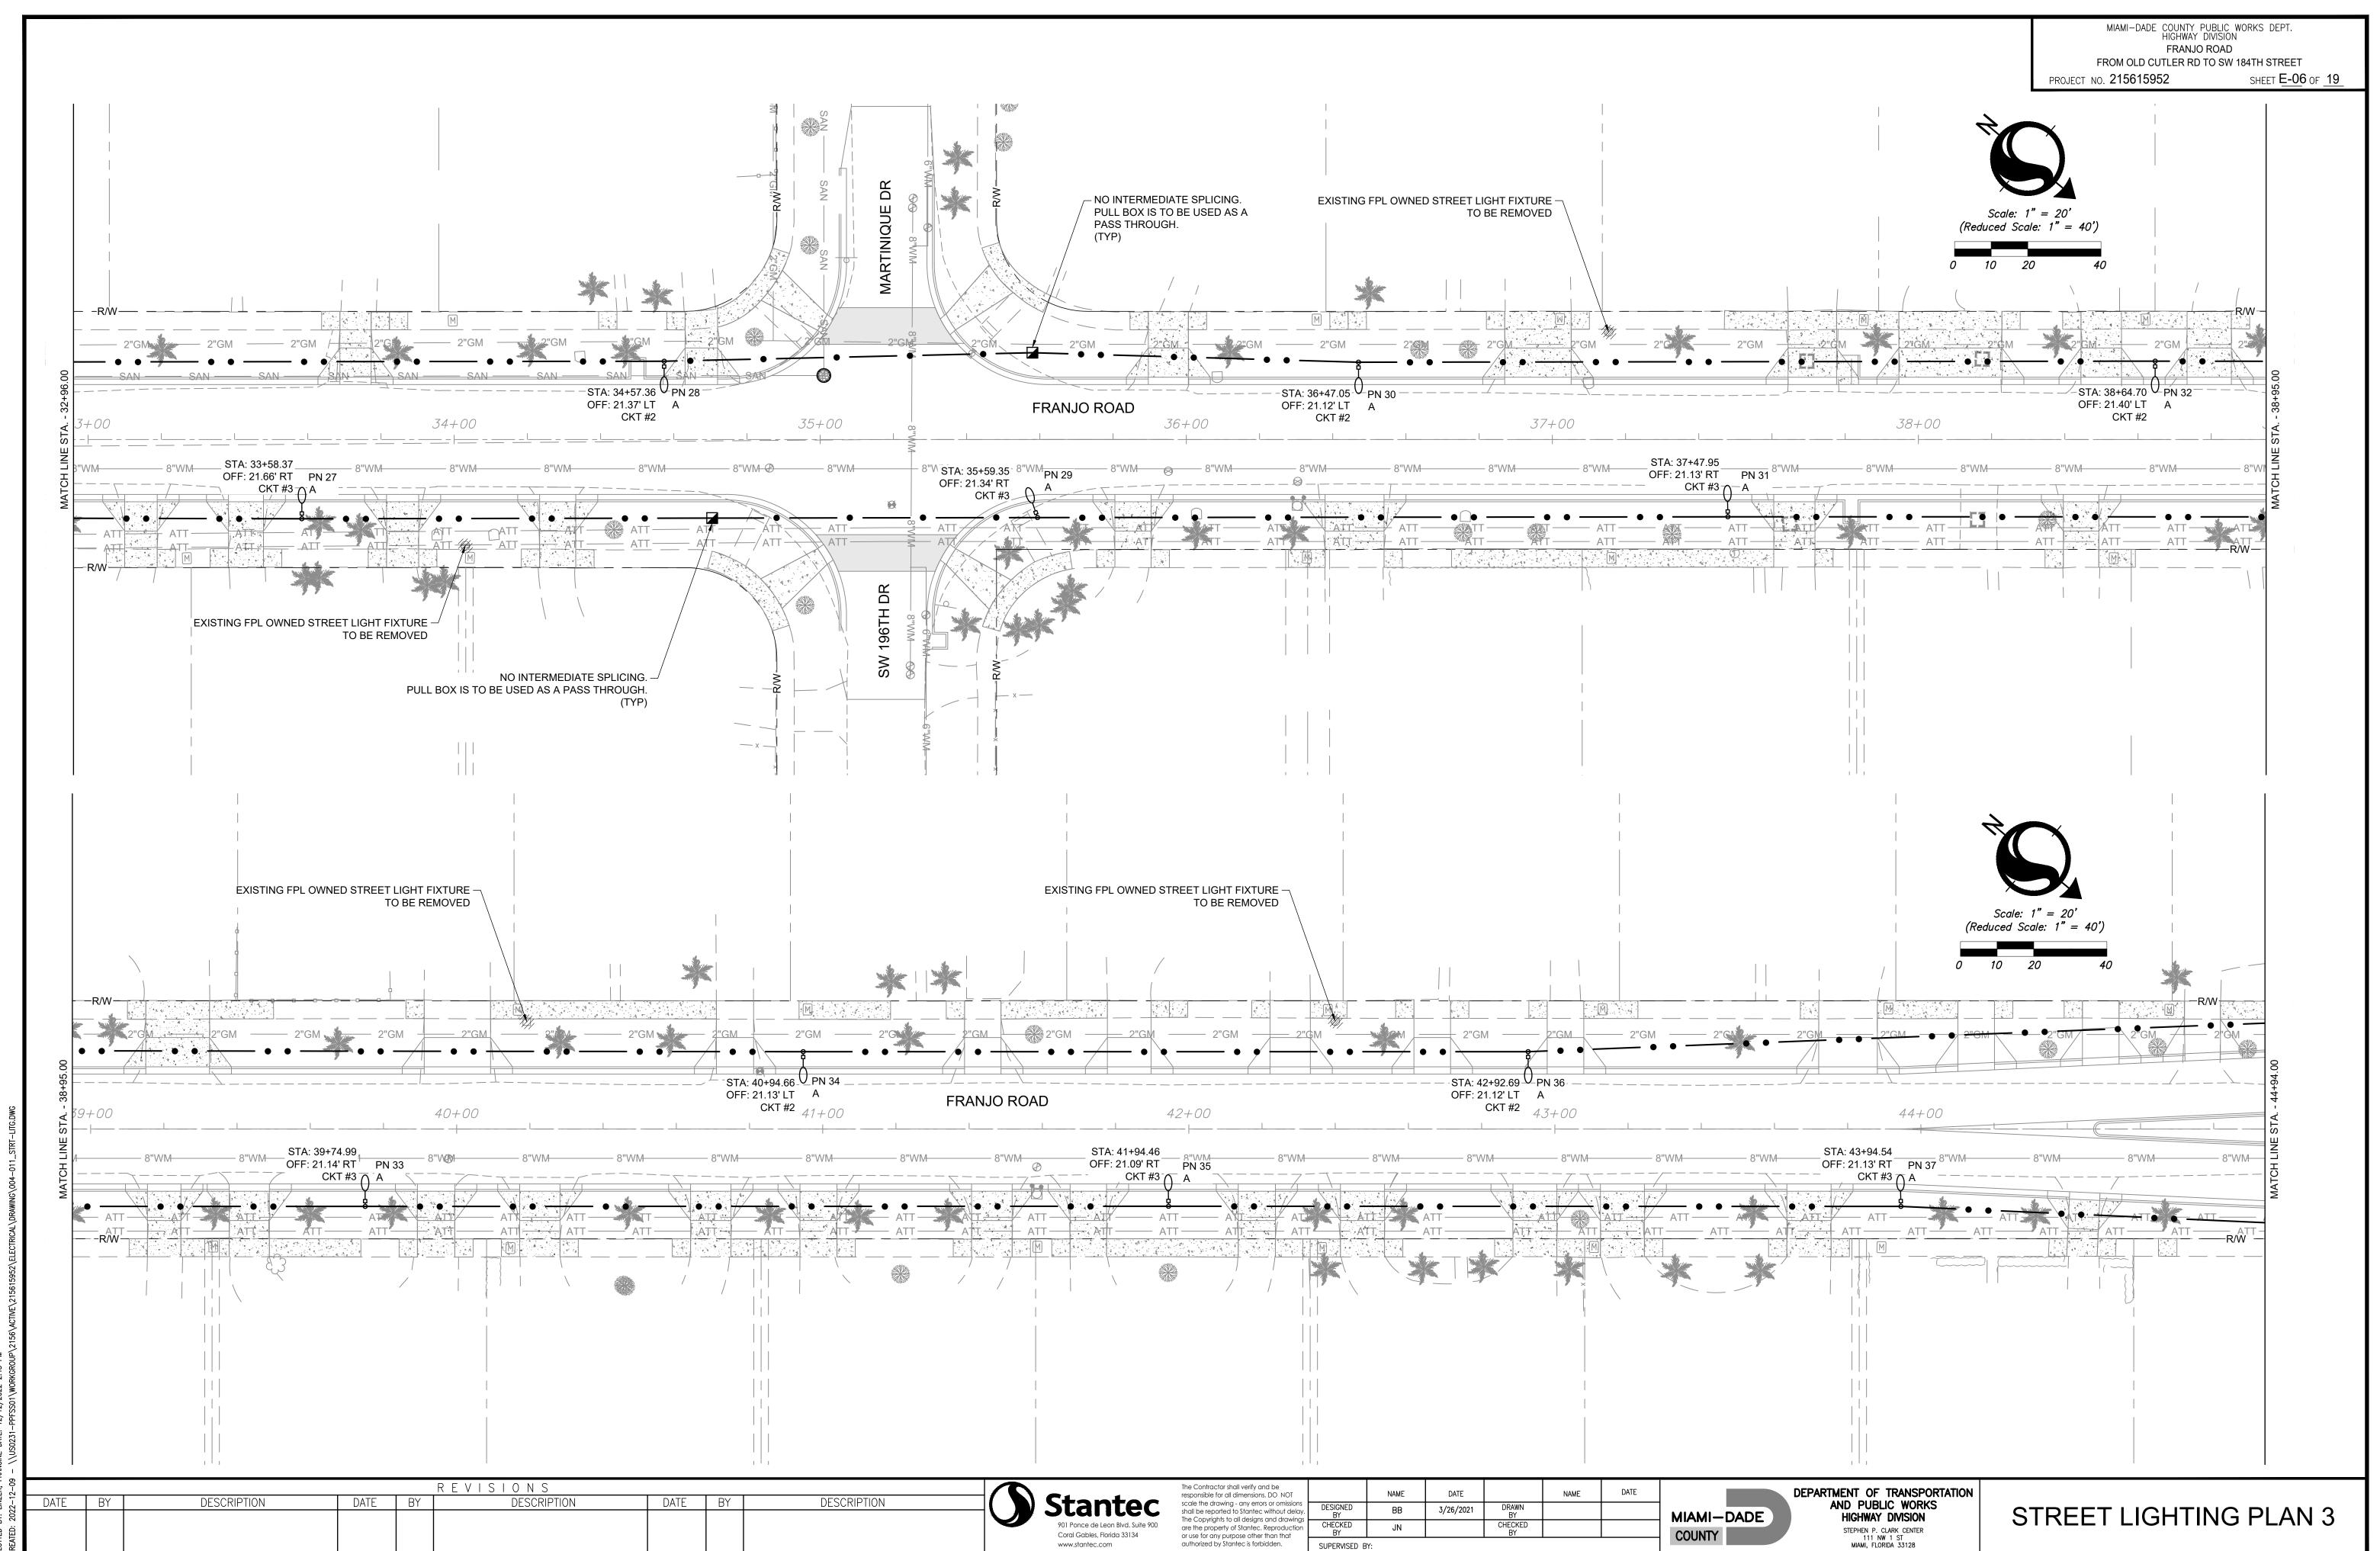



NZER ERANCINE DATE: 19/19/2022 2:43 PI

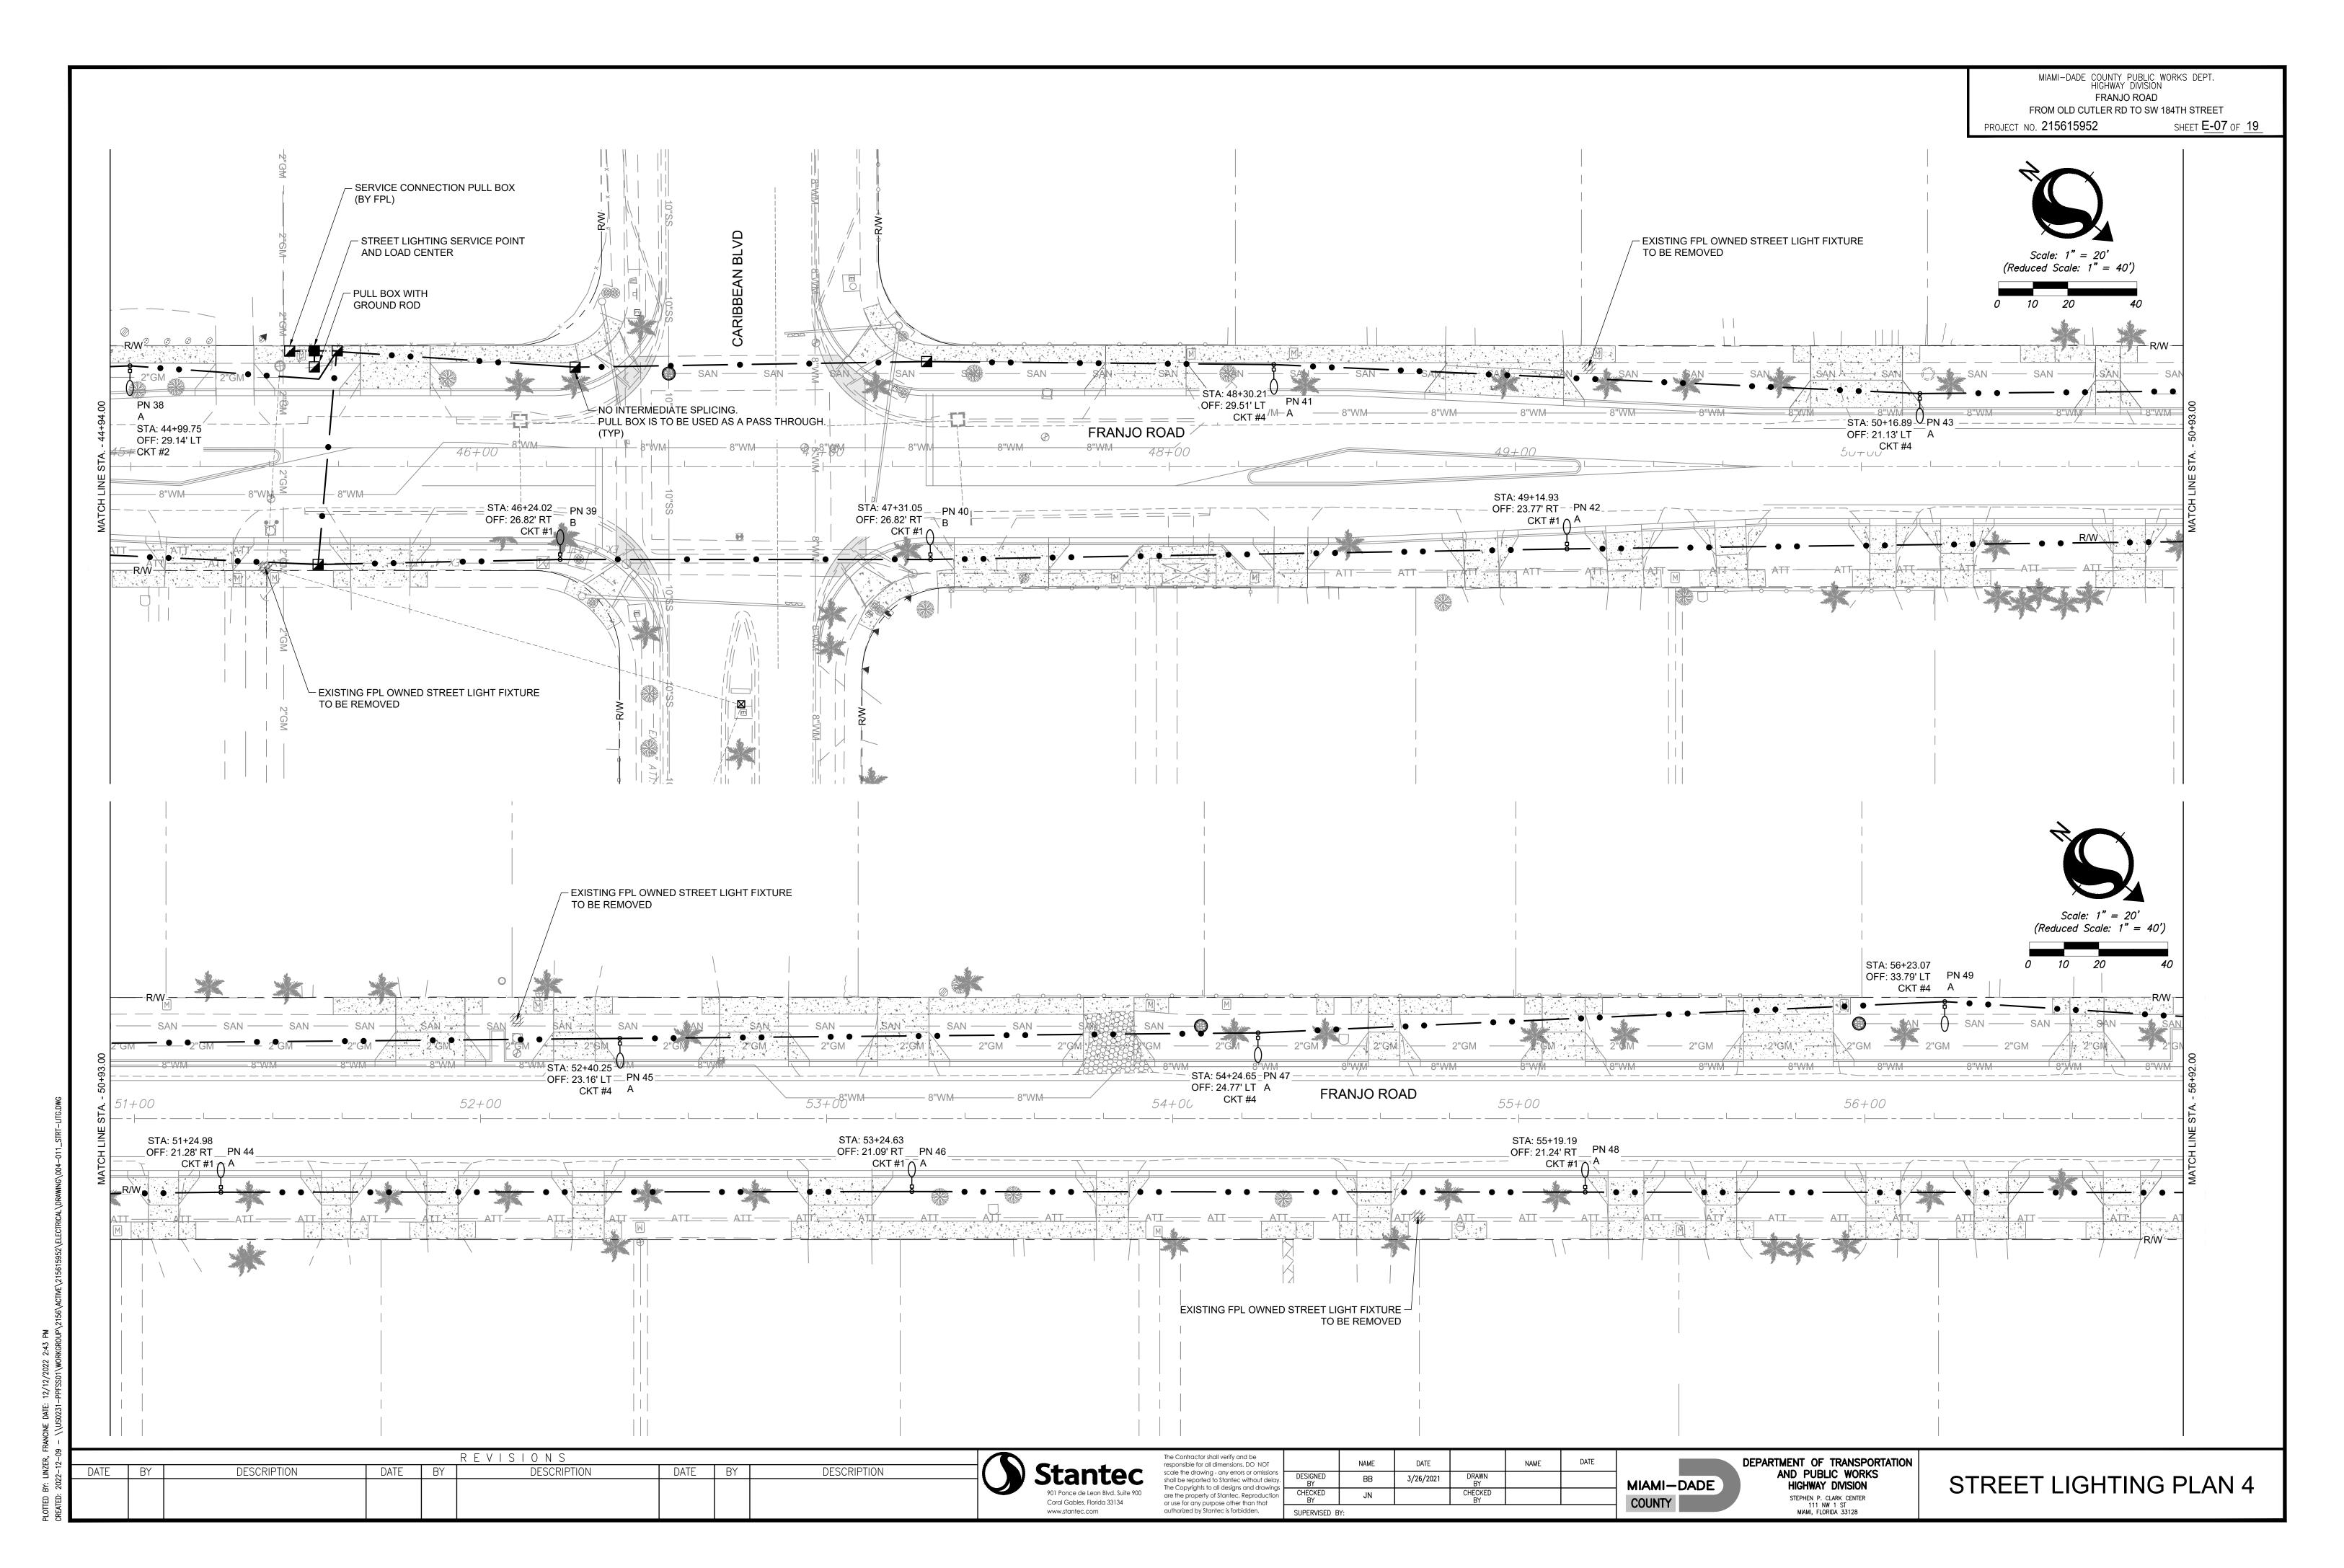


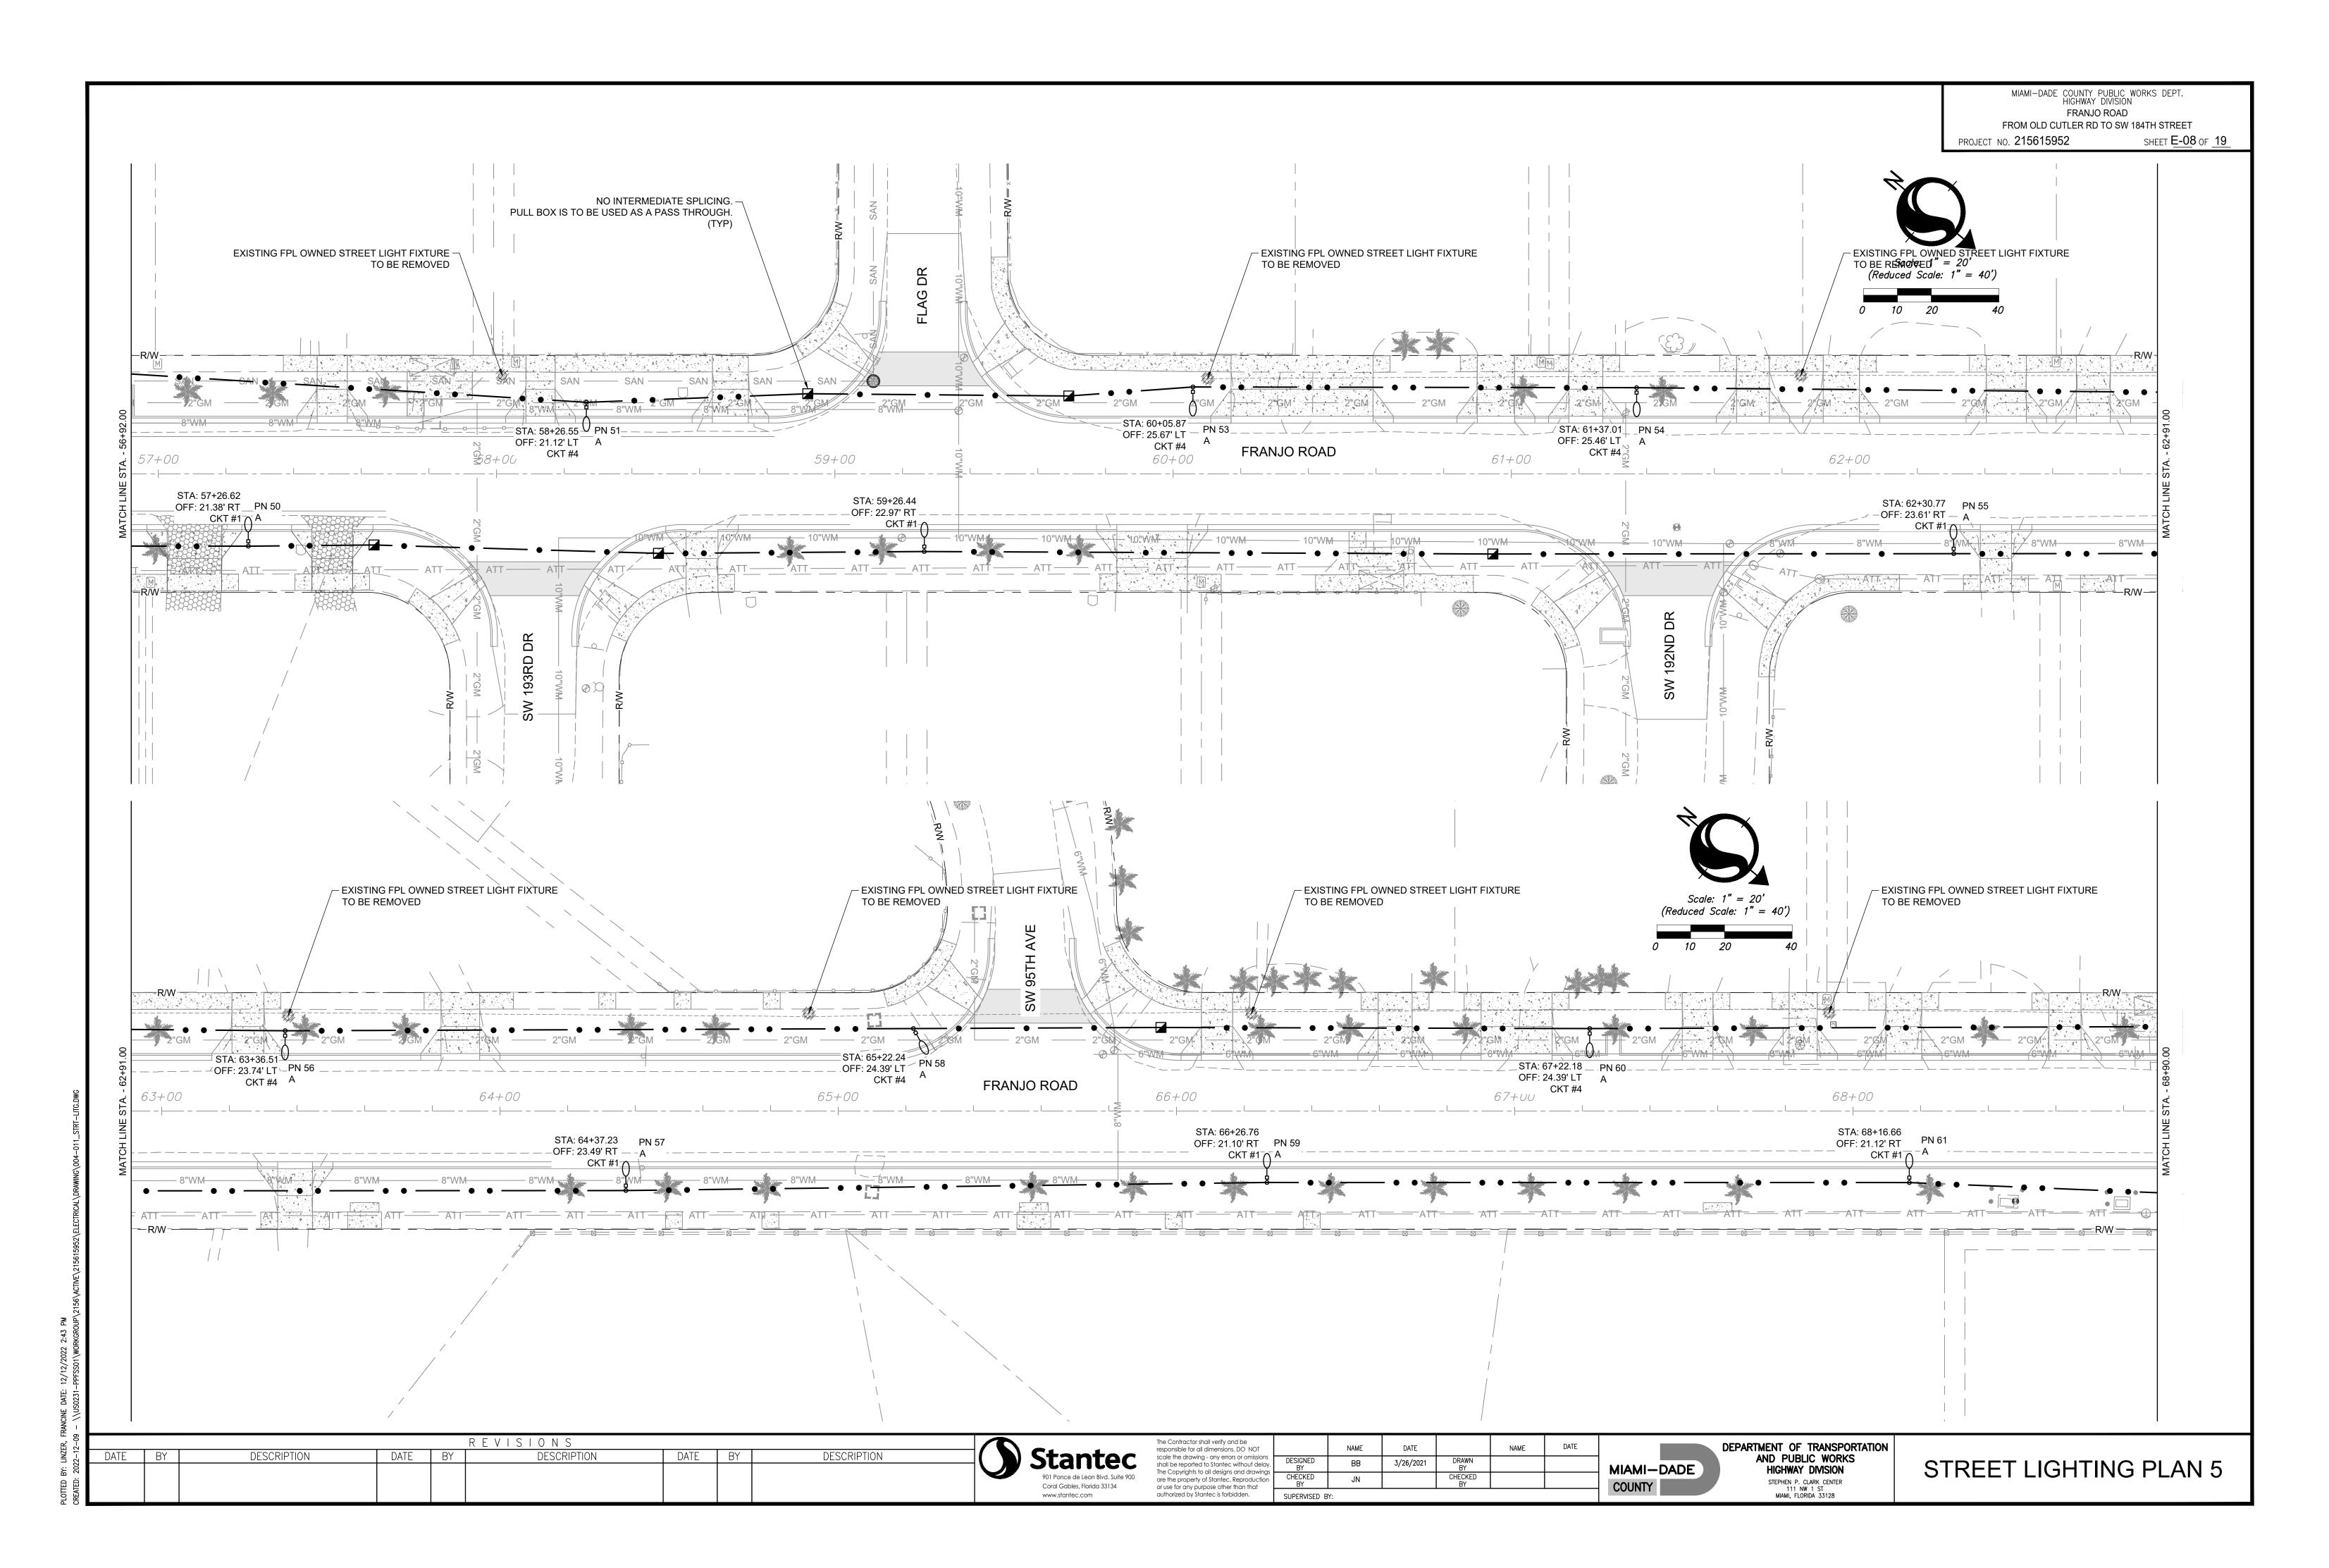


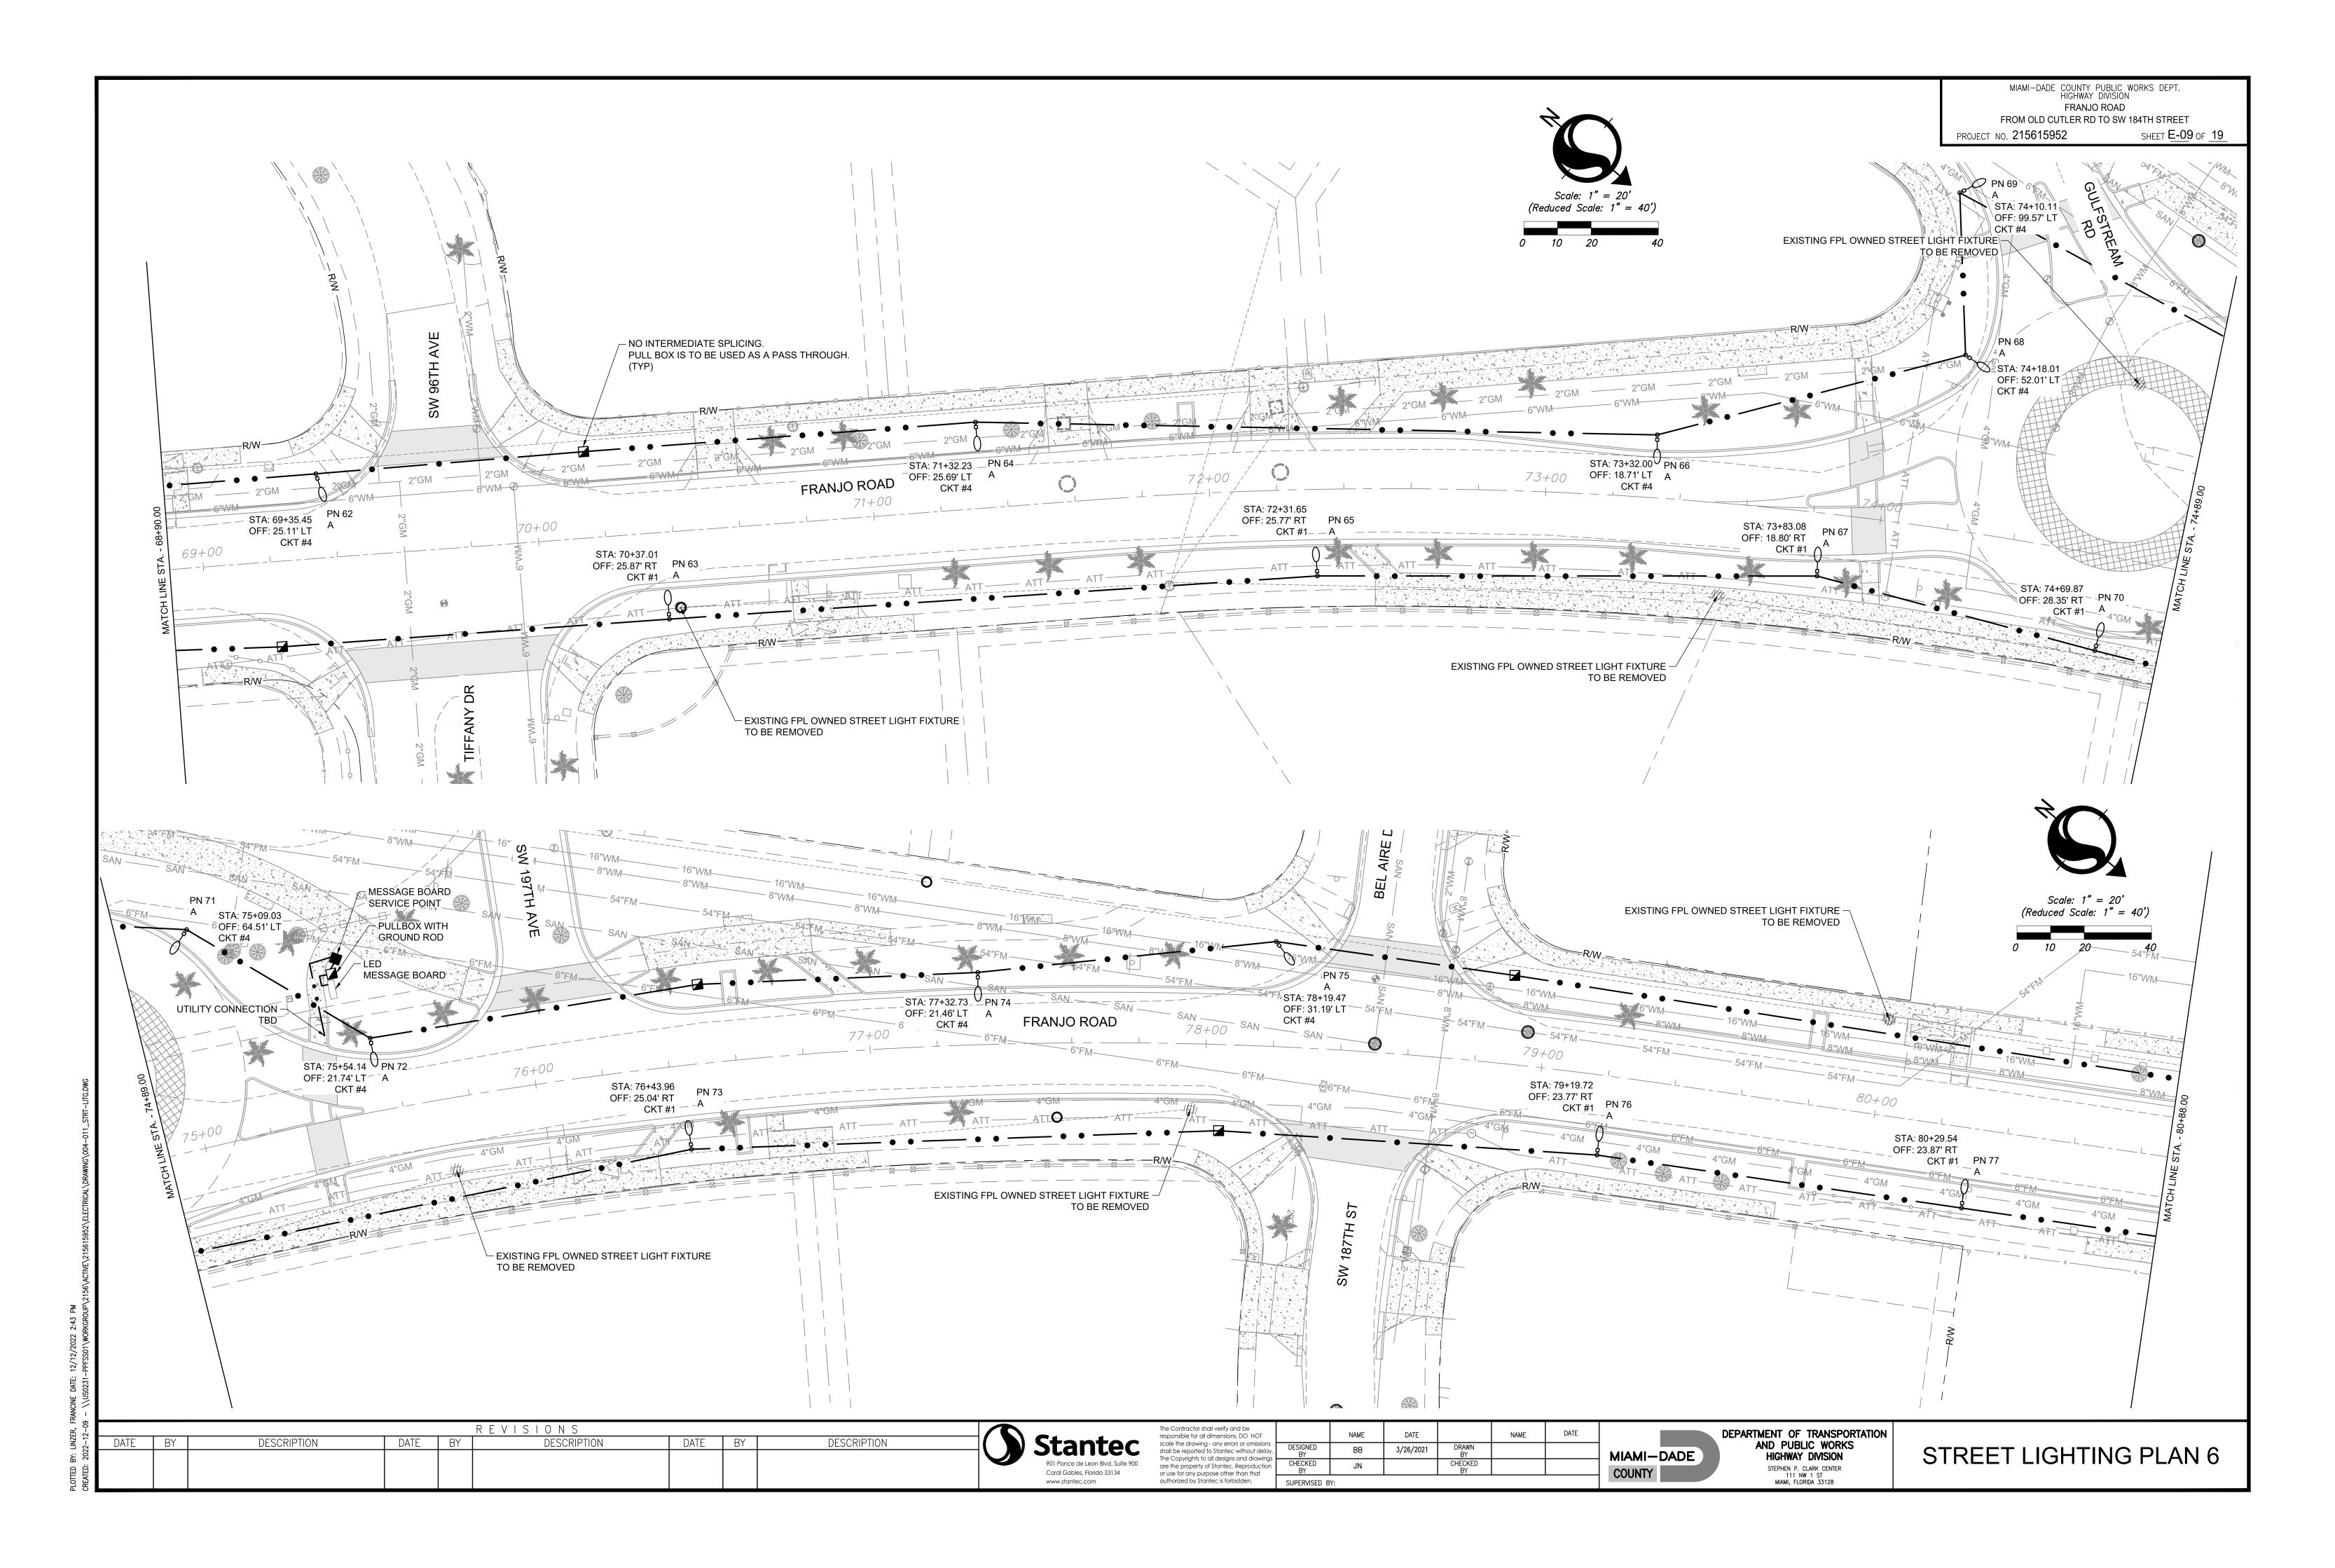


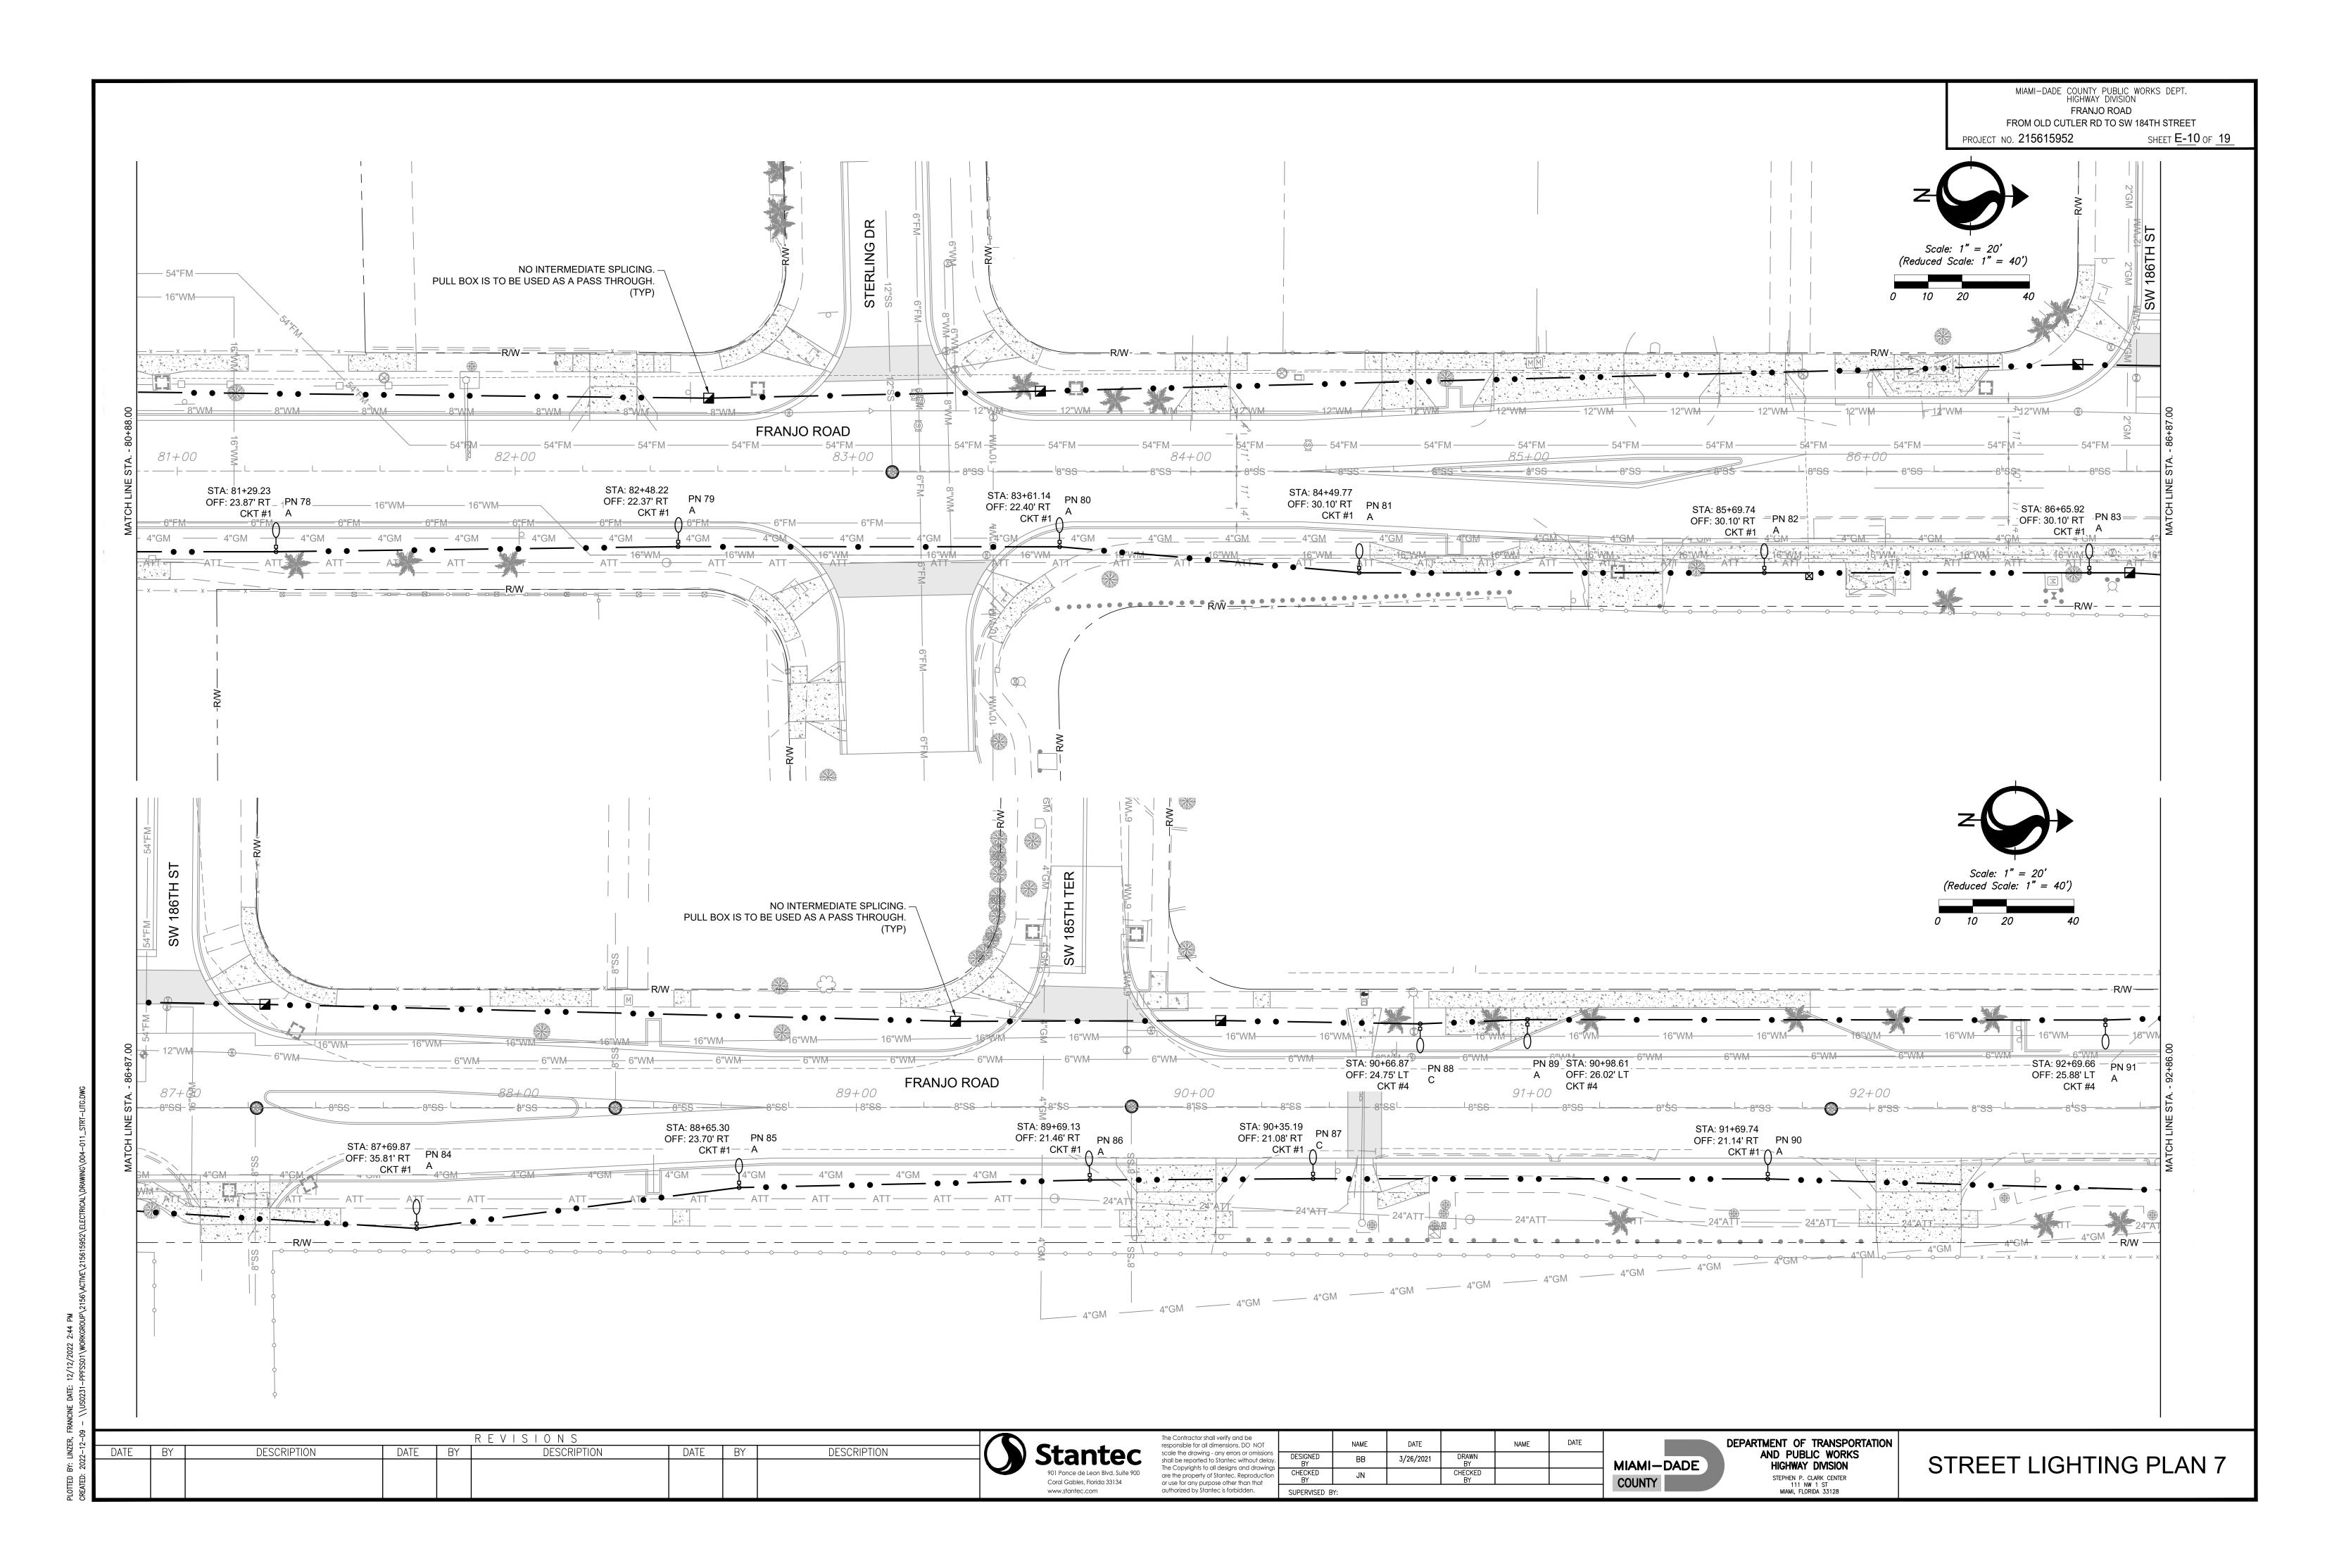


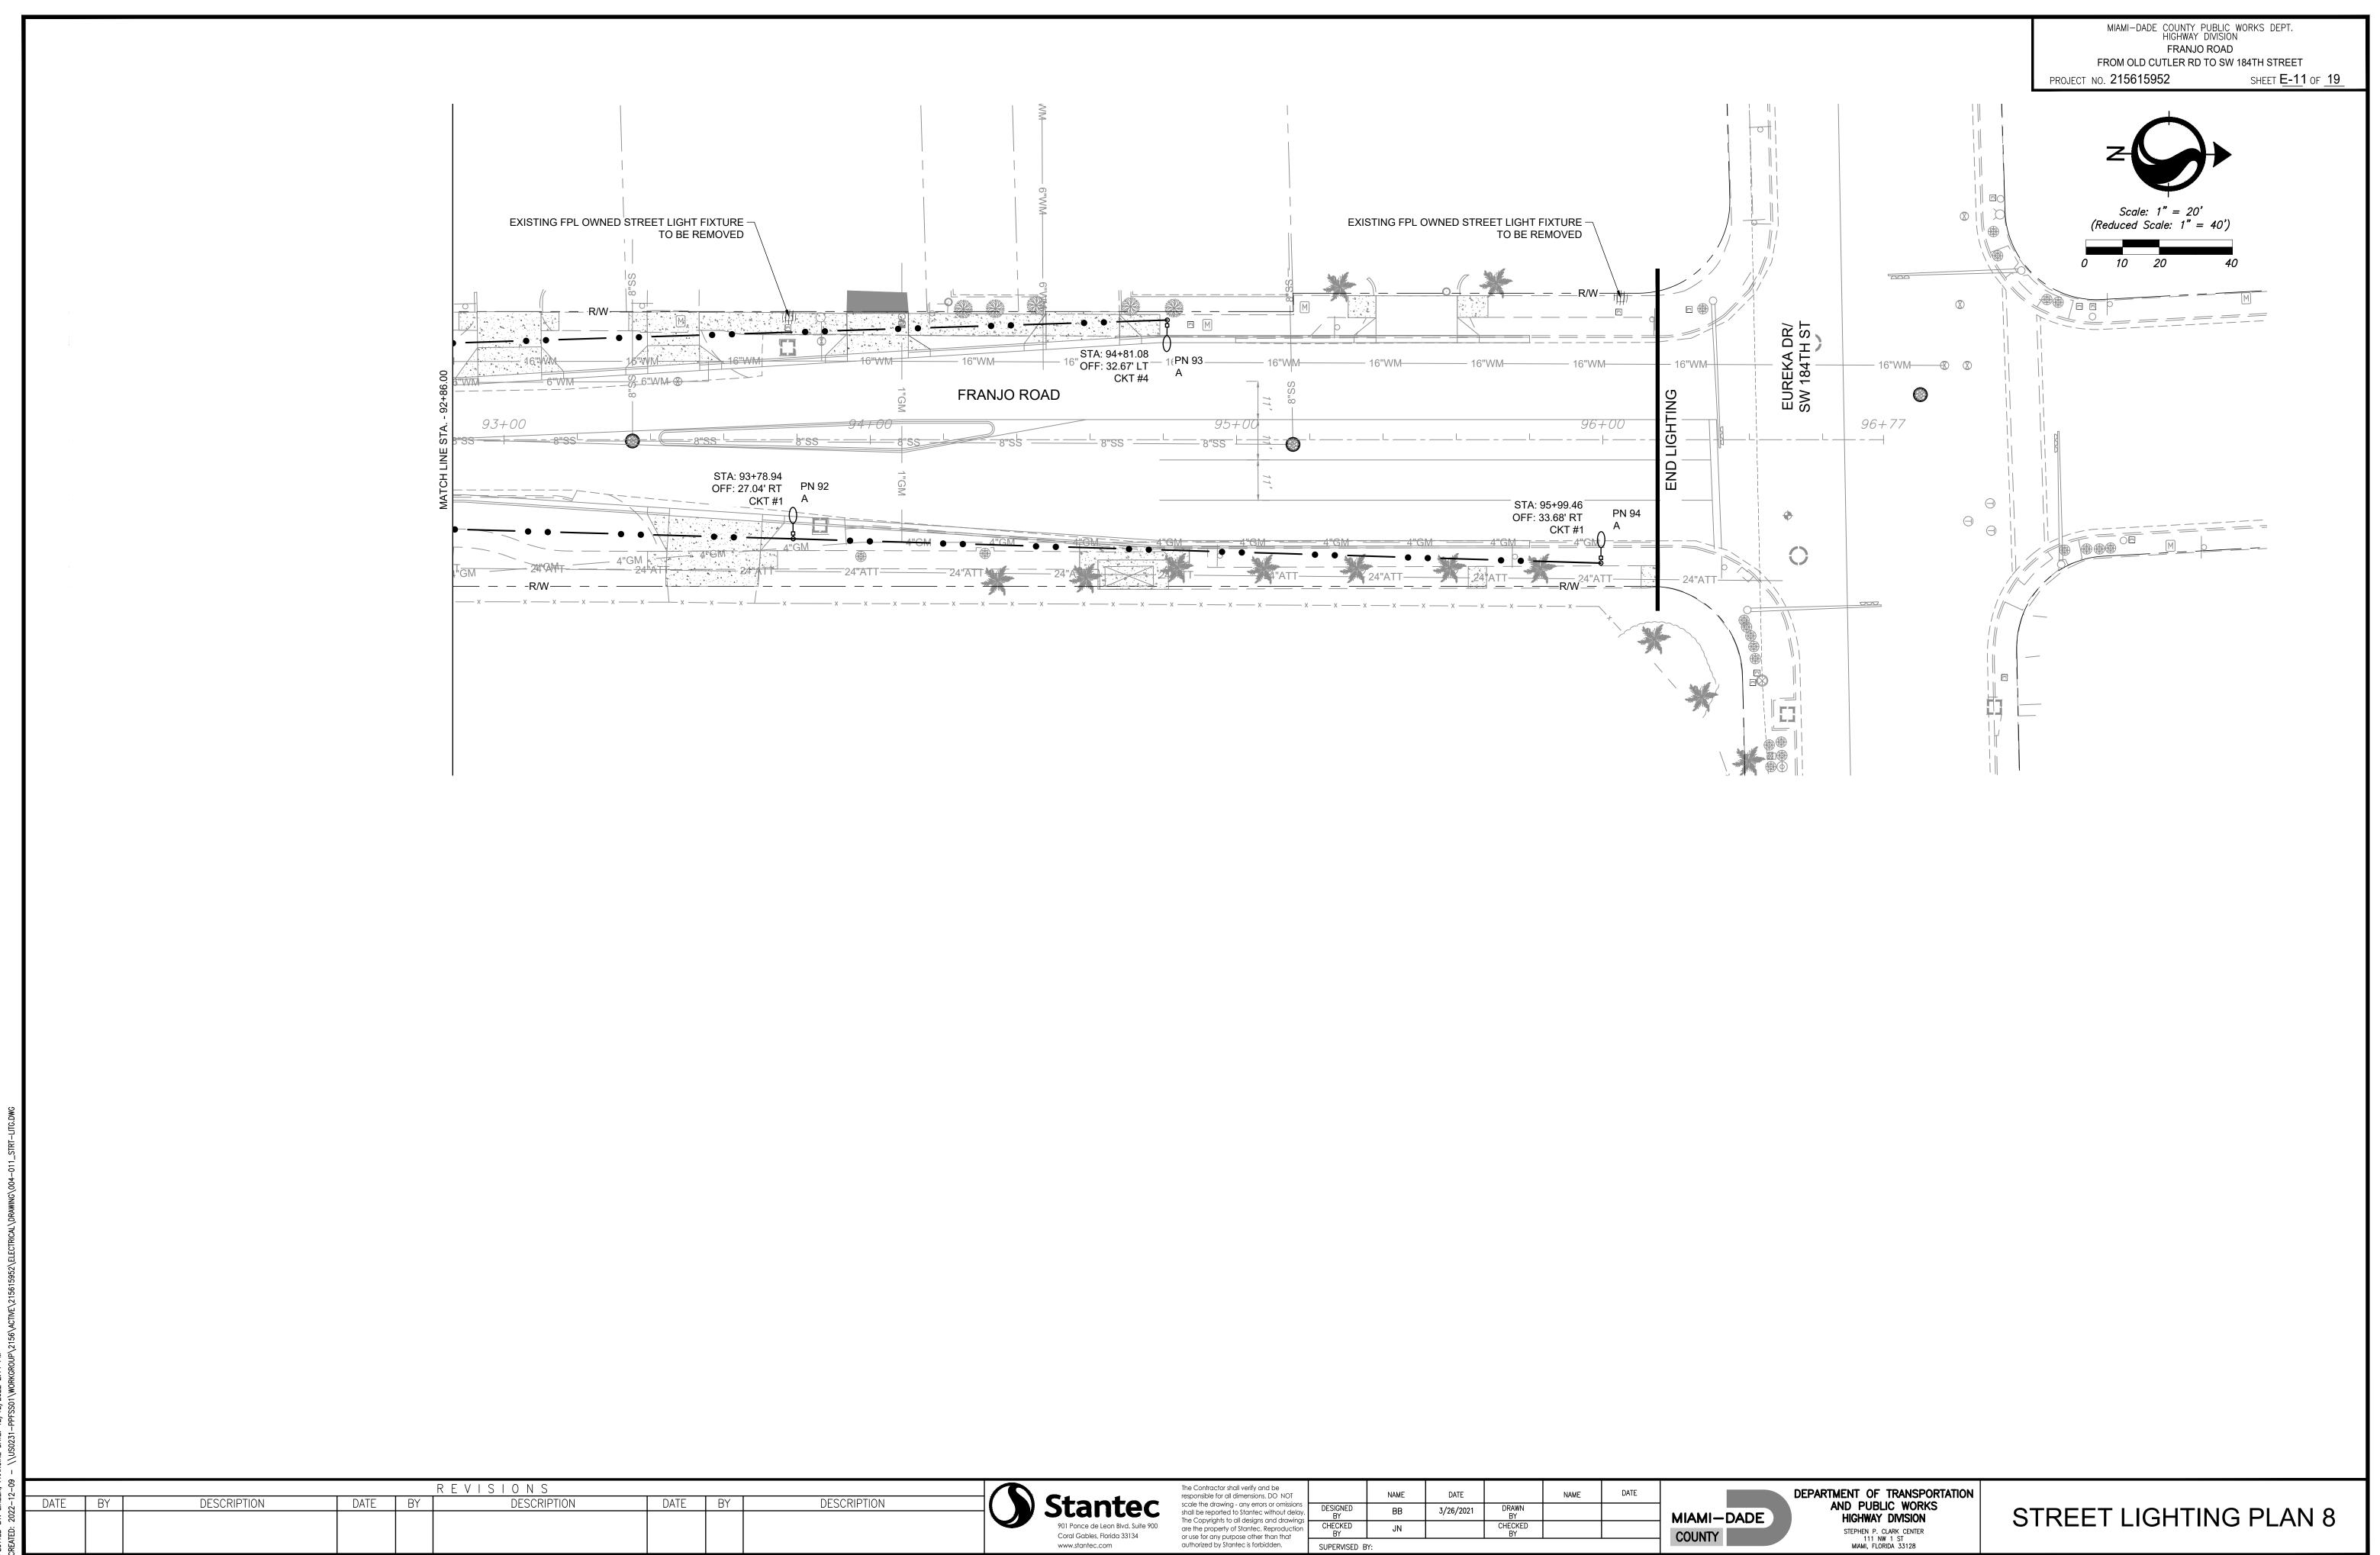

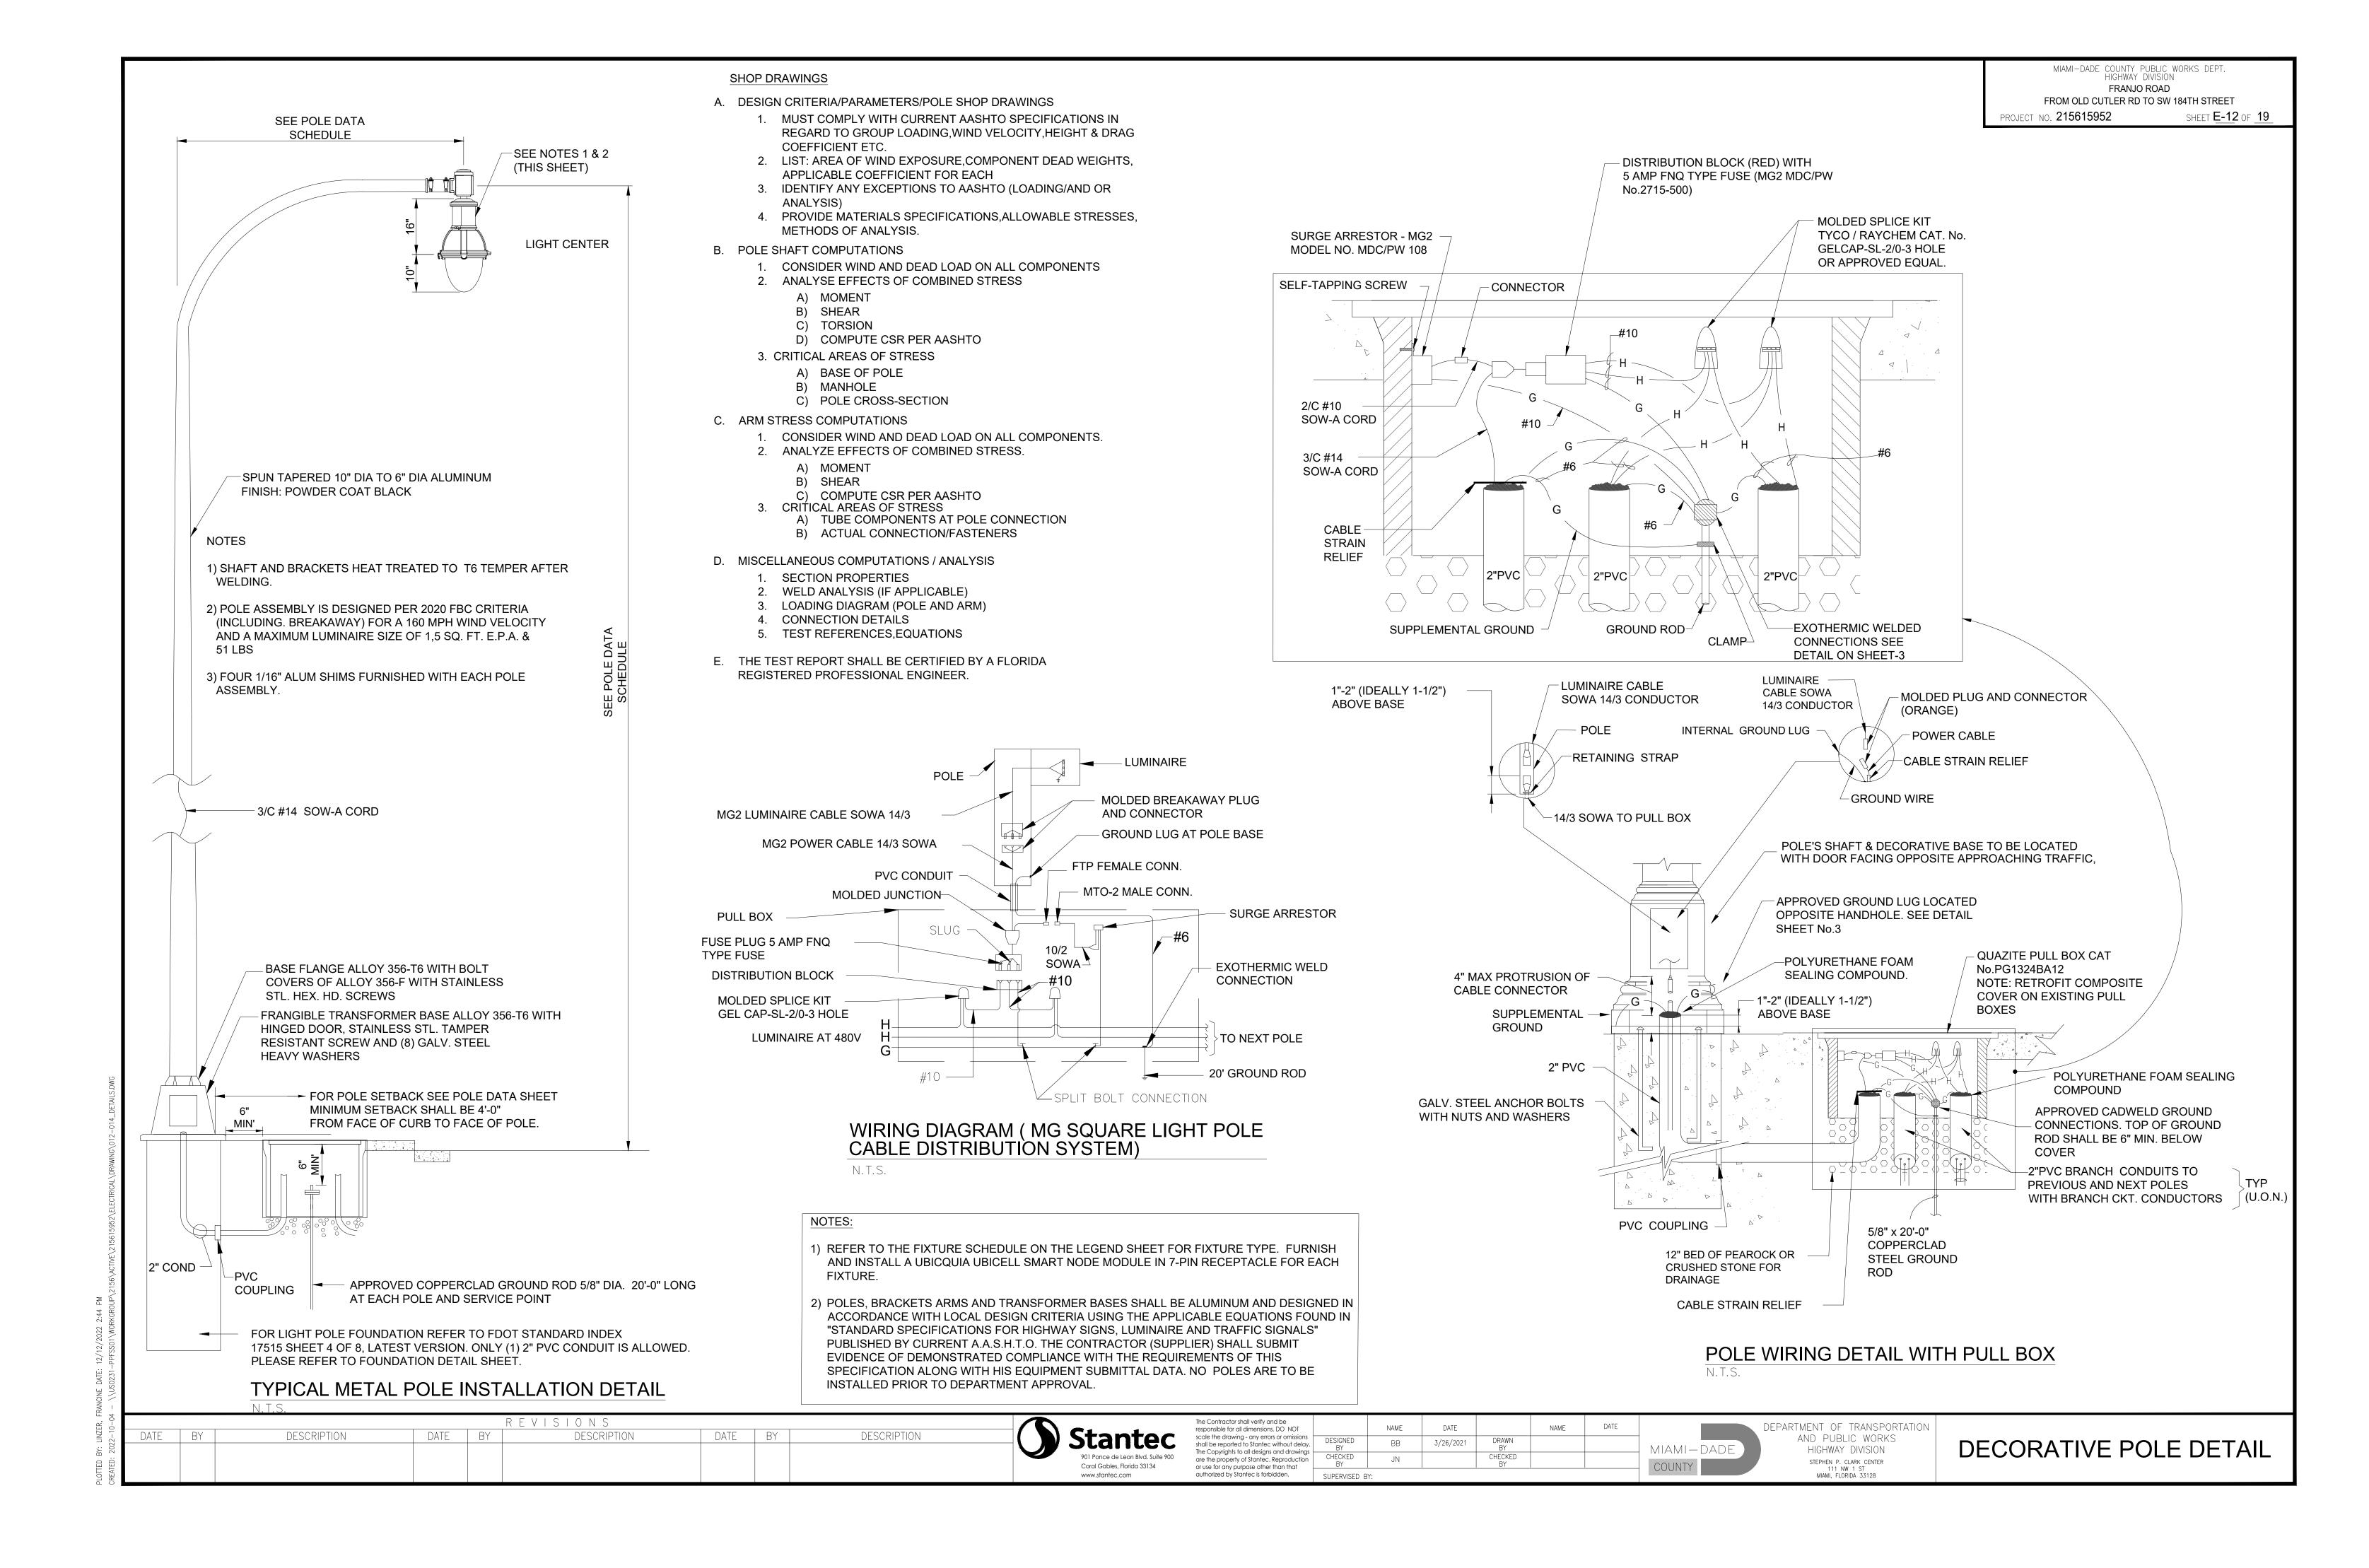

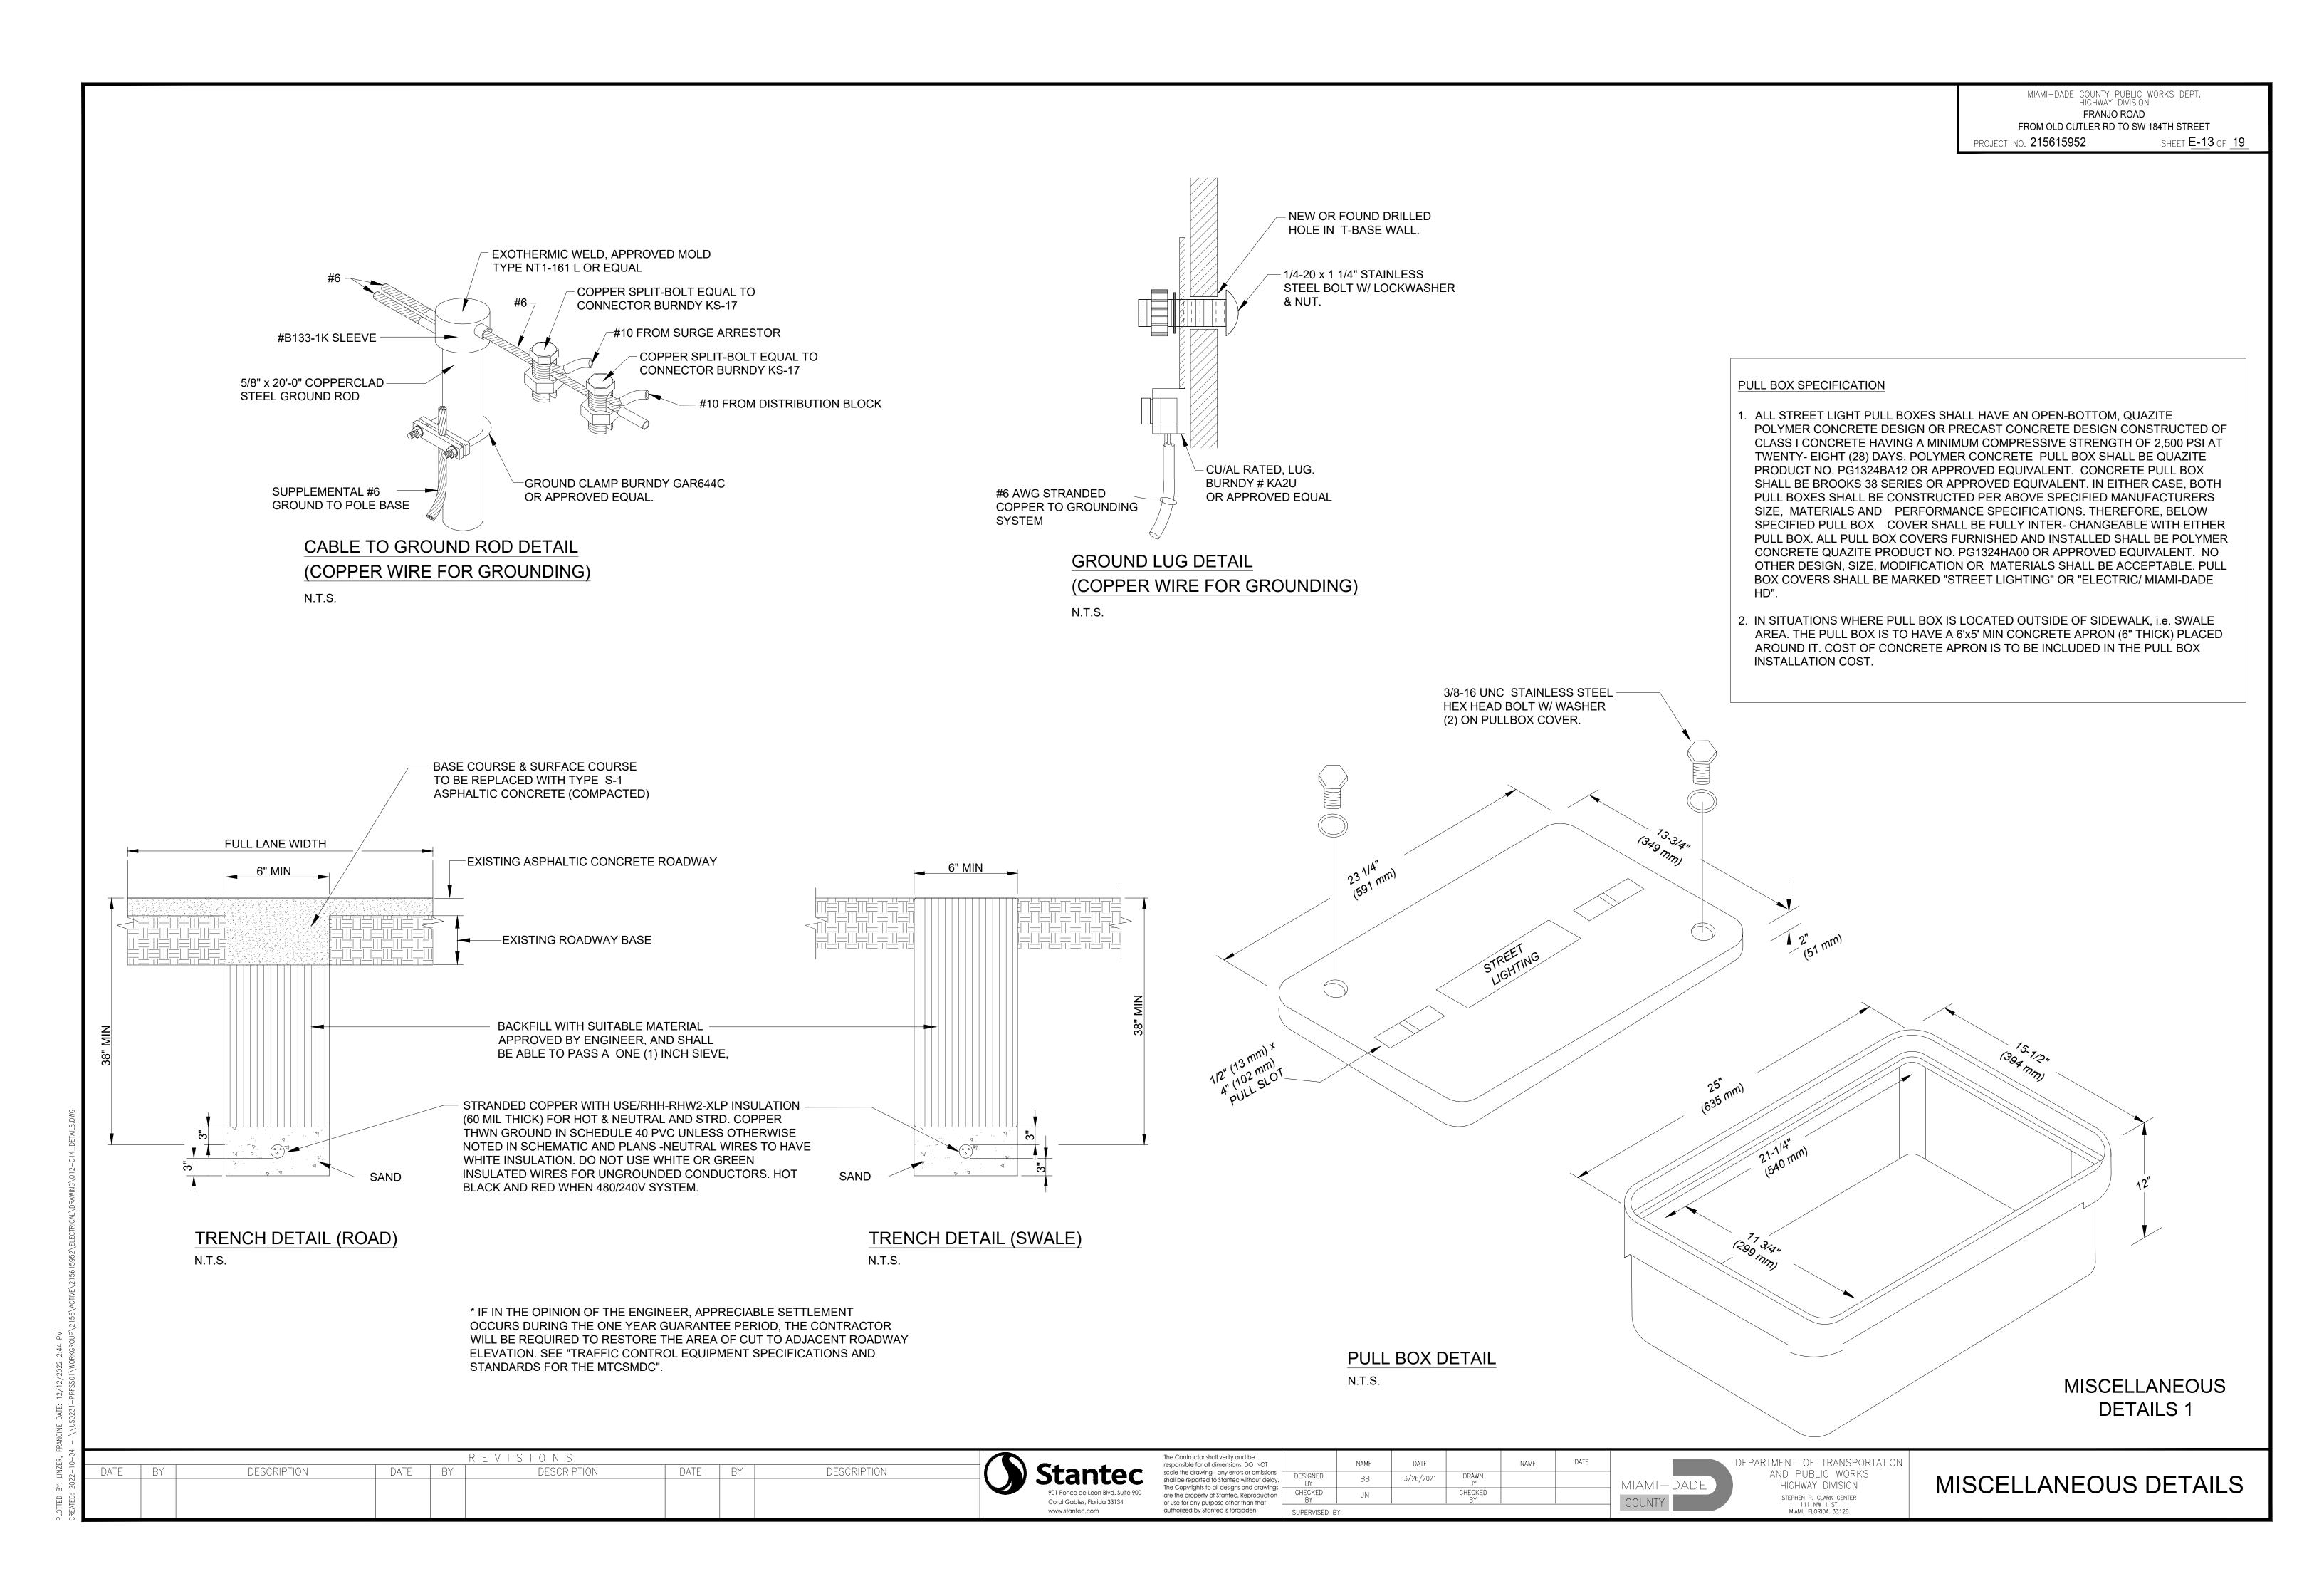

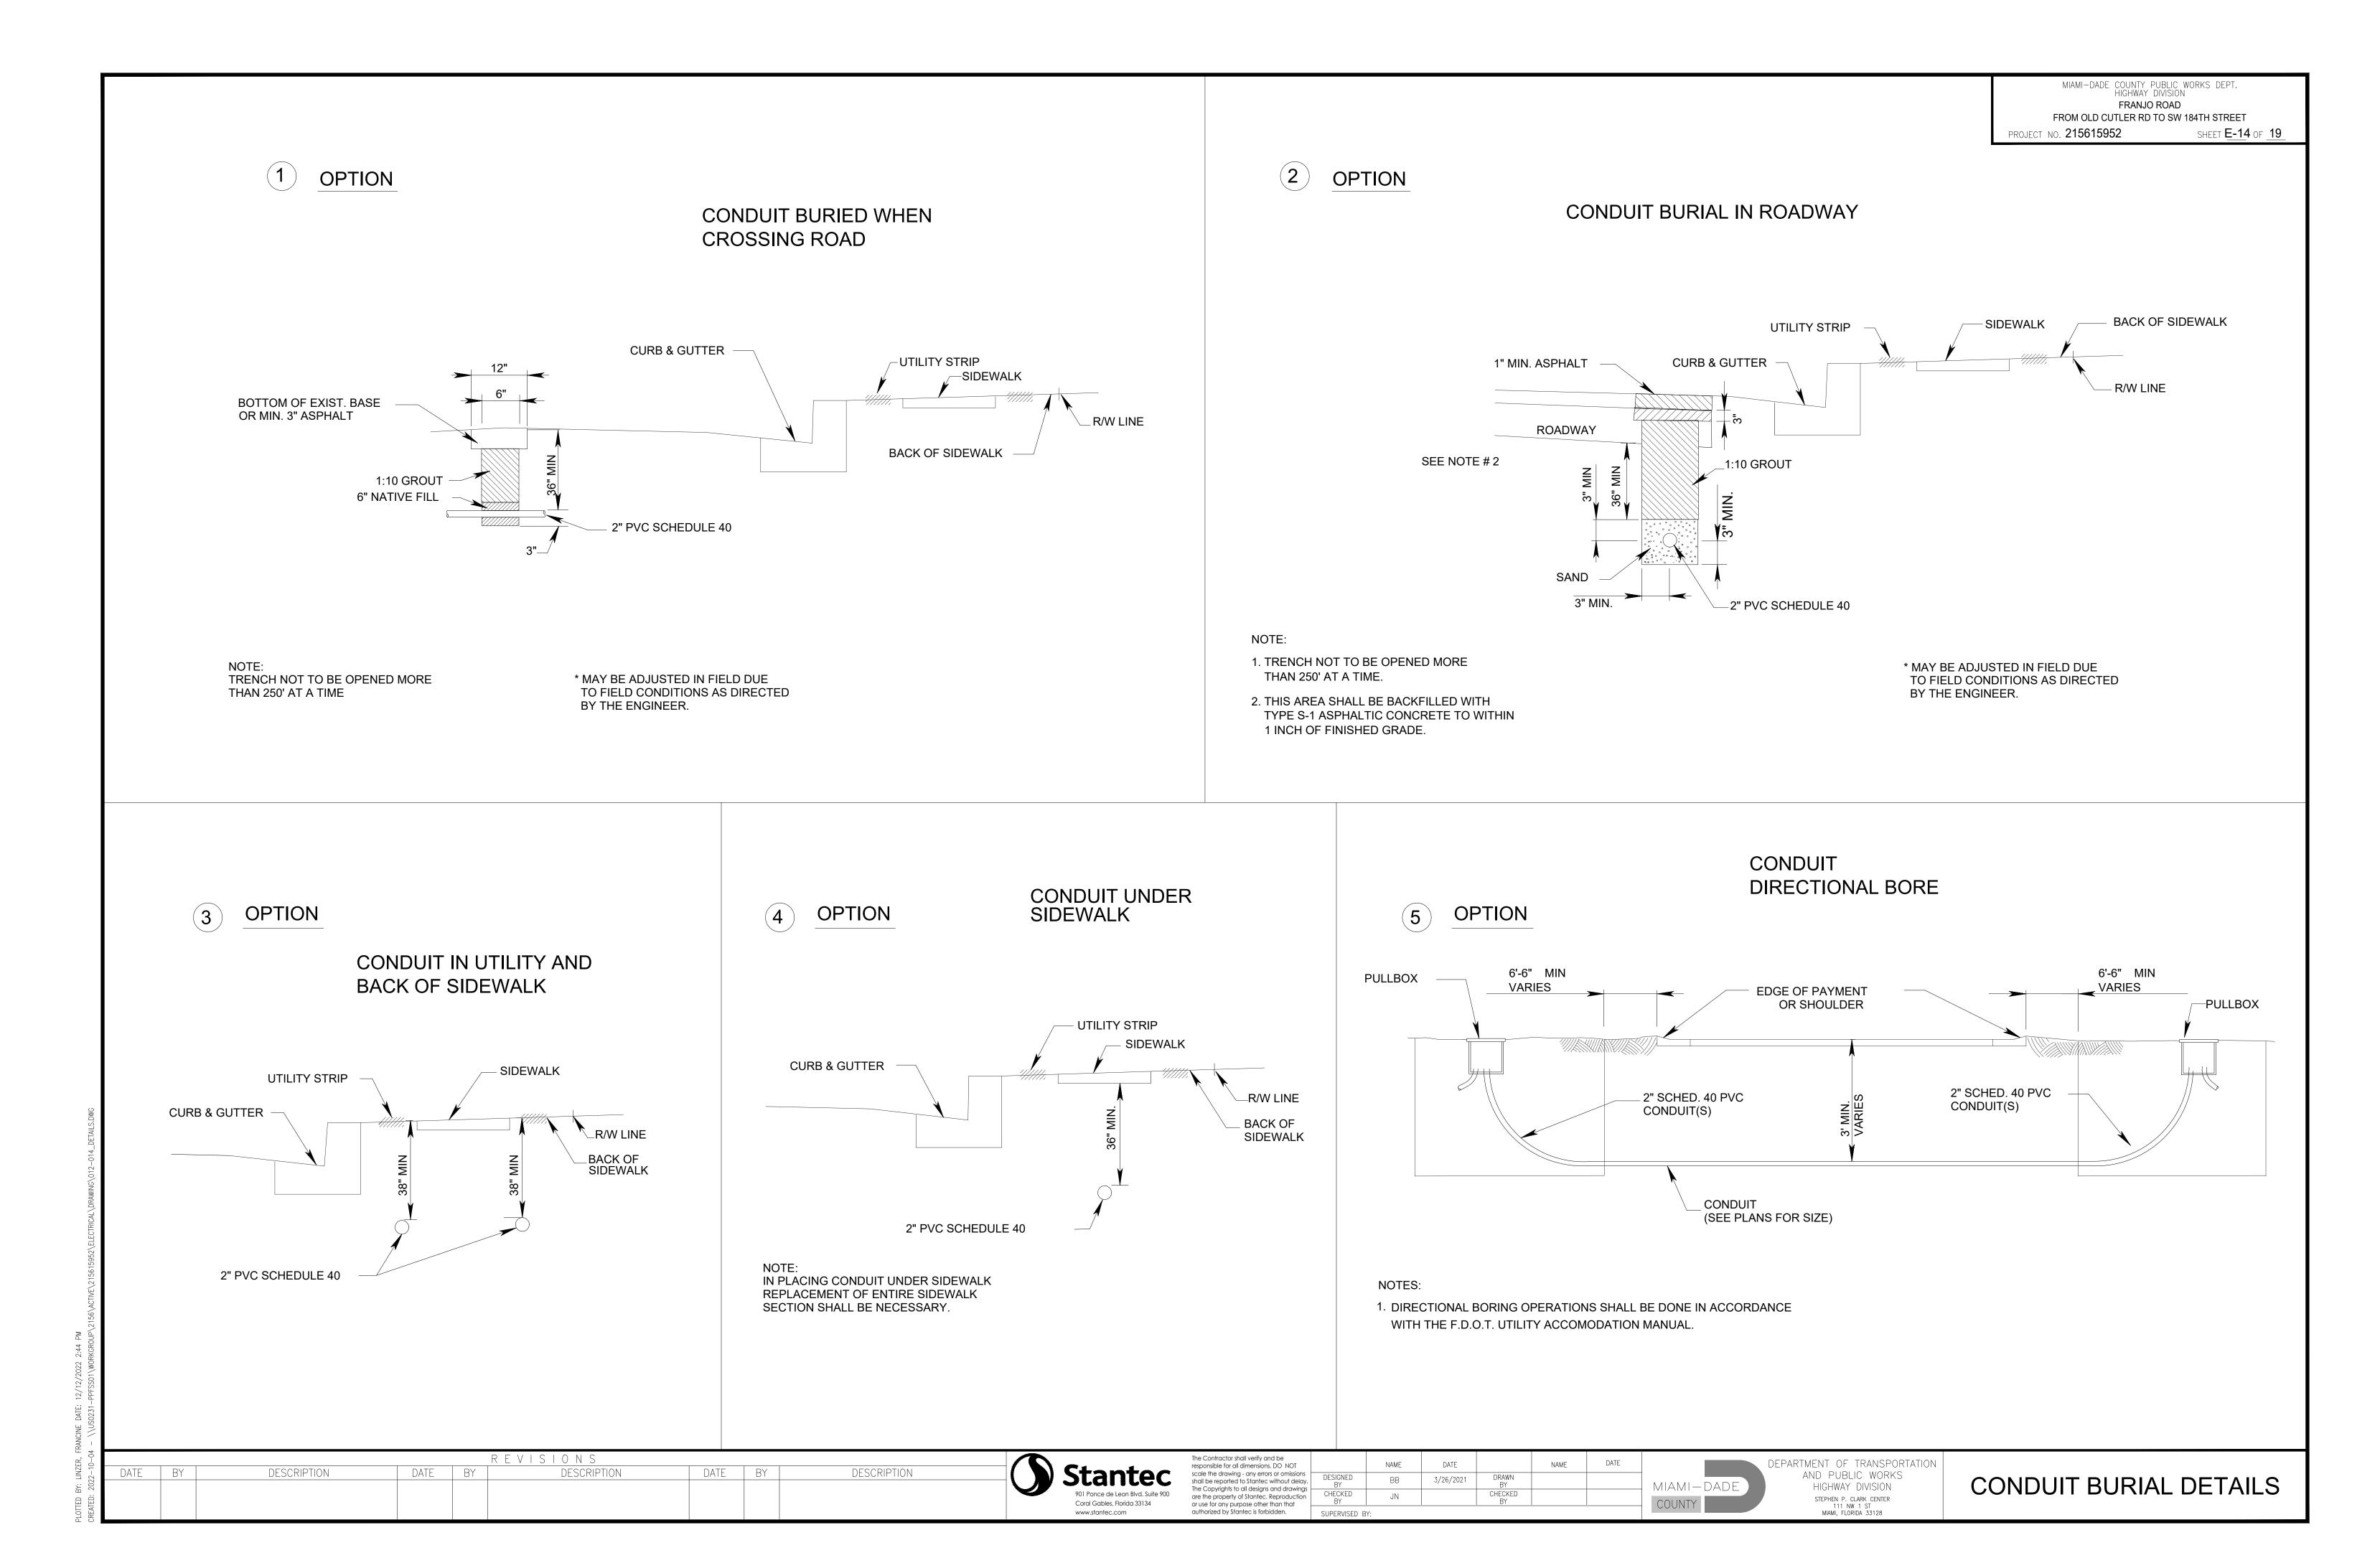

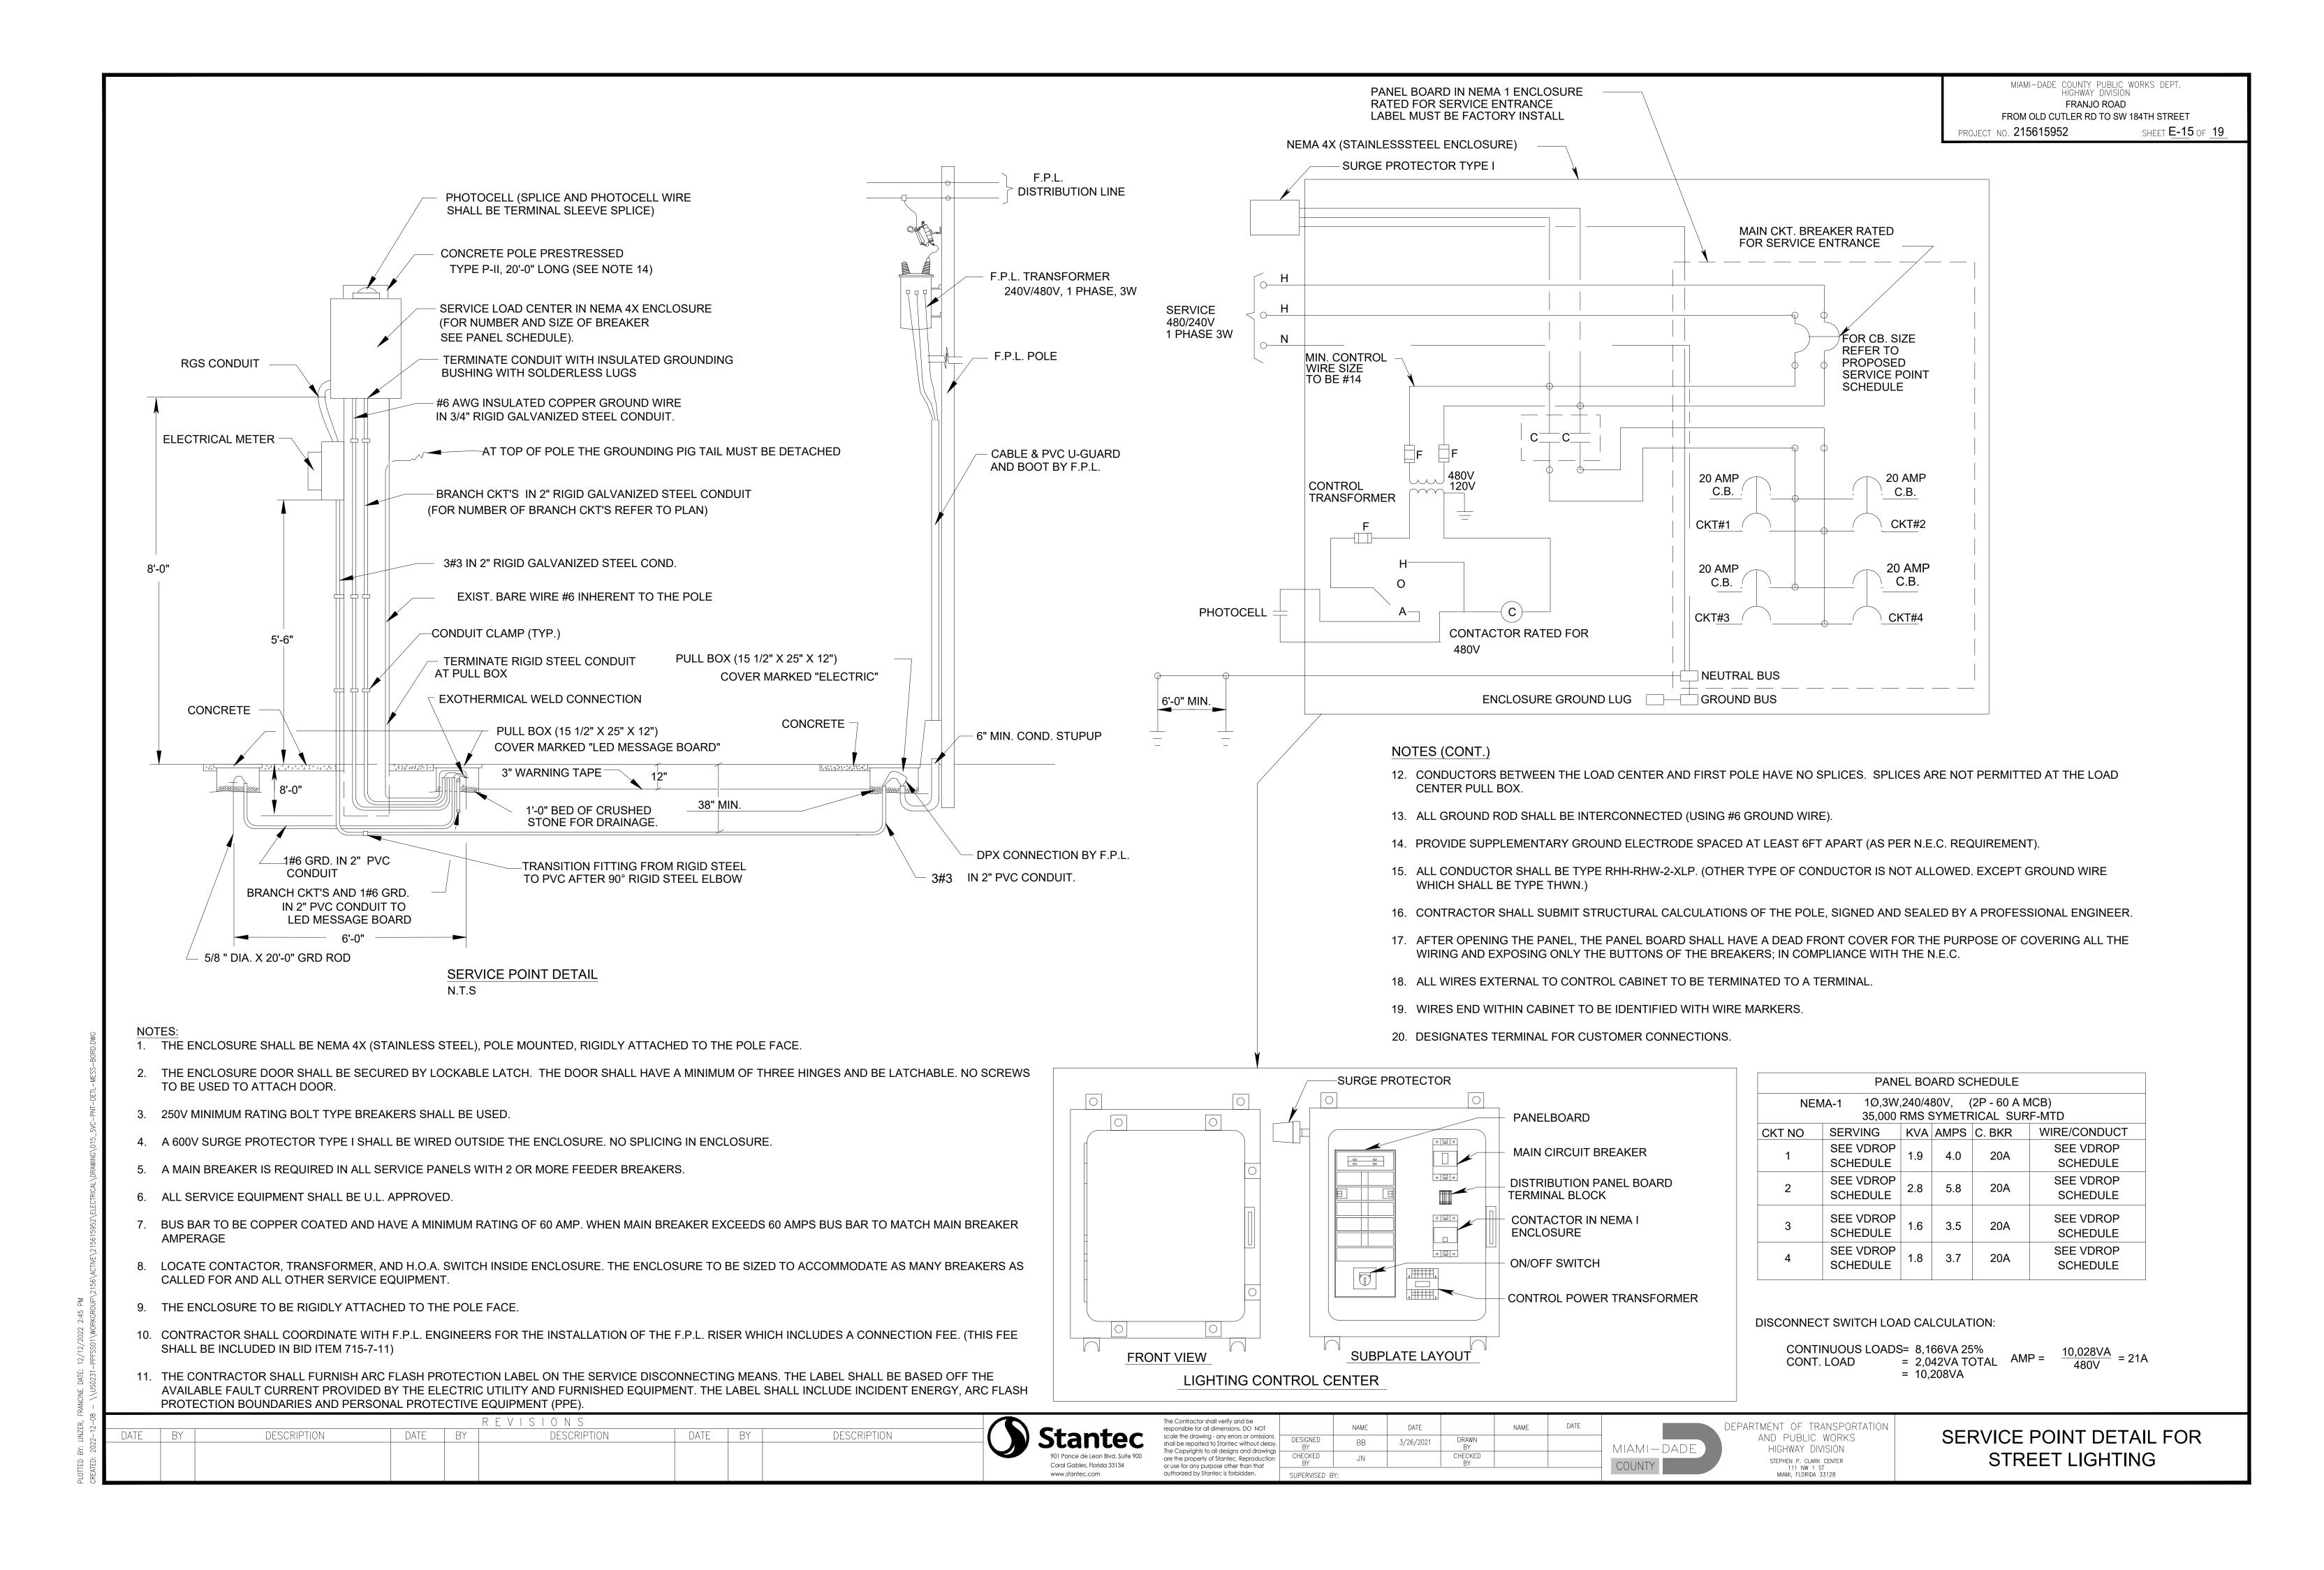


- 1. METER INSTALLATION CONNECTION AND ALL WORK RELATED TO ELECTRICAL POWER SERVICE SHALL BE COORDINATED WITH FPL UTILITY REPRESENTATIVE. COORDINATE EXACT LOCATION, EQUIPMENT DIMENSIONS, AND SERVICE INSTALLATION.
- 2. THE ELECTRICAL CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATING ELECTRICAL INSTALLATIONS WITH ALL OTHER TRADES TO AVOID ANY CONFLICTS.
- 3. ALL NEW WIRING SHALL BE INSTALLED IN CONDUIT WITHOUT EXCEPTION. MINIMUM SIZE CONDUIT SHALL BE 3/4".
- 4. ALL NEW CONDUCTORS SHALL BE TYPE THHN/THWN-2 90C COPPER FOR #10 AND SMALLER AND XHHW-2 FOR #8 AND LARGER.
- 5. THE USE OF NO. 14 AWG COPPER CONDUCTORS SHALL BE RESTRICTED TO CONTROL AND INSTRUMENT WIRING.
- 6. ALL ELECTRICAL EQUIPMENT SHALL BE GROUNDED IN ACCORDANCE WITH ARTICLE 250 OF THE N.E.C.
- 7. ALL CUTTING AND PATCHING REQUIRED FOR THE INSTALLATION OF NEW RACEWAYS OR EQUIPMENT SHALL BE PERFORMED BY A TRADESMAN EXPERIENCED IN THE WORK REQUIRED. ALL FINISHES SHALL MATCH EXISTING ADJACENT SURFACES.
- 8. THE ELECTRICAL CONTRACTOR SHALL BE RESPONSIBLE FOR ANY LOSS OR DAMAGE CAUSED BY HIM OR HIS WORKMAN TO THE LOCATION DURING THE COURSE OF CONSTRUCTION. THE ELECTRICAL CONTRACTOR SHALL BE RESPONSIBLE FOR REPAIRING OR REPLACING SUCH LOSS OR DAMAGE AT NO ADDITIONAL COST TO THE OWNER.
- THE ELECTRICAL WORK SHALL COMPLY WITH ALL APPLICABLE CITY, COUNTY, STATE AND SERVING ELECTRICAL UTILITY CODES, ORDINANCES, RULES AND REGULATIONS. THE ENTIRE ELECTRICAL INSTALLATION SHALL COMPLY WITH OR SURPASS THE LATEST EDITION OF THE NATIONAL ELECTRICAL CODE.
- 10. THE ELECTRICAL CONTRACTOR SHALL FURNISH ALL MATERIALS, TOOLS, LABOR, PLAN CHECK FEES, ETC., FOR A COMPLETE ELECTRICAL INSTALLATION UNLESS OTHERWISE NOTED ON PLANS.
- 11. ALL MATERIALS FURNISHED BY THE ELECTRICAL CONTRACTOR SHALL BE NEW AND OF FIRST CLASS QUALITY, SHALL BE U.L. LISTED AND FREE OF ANY DEFECTS UNLESS OTHERWISE NOTED ON PLANS.
- 12. ALL EQUIPMENT SHALL BE RATED FOR USE INTENDED VOLTAGE, H.P., ETC. ALL DISCONNECT SWITCHES FURNISHED SHALL BE LOAD BREAK RATED.
- 13. ALL NECESSARY PERMITS REQUIRED FOR ELECTRICAL INSTALLATIONS ARE THE RESPONSIBILITY OF THE ELECTRICAL CONTRACTOR AND SHALL BE CONSIDERED TO BE PART OF HIS CONTRACT FEE.
- 14. THE ELECTRICAL CONTRACTOR SHALL FULLY GUARANTEE THE INSTALLATION FOR A PERIOD OF ONE YEAR FROM THE DATE OF FINAL ACCEPTANCE BY THE OWNER AGAINST IMPERFECT WORKMANSHIP AND MALFUNCTION OF EQUIPMENT. ANY WORK FOUND TO BE DEFECTIVE WITHIN THIS PERIOD SHALL BE REPAIRED OR REPLACED PROMPTLY AT NO ADDITIONAL COST TO THE OWNER.
- 15. DRAWINGS ARE DIAGRAMMATIC IN NATURE AND CANNOT SHOW EVERY CONNECTION, JUNCTION BOX, WIRE, CONDUIT, ETC. THE EXACT LOCATION AND ARRANGEMENT OF ALL PARTS SHALL BE DETERMINED AS THE WORK PROGRESSES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING A COMPLETE AND FUNCTIONAL ELECTRICAL SYSTEM.
- 16. ALL SERVICE EQUIPMENT SHALL BE U.L. LISTED..
- 17. ELECTRICAL CONTRACTOR TO VERIFY AND PROVIDE EQUIPMENT GROUNDING CONDUCTOR AS PER NEC 250. ALL EXPOSED METAL PARTS ARE TO BE BONDED TO THE GROUND SYSTEM.

KEYED NOTES

- THE ENCLOSURE SHALL BE NEMA 4X POLE MOUNTED, RIGIDLY ATTACHED TO THE POLE FACE. THE ENCLOSURE DOOR SHALL BE LOCKABLE BY PADLOCK AND FOUR KEYS PROVIDED. NO SCREWS TO BE USED TO ATTACH DOOR.
- SPD SHALL BE WIRED INSIDE THE ENCLOSURE. PROVIDE SQUARE D SDSA1175 OR APPROVED EQUIVALENT. CONNECT PER MANUFACTURER INSTRUCTIONS.
- (3) MODIFY EMBEDMENT DEPTH AS REQUIRED BY FIELD CONDITIONS.
- 4 BOND RGS CONDUIT TO GROUNDING ELECTRODE CONDUCTOR AT BOTH ENDS.
- NEW SIGN WITH TWO MESSAGE BOARDS (ONE ON EACH SIDE). ALPHA ECLIPSE STREET SMART 48X64 AMBER, 17MM, WITH CELLULAR RADIO.

THE CONTRACTOR SHALL FURNISH ARC FLASH PROTECTION LABEL ON THE MESSAGE BOARD SERVICE DISCONNECTING MEANS. THE LABEL SHALL BE BASED OFF THE AVAILABLE FAULT CURRENT PROVIDED BY THE ELECTRIC UTILITY AND FURNISHED EQUIPMENT. THE LABEL SHALL INCLUDED INCIDENT ENERGY, ARCH FLASH PROTECTION BOUNDARIES AND PERSONAL PROTECTIVE EQUIPMENT (PPE).

MIAMI-DADE COUNTY PUBLIC WORKS DEPT. HIGHWAY DIVISION FRANJO ROAD FROM OLD CUTLER RD TO SW 184TH STREET PROJECT NO. **215615952** SHEET **E-16** OF **19 FPL DISTRIBUTION** LINE FPL TRANSFORMER —

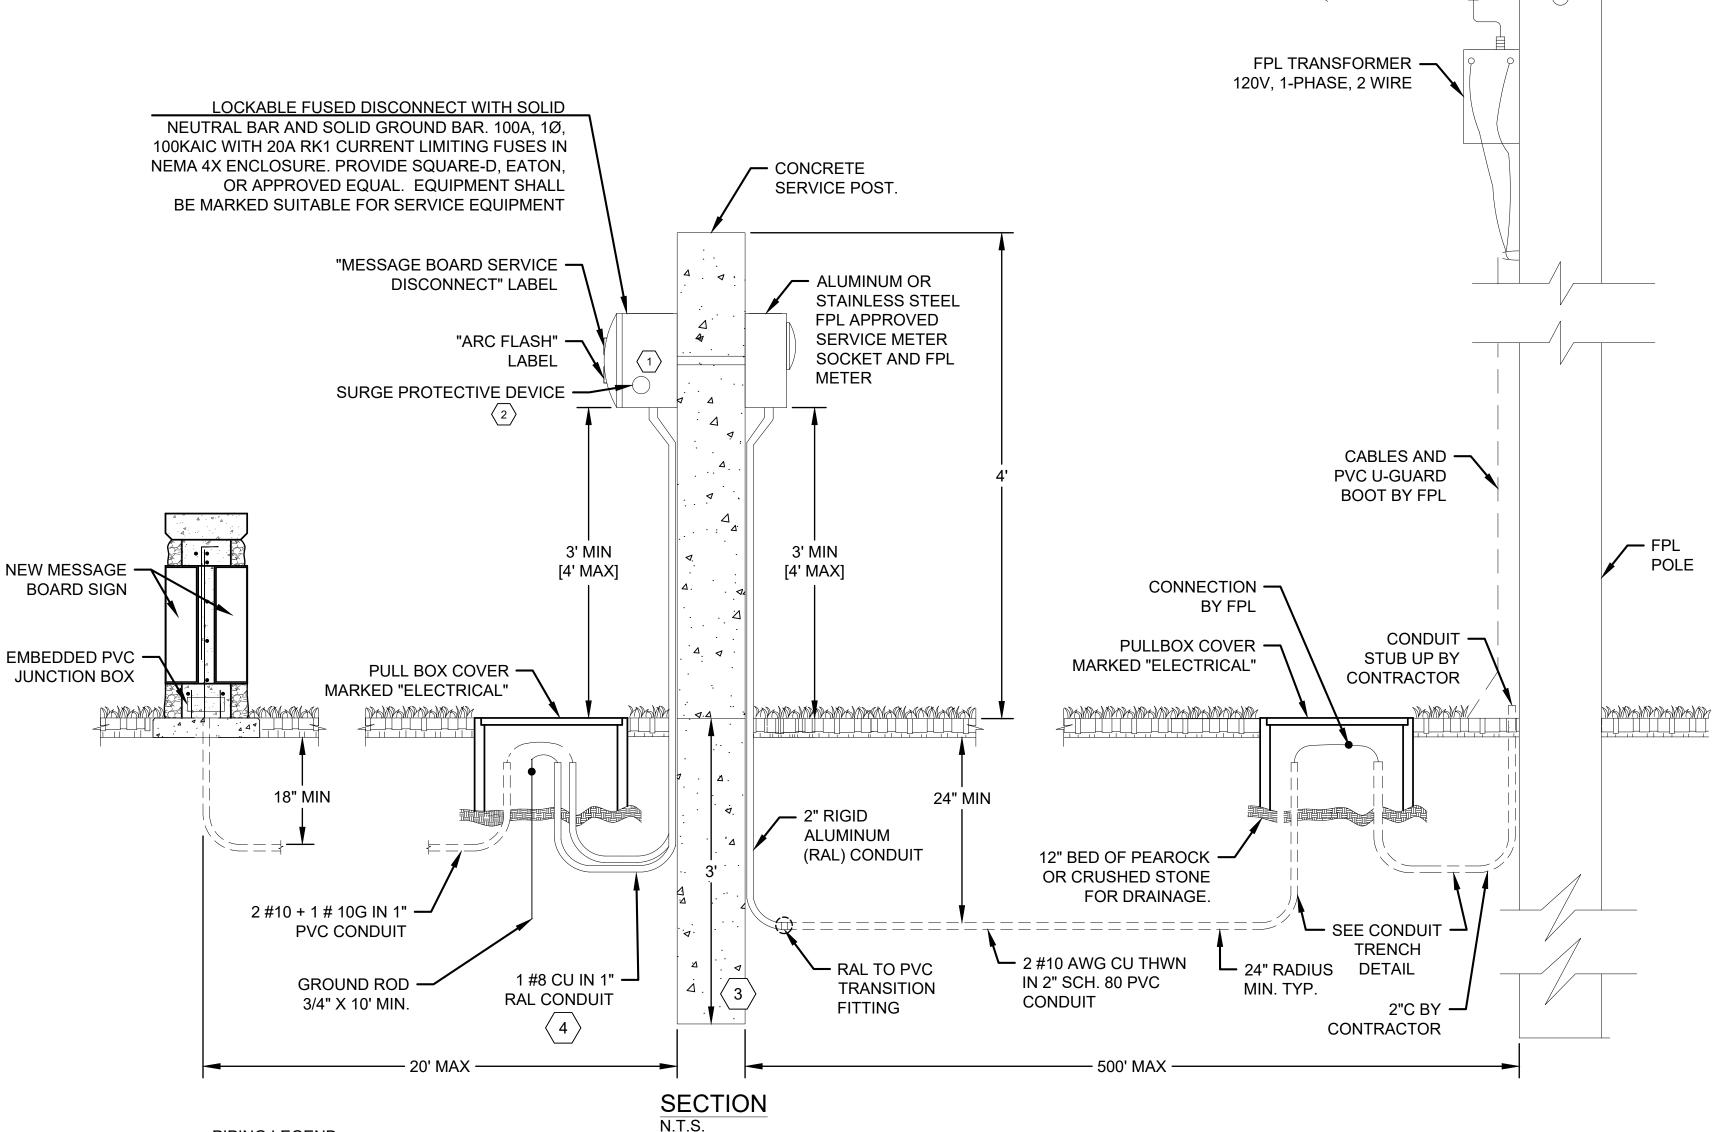

PIPING LEGEND:

OTHERWISE NOTED). REFER TO PLANS FOR SIZING.

RGS CONDUIT. REFER TO PLANS FOR SIZING AND QUANTITY.

TYPICAL SERVICE POINT DETAILS

DESCRIPTION MESSAGE BOARD SIDE 1 626.4 MESSAGE BOARD SIDE 2 626.4 25% OF CONTINUOUS LOADS TOTAL LOAD 1,566.0 AMPS@120V=13A

SERVICE 1 LOAD CALCULATION

N.T.S.

	R E V I S I U N S										
DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION			



e Contractor shall verify and be sponsible for all dimensions. DO NOT		NAME	DATE		NAME	DATE	
ale the drawing - any errors or omissions all be reported to Stantec without delay. e Copyrights to all designs and drawings	DESIGNED BY	BB	3/26/2021	DRAWN BY			М
e the property of Stantec. Reproduction use for any purpose other than that	CHECKED BY	JN		CHECKED BY			C
othorized by Stantec is forbidden.	SUPERVISED B	Y:					



DEPARTMENT OF TRANSPORTATION AND PUBLIC WORKS HIGHWAY DIVISION STEPHEN P. CLARK CENTER

SERVICE POINT DETAIL FOR MESSAGE BOARD

MIAMI-DADE COUNTY PUBLIC WORKS DEPT. HIGHWAY DIVISION FRANJO ROAD FROM OLD CUTLER RD TO SW 184TH STREET

PROJECT NO. **215615952** SHEET **E-17** OF **19**

Circuit Iumber	Source	Servicing	Feeder Voltage (V)	Power Factor	Segment Length (ft)	Wire Size (AWG or kcmil)	Conducto r Material	Conduit Material	Parallel Sets	Load (VA)	Total Load (VA)	Total Amperage (A)	Conductor Impedance ZC (Ω/1000ft)	Segment Voltage Drop (V)	Tota Volta Drop (%)
	Utility XFMR	LC-A	240/480V, 1Ø	0.9	50	3	Cu	PVC	1	50	8788	18.31	0.2455	0.45	0.09%
1	LC-A	POLE 39	480V, 1Ø	0.9	139	6	Cu	PVC	1	156	3049	6.35	0.4632	0.82	0.26%
	POLE 39	POLE 40	480V, 1Ø	0.9	108	6	Cu	PVC	1	156	2893	6.03	0.4632	0.60	0.399
	POLE 40	POLE 42	480V, 1Ø	0.9	184	6	Cu	PVC	1	92	2737	5.70	0.4632	0.97	0.599
	POLE 42	POLE 44	480V, 1Ø	0.9	211	6	Cu	PVC	1	92	2645	5.51	0.4632	1.08	0.82
	POLE 44	POLE 46	480V, 1Ø	0.9	200	6	Cu	PVC	1	92	2553	5.32	0.4632	0.99	1.029
	POLE 46	POLE 48	480V, 1Ø	0.9	195	6	Cu	PVC	1	92	2461	5.13	0.4632	0.93	1.21
	POLE 48	POLE 50	480V, 1Ø	0.9	208	6	Cu	PVC	1	92	2369	4.93	0.4632	0.95	1.41
	POLE 50	POLE 52	480V, 1Ø	0.9	200	6	Cu	PVC	1	92	2276	4.74	0.4632	0.88	1.60
	POLE 52	POLE 55	480V, 1Ø	0.9	305	6	Cu	PVC	1	92	2184	4.55	0.4632	1.29	1.86
	POLE 55	POLE 57	480V, 1Ø	0.9	207	6	Cu	PVC	1	92	2092	4.36	0.4632	0.84	2.04
	POLE 57	POLE 59	480V, 1Ø	0.9	190	6	Cu	PVC	1	92	2000	4.17	0.4632	0.73	2.19
	POLE 59	POLE 61	480V, 1Ø	0.9	190	6	Cu	PVC	1	92	1907	3.97	0.4632	0.70	2.34
	POLE 61	POLE 63	480V, 1Ø	0.9	221	6	Cu	PVC	1	92	1815	3.78	0.4632	0.77	2.50
	POLE 63	POLE 65	480V, 1Ø	0.9	194	6	Cu	PVC	1	92	1723	3.59	0.4632	0.65	2.63
	POLE 65	POLE 67	480V, 1Ø	0.9	149	6	Cu	PVC	1	92	1631	3.40	0.4632	0.47	2.73
	POLE 67	POLE 70	480V, 1Ø	0.9	86	6	Cu	PVC	1	92	1539	3.21	0.4632	0.26	2.78
	POLE 70	POLE 73	480V, 1Ø	0.9	170	6	Cu	PVC	1	92	1446	3.01	0.4632	0.47	2.88
	POLE 73	POLE 76	480V, 1Ø	0.9	270	6	Cu	PVC	1	92	1354	2.82	0.4632	0.71	3.03
	POLE 76	POLE 77	480V, 1Ø	0.9	110	6	Cu	PVC	1	92	1262	2.63	0.4632	0.27	3.08
	POLE 77	POLE 78	480V, 1Ø	0.9	100	6	Cu	PVC	1	92	1170	2.44	0.4632	0.23	3.13
	POLE 78	POLE 79	480V, 1Ø	0.9	120	6	Cu	PVC	1	92	1077	2.24	0.4632	0.25	3.18
	POLE 79	POLE 80	480V, 1Ø	0.9	113	6	Cu	PVC	1	92	985	2.05	0.4632	0.21	3.2
	POLE 80	POLE 81	480V, 1Ø	0.9	89	6	Cu	PVC	1	92	893	1.86	0.4632	0.15	3.2
	POLE 81	POLE 82	480V, 1Ø	0.9	120	6	Cu	PVC	1	92	801	1.67	0.4632	0.19	3.30
	POLE 82	POLE 83	480V, 1Ø	0.9	109	6	Cu	PVC	1	92	709	1.48	0.4632	0.15	3.33
	POLE 83	POLE 84	480V, 1Ø	0.9	93	6	Cu	PVC	1	92	616	1.28	0.4632	0.11	3.35
	POLE 84	POLE 85	480V, 1Ø	0.9	97	6	Cu	PVC	1	92	524	1.09	0.4632	0.10	3.3
	POLE 85	POLE 86	480V, 1Ø	0.9	104	6	Cu	PVC	1	92	432	0.90	0.4632	0.09	3.3
	POLE 86	POLE 87	480V, 1Ø	0.9	67	6	Cu	PVC	1	63	340	0.71	0.4632	0.04	3.40
	POLE 87	POLE 90	480V, 1Ø	0.9	135	6	Cu	PVC	1	92	277	0.58	0.4632	0.07	3.4
	POLE 90	POLE 92	480V, 1Ø	0.9	210	6	Cu	PVC	1	92	184	0.38	0.4632	0.07	3.4
	POLE 92	POLE 94	480V, 1Ø	0.9	221	6	Cu	PVC	1	92	92	0.19	0.4632	0.04	3.4
2	LC-A	POLE 38	480V, 1Ø	0.9	72	6	Cu	PVC	1	92	1752	3.65	0.4632	0.24	0.1
	POLE 38	POLE 36	480V, 1Ø	0.9	208	6	Cu	PVC	1	92	1660	3.46	0.4632	0.67	0.2
	POLE 36	POLE 34	480V, 1Ø	0.9	199	6	Cu	PVC	1	92	1568	3.27	0.4632	0.60	0.4
	POLE 34	POLE 32	480V, 1Ø	0.9	230	6	Cu	PVC	1	92	1476	3.07	0.4632	0.66	0.5
	POLE 32	POLE 30	480V, 1Ø	0.9	218	6	Cu	PVC	1	92	1383	2.88	0.4632	0.58	0.6
	POLE 30	POLE 28	480V, 1Ø	0.9	190	6	Cu	PVC	1	92	1291	2.69	0.4632	0.47	0.7
	POLE 28	POLE 26	480V, 1Ø	0.9	211	6	Cu	PVC	1	92	1199	2.50	0.4632	0.49	0.8
	POLE 26	POLE 24	480V, 1Ø	0.9	215	6	Cu	PVC	1	92	1107	2.31	0.4632	0.46	0.9
	POLE 24	POLE 22	480V, 1Ø	0.9	201	6	Cu	PVC	1	92	1014	2.11	0.4632	0.39	1.04
	POLE 22	POLE 20	480V, 1Ø	0.9	221	6	Cu	PVC	1	92	922	1.92	0.4632	0.39	1.13
	POLE 20	POLE 18	480V, 1Ø	0.9	201	6	Cu	PVC	1	92	830	1.73	0.4632	0.32	1.19
	POLE 18	POLE 17	480V, 1Ø	0.9	85	6	Cu	PVC	1	92	738	1.54	0.4632	0.12	1.2
	POLE 17	POLE 16	480V, 1Ø	0.9	105	6	Cu	PVC	1	92	646	1.34	0.4632	0.13	1.2
	POLE 16	POLE 14	480V, 1Ø	0.9	62	6	Cu	PVC	1	92	553	1.15	0.4632	0.07	1.20
	POLE 14	POLE 12	480V, 1Ø	0.9	70	6	Cu	PVC	1	92	461	0.96	0.4632	0.06	1.2
	POLE 12	POLE 10	480V, 1Ø	0.9	117	6	Cu	PVC	1	92	369	0.77	0.4632	0.08	1.29
	POLE 10	POLE 8	480V, 1Ø	0.9	187	6	Cu	PVC	1	92	277	0.58	0.4632	0.10	1.3
	POLE 8	POLE 6	480V, 1Ø	0.9	209	6	Cu	PVC	1	92	184	0.38	0.4632	0.07	1.33
	POLE 8	POLE 4	480V, 1Ø	0.9	167	6	Cu	PVC	1	92	92	0.19	0.4632	0.07	1.3


BY: LINZER, FRANCINE DATE: 12/12/2022 2:46 PM : 2022-10-07 - \\US0231-PPFSS01\WORKGROUP\2156\ACTIVE\215615952\ELECTRICAL\DRAWIN

REVISIONS

E BY DESCRIPTION DATE BY DESCRIPTION DATE BY DESCRIPTION



	The Contractor shall verify and be
	responsible for all dimensions. DO NOT
t	scale the drawing - any errors or omissions
•	shall be reported to Stantec without delay.
	The Copyrights to all designs and drawings
	are the property of Stantec. Reproduction
	or use for any purpose other than that
	authorized by Stantec is forbidden.





DEPARTMENT OF TRANSPORTATION

AND PUBLIC WORKS

HIGHWAY DIVISION

STEPHEN P. CLARK CENTER

111 NW 1 ST

MIAMI, FLORIDA 33128

VOLTAGE DROP CALCULATIONS 1

MIAMI-DADE COUNTY PUBLIC WORKS DEPT. HIGHWAY DIVISION FRANJO ROAD FROM OLD CUTLER RD TO SW 184TH STREET SHEET **E-18** OF **19**


PROJECT NO. 215615952

Circuit Number	Source	Servicing	Feeder Voltage (V)	Power Factor	Segment Length (ft)	Wire Size (AWG or kcmil)	Conducto r Material	Conduit Material	Parallel Sets	Load (VA)	Total Load (VA)	Total Amperage (A)	Conductor Impedance ZC (Ω/1000ft)	Segment Voltage Drop (V)	Total Voltage Drop (%)
3	LC-A	POLE 37	480V, 1Ø	0.9	229	6	Cu	PVC	1	92	1752	3.65	0.4632	0.77	0.25%
	POLE 37	POLE 35	480V, 1Ø	0.9	220	6	Cu	PVC	1	92	1660	3.46	0.4632	0.70	0.40%
	POLE 35	POLE 33	480V, 1Ø	0.9	220	6	Cu	PVC	1	92	1568	3.27	0.4632	0.67	0.54%
	POLE 33	POLE 31	480V, 1Ø	0.9	228	6	Cu	PVC	1	92	1476	3.07	0.4632	0.65	0.68%
	POLE 31	POLE 29	480V, 1Ø	0.9	189	6	Cu	PVC	1	92	1383	2.88	0.4632	0.50	0.78%
	POLE 29	POLE 27	480V, 1Ø	0.9	201	6	Cu	PVC	1	92	1291	2.69	0.4632	0.50	0.89%
	POLE 27	POLE 25	480V, 1Ø	0.9	220	6	Cu	PVC	1	92	1199	2.50	0.4632	0.51	0.99%
	POLE 25	POLE 23	480V, 1Ø	0.9	215	6	Cu	PVC	1	92	1107	2.31	0.4632	0.46	1.09%
	POLE 23	POLE 21	480V, 1Ø	0.9	200	6	Cu	PVC	1	92	1014	2.11	0.4632	0.39	1.17%
	POLE 21	POLE 19	480V, 1Ø	0.9	195	6	Cu	PVC	1	92	922	1.92	0.4632	0.35	1.24%
	POLE 19	POLE 15	480V, 1Ø	0.9	276	6	Cu	PVC	1	92	830	1.73	0.4632	0.44	1.33%
	POLE 15	POLE 13	480V, 1Ø	0.9	95	6	Cu	PVC	1	92	738	1.54	0.4632	0.14	1.36%
	POLE 13	POLE 11	480V, 1Ø	0.9	143	6	Cu	PVC	1	92	646	1.34	0.4632	0.18	1.40%
	POLE 11	POLE 9	480V, 1Ø	0.9	158	6	Cu	PVC	1	92	553	1.15	0.4632	0.17	1.43%
	POLE 9	POLE 7	480V, 1Ø	0.9	193	6	Cu	PVC	1	92	461	0.96	0.4632	0.17	1.47%
	POLE 7	POLE 5	480V, 1Ø	0.9	196	6	Cu	PVC	1	92	369	0.77	0.4632	0.14	1.50%
	POLE 5	POLE 3	480V, 1Ø	0.9	181	6	Cu	PVC	1	92	277	0.58	0.4632	0.10	1.52%
	POLE 3	POLE 2	480V, 1Ø	0.9	108	6	Cu	PVC	1	92	184	0.38	0.4632	0.04	1.53%
	POLE 2	POLE 1	480V, 1Ø	0.9	113	6	Cu	PVC	1	92	92	0.19	0.4632	0.02	1.53%
4	LC-A	POLE 41	480V, 1Ø	0.9	278	6	Cu	PVC	1	92	2184	4.55	0.4632	1.17	0.34%
	POLE 41	POLE 43	480V, 1Ø	0.9	187	6	Cu	PVC	1	92	2092	4.36	0.4632	0.76	0.50%
	POLE 43	POLE 45	480V, 1Ø	0.9	224	6	Cu	PVC	1	92	2000	4.17	0.4632	0.86	0.68%
	POLE 45	POLE 47	480V, 1Ø	0.9	185	6	Cu	PVC	1	92	1907	3.97	0.4632	0.68	0.82%
	POLE 47	POLE 49	480V, 1Ø	0.9	199	6	Cu	PVC	1	92	1815	3.78	0.4632	0.70	0.96%
	POLE 49	POLE 51	480V, 1Ø	0.9	204	6	Cu	PVC	1	92	1723	3.59	0.4632	0.68	1.10%
	POLE 51	POLE 53	480V, 1Ø	0.9	180	6	Cu	PVC	1	92	1631	3.40	0.4632	0.57	1.22%
	POLE 53	POLE 54	480V, 1Ø	0.9	132	6	Cu	PVC	1	92	1539	3.21	0.4632	0.39	1.30%
	POLE 54	POLE 56	480V, 1Ø	0.9	200	6	Cu	PVC	1	92	1446	3.01	0.4632	0.56	1.42%
	POLE 56	POLE 58	480V, 1Ø	0.9	186	6	Cu	PVC	1	92	1354	2.82	0.4632	0.49	1.52%
	POLE 58	POLE 60	480V, 1Ø	0.9	200	6	Cu	PVC	1	92	1262	2.63	0.4632	0.49	1.62%
	POLE 60	POLE 62	480V, 1Ø	0.9	214	6	Cu	PVC	1	92	1170	2.44	0.4632	0.48	1.72%
	POLE 62	POLE 64	480V, 1Ø	0.9	197	6	Cu	PVC	1	92	1077	2.24	0.4632	0.41	1.81%
	POLE 64	POLE 66	480V, 1Ø	0.9	203	6	Cu	PVC	1	92	985	2.05	0.4632	0.39	1.89%
	POLE 66	POLE 68	480V, 1Ø	0.9	95	6	Cu	PVC	1	92	893	1.86	0.4632	0.16	1.92%
	POLE 68	POLE 69	480V, 1Ø	0.9	49	6	Cu	PVC	1	92	801	1.67	0.4632	0.08	1.94%
	POLE 69	POLE 71	480V, 1Ø	0.9	112	6	Cu	PVC	1	92	709	1.48	0.4632	0.15	1.97%
	POLE 71	POLE 72	480V, 1Ø	0.9	64	6	Cu	PVC	1	92	616	1.28	0.4632	0.08	1.99%
	POLE 72	POLE 74	480V, 1Ø	0.9	183	6	Cu	PVC	1	92	524	1.09	0.4632	0.19	2.03%
	POLE 74	POLE 75	480V, 1Ø	0.9	90	6	Cu	PVC	1	92	432	0.90	0.4632	0.08	2.04%
	POLE 75	POLE 88	480V, 1Ø	0.9	1251	6	Cu	PVC	1	63	340	0.71	0.4632	0.82	2.21%
	POLE 88	POLE 89	480V, 1Ø	0.9	32	6	Cu	PVC	1	92	277	0.58	0.4632	0.02	2.22%
	POLE 89	POLE 91	480V, 1Ø	0.9	172	6	Cu	PVC	1	92	184	0.38	0.4632	0.02	2.23%
	POLE 91	POLE 93	480V, 1Ø	0.9	212	6	Cu	PVC	1	92	92	0.19	0.4632	0.04	2.24%
	PULE 91	PULE 93	48UV, 1Ø	0.9	212	ь	Cu	PVC	1	92	92	0.19	0.4632	0.04	

R E V I S I O N S DESCRIPTION DESCRIPTION DATE BY DATE BY DESCRIPTION

Stantec	
901 Ponce de Leon Blvd. Suite 900	
Coral Gables, Florida 33134	
www.stantec.com	


	dimensions. DO NOT	
shall be reported	g - any errors or omissions to Stantec without delay.	l
are the property	all designs and drawings of Stantec. Reproduction pose other than that	L
	ntec is forbidden.	





DEPARTMENT OF TRANSPORTATION
AND PUBLIC WORKS
HIGHWAY DIVISION
STEPHEN P. CLARK CENTER
111 NW 1 ST
MIAMI, FLORIDA 33128

MIAMI-DADE COUNTY PUBLIC WORKS DEPT. HIGHWAY DIVISION FRANJO ROAD FROM OLD CUTLER RD TO SW 184TH STREET SHEET **E-19** OF **19** PROJECT NO. **215615952**

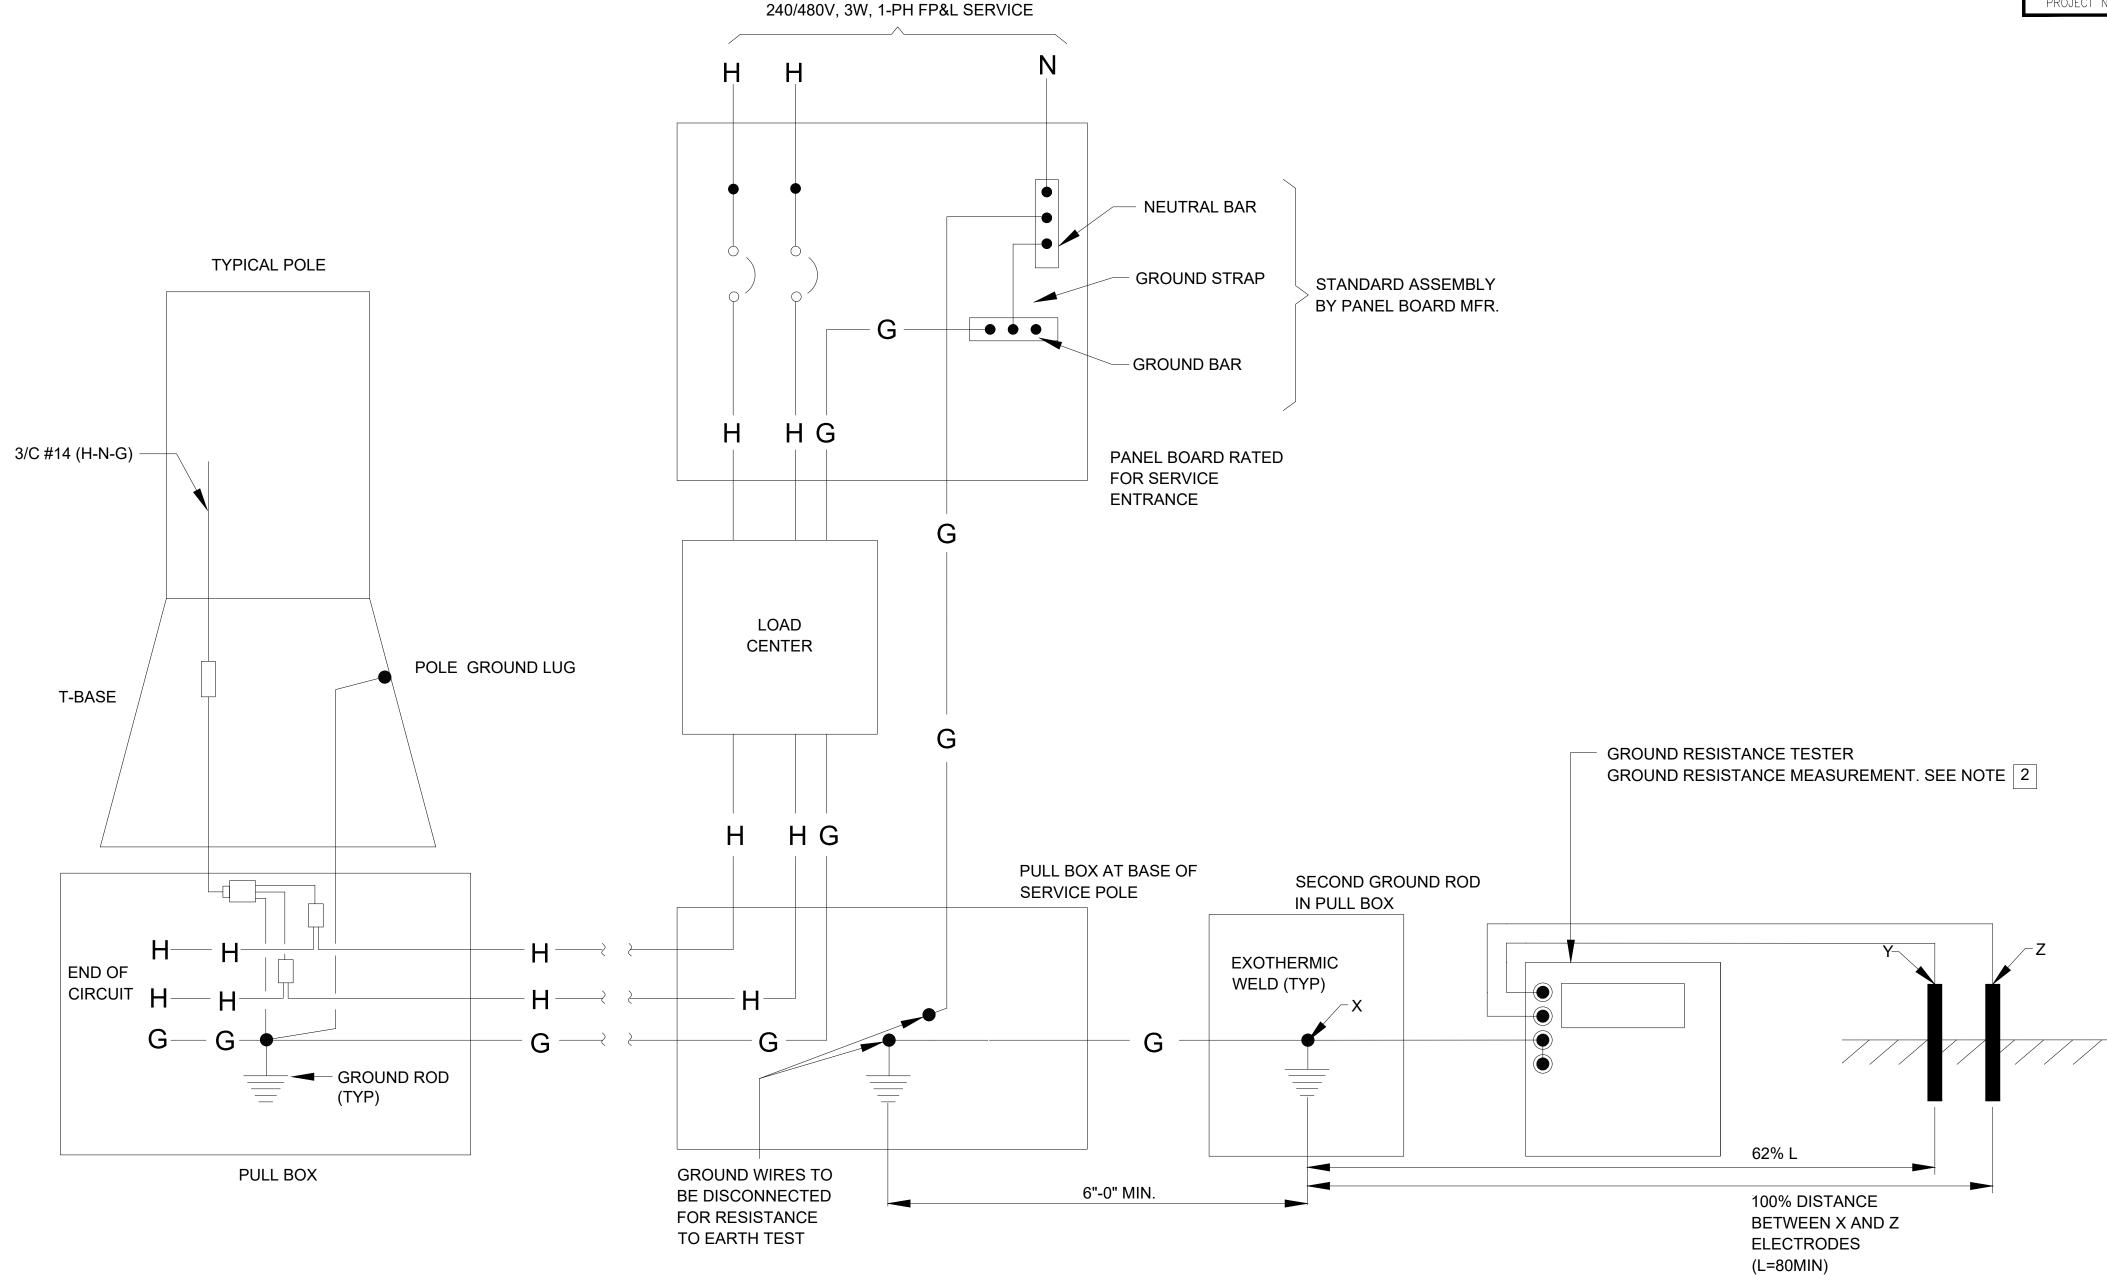


RESISTANCE TO EARTH (FALL OF POTENTIAL TEST (62% METHOD)) & CONTINUITY TESTS SCHEMATIC

GROUND TEST NOTES

- THE INTENTION OF THIS TEST IS TO DETERMINE THE RESISTANCE TO EARTH OF THE SERVICE POINT. THIS IS MORE ACCURATE THAN THE "CLAMP-ON" METHOD AND THEREFORE IT IS THE METHOD THAT SHALL BE USED UNLESS THERE IS A LACK OF SUFFICIENT REAL ESTATE.
- 2 USE GROUND RESISTANCE TESTER, AEMC MODEL 4620, 4630 OR APPROVED EQUAL, CALIBRATED WITHIN THE PAST 180 DAYS. RESISTANCE-TO-GROUND MEASUREMENT ABOVE 25 OHMS SHALL BE CONSIDERED INADEQUATE.
- 3 ELECTRICAL CONTRACTOR SHALL SUBMIT CERTIFICATION LETTER CONFIRMING 1,2 & 3 INCLUDING READING, CALCULATION AND RESULTS.

				R	EVISIONS				
=	BY	DESCRIPTION	DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION	-($lacktriangle$) Stante
									901 Ponce de Leon Blvd. S
									Coral Gables, Florida 3313 www.stantec.com


tec n Blvd. Suite 900 ida 33134	responsible for a scale the drawir shall be reported. The Copyrights the are the property or use for any put authorized by St
---------------------------------------	--




NAME

BB






MIAMI-DADE COUNTY PUBLIC WORKS DEPT.
HIGHWAY DIVISION
FRANJO ROAD
FROM OLD CUTLER RD TO SW 184TH STREET
PROJECT NO. 215615952
SHEET S-01 OF 2

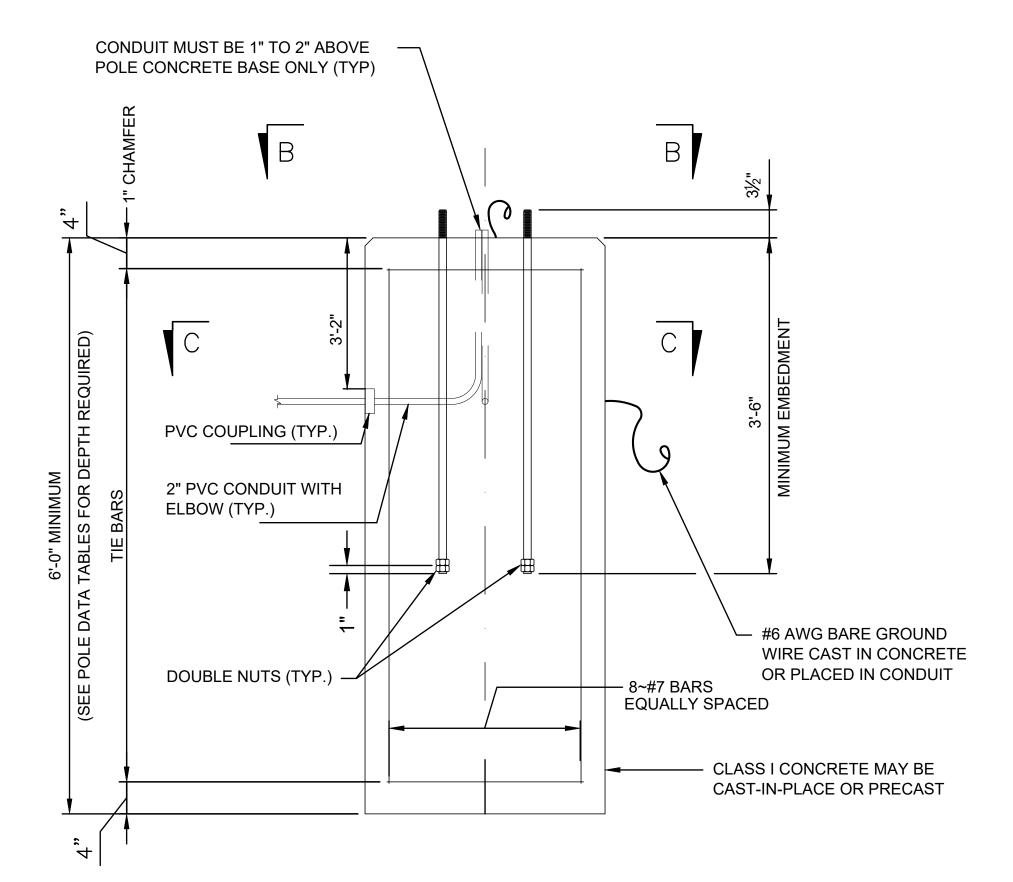



DRILLED SHAFT FOUNDATION DETAILS

#4 TIE BARS @ 12" CENTERS (MAX.) OR D10 (OR W10) SPIRAL @ 6" PITCH, 3 FLAT TURNS TOP AND 1 FLAT TURN BOTTOM.

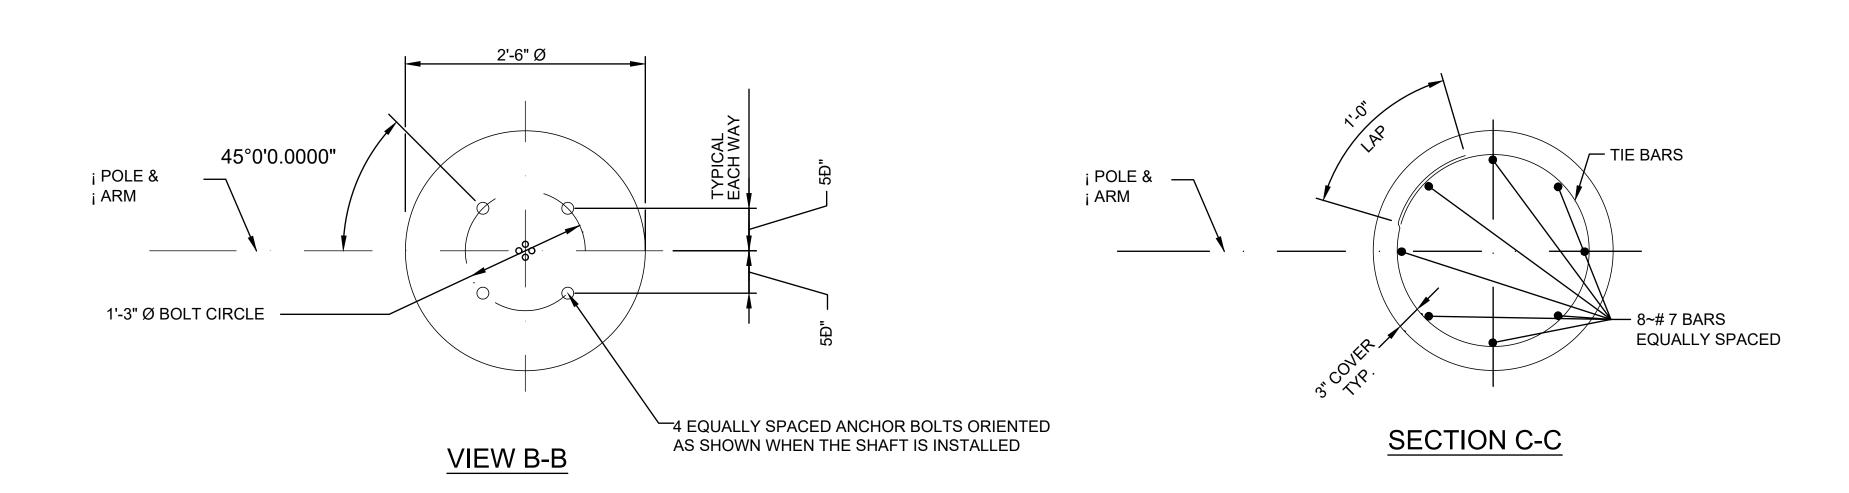

FOUNDATION TABLE W/ARM									
WIND SPEED (MPH)	DESIGN MOUNTING HEIGHT (FT)	TOTAL DEPTH (FT)							
160	15	*							
160	40	*							

*THE CONTRACTOR SHALL SUBMIT SHOP DRAWINGS, WITH DETAILS AND CALCULATIONS SIGNED AND SEALED BY A STRUCTURAL ENGINEER REGISTERED IN THE STATE OF FLORIDA. THE LIGHT POLES AND FOUNDATIONS SHALL MEET FLORIDA BUILDING CODE REQUIREMENTS AND THE WIND LOAD REQUIREMENTS PROVIDED HEREIN.

REVISIONS

DATE BY DESCRIPTION DATE BY DESCRIPTION

OUTDITION

DATE DESCRIPTION

DATE DESCRIPTION

DATE DESCRIPTION

DESCRIPTION

DESCRIPTION

DESCRIPTION

Stantec
901 Ponce de Leon Blvd. Suite 900
Coral Gables, Florida 33134
www.stantec.com

The Contractor shall verify and be responsible for all dimensions. DO NOT scale the drawing - any errors or omissions shall be reported to Stantec without delay. The Copyrights to all designs and drawings are the property of Stantec. Reproduction or use for any purpose other than that authorized by Stantec is forbidden.

NAME DATE

NAME DATE

NAME

DESIGNED
BY
BY

CHECKED
BY


SUPERVISED BY:


MIAMI-DADE COUNTY


DEPARTMENT OF TRANSPORTATION
AND PUBLIC WORKS
HIGHWAY DIVISION


STEPHEN P. CLARK CENTER
111 NW 1 ST
MIAMI, FLORIDA 33128


FOUNDATION DETAIL

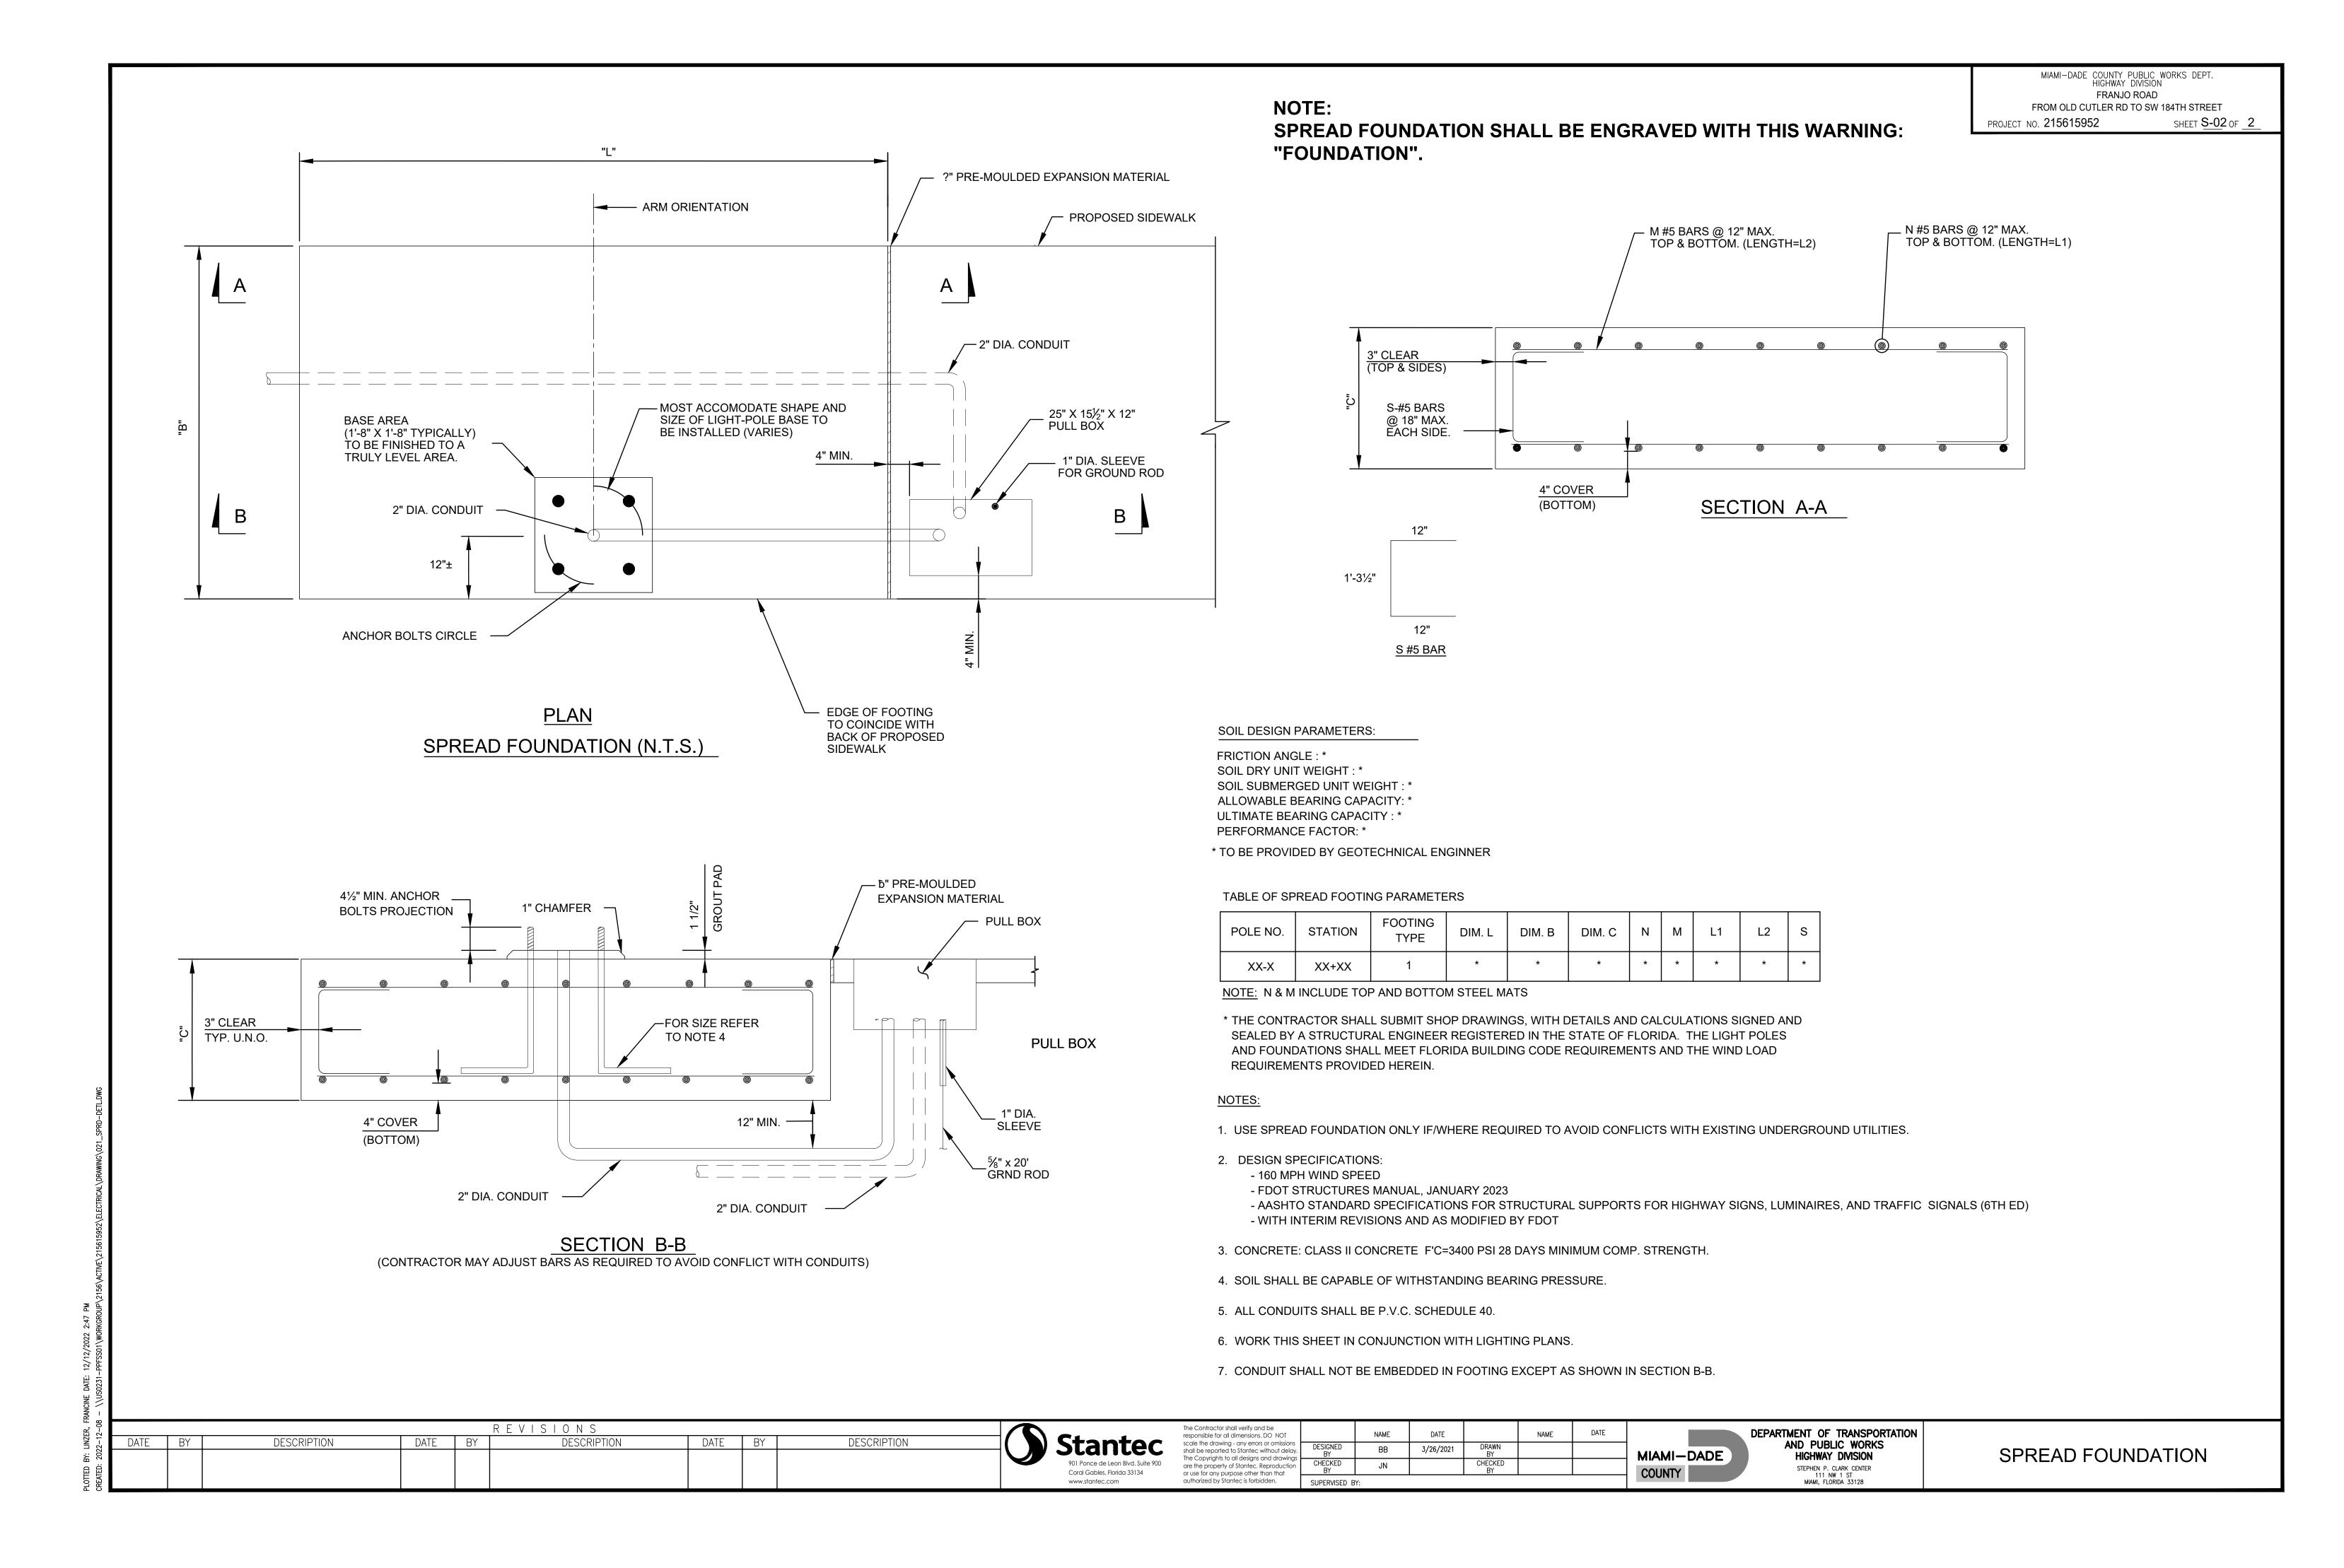


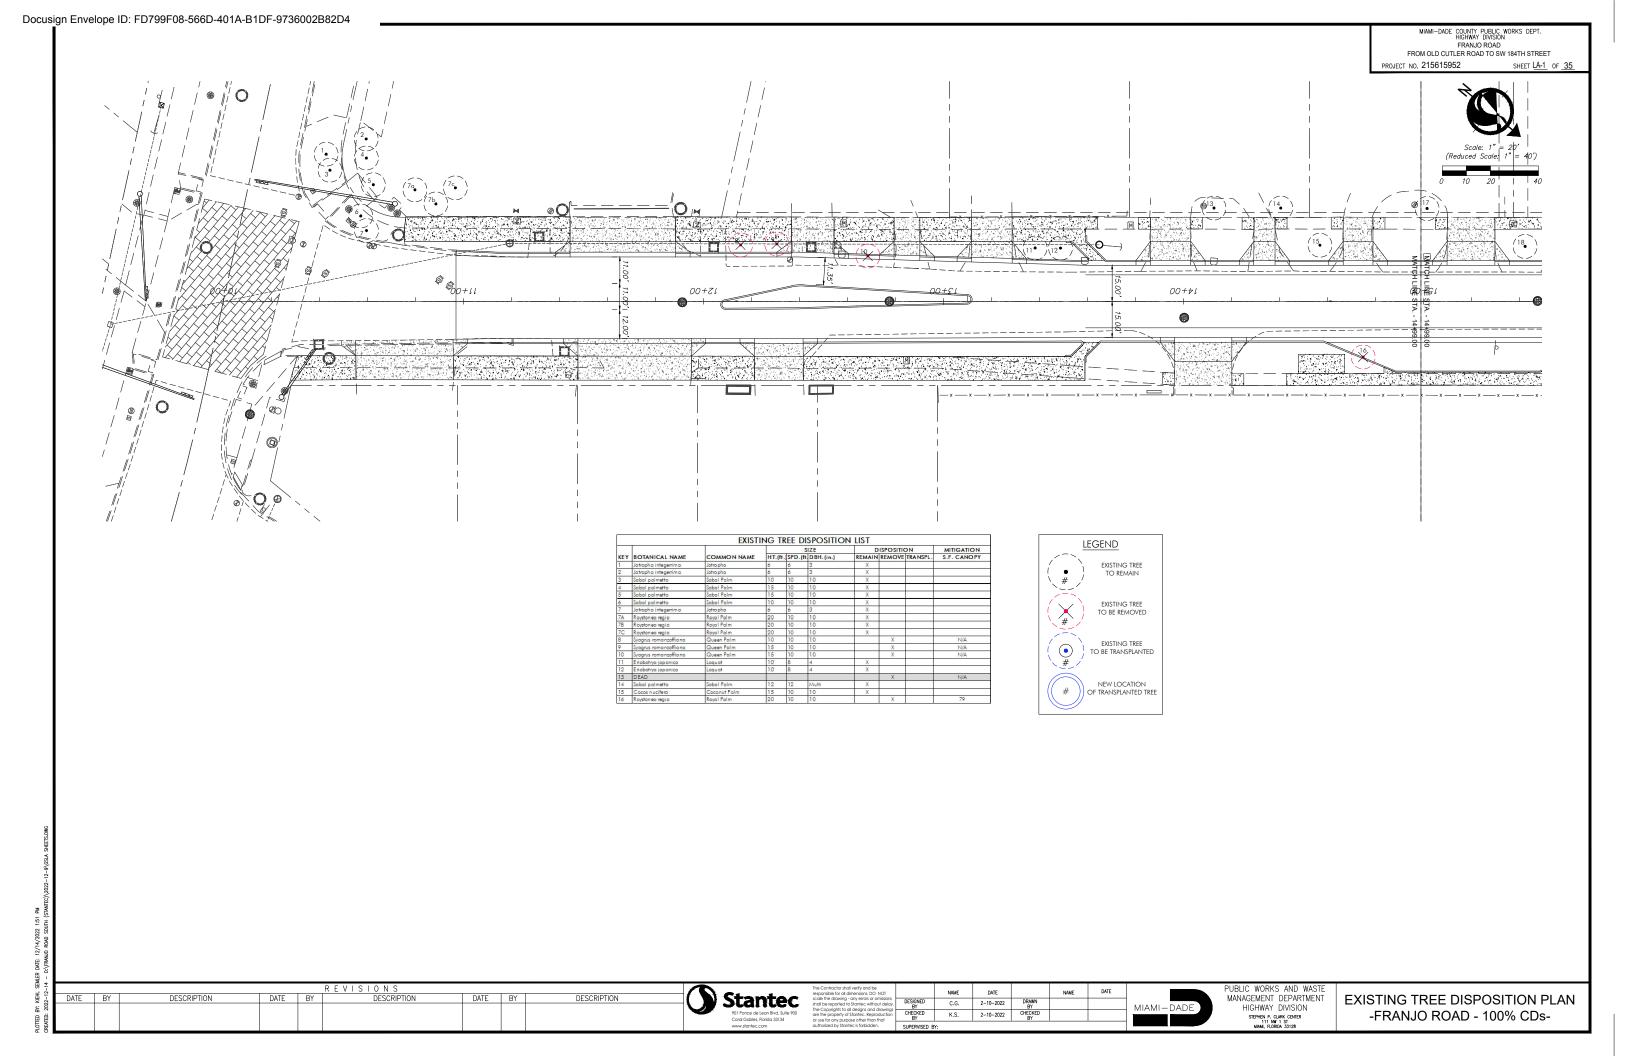


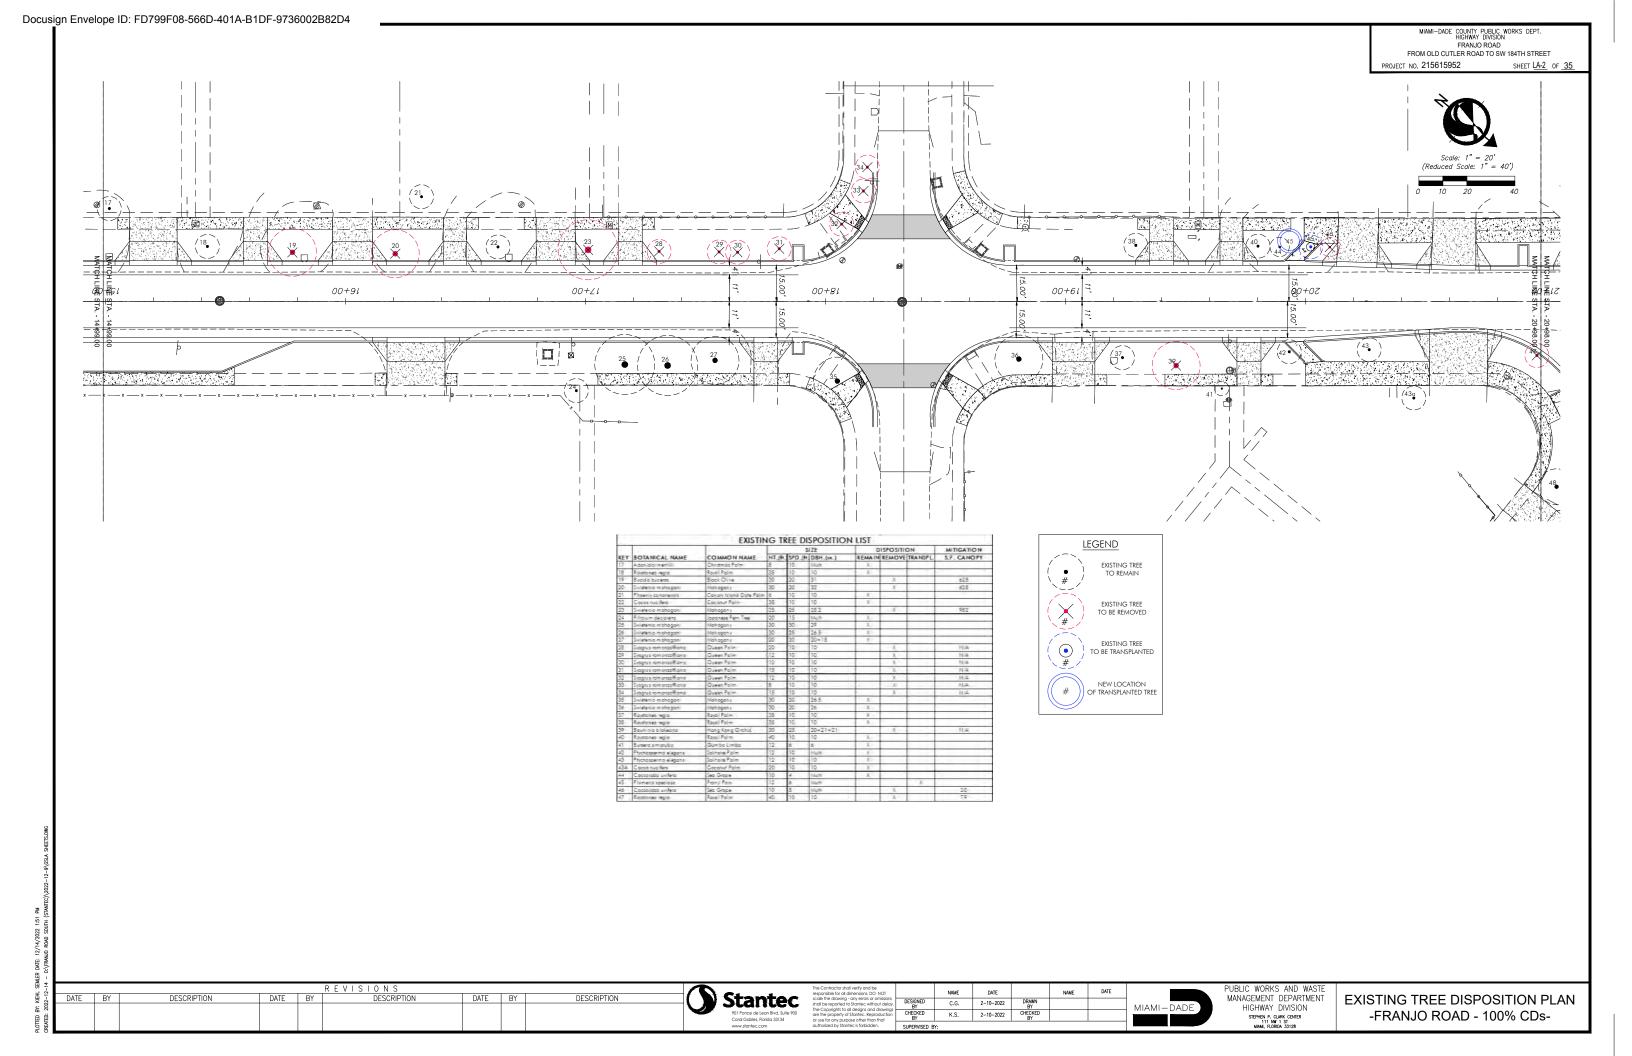


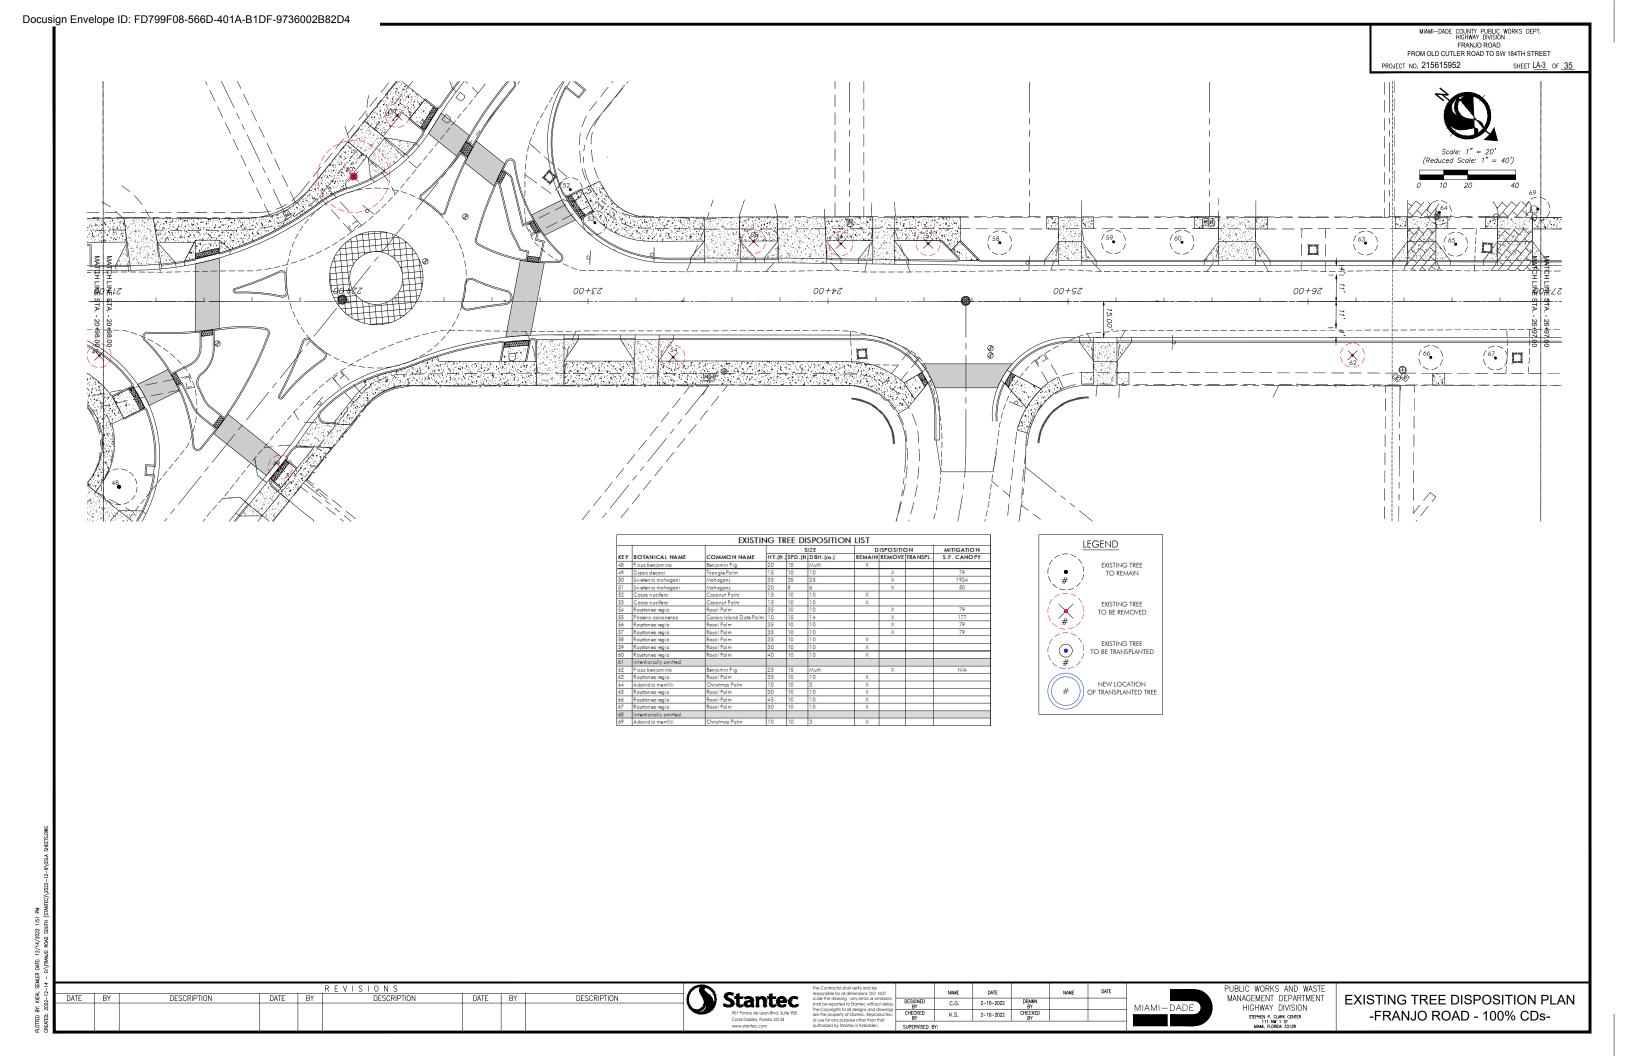


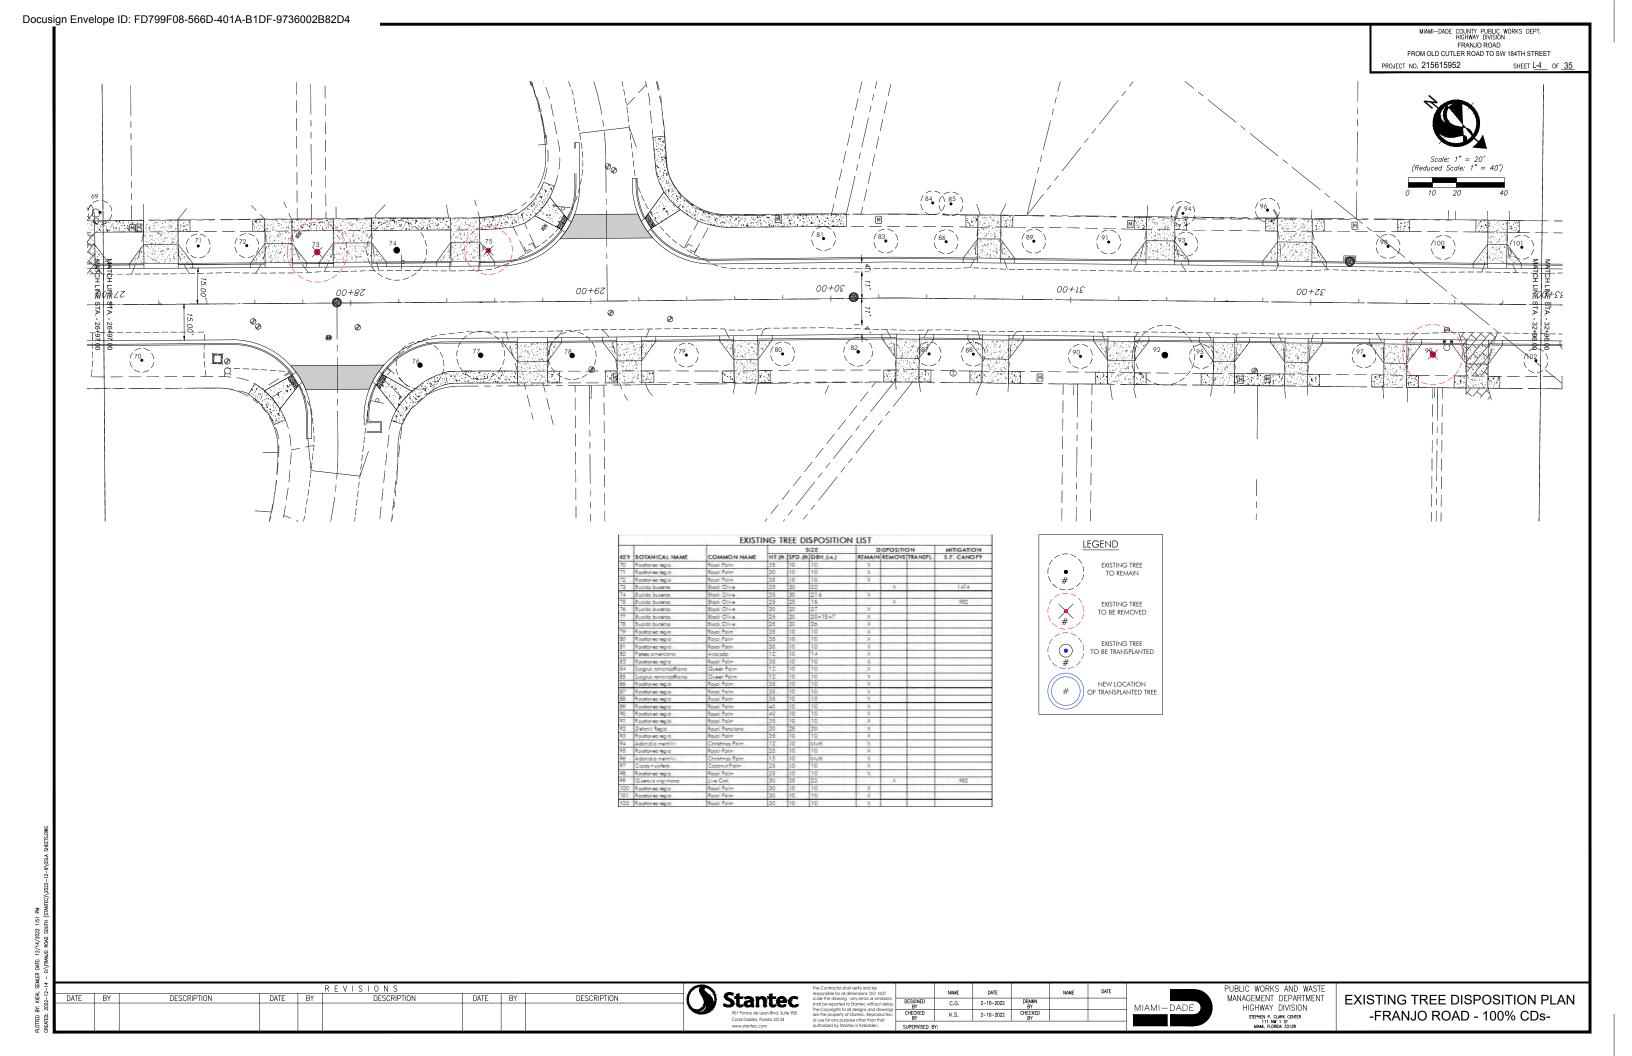


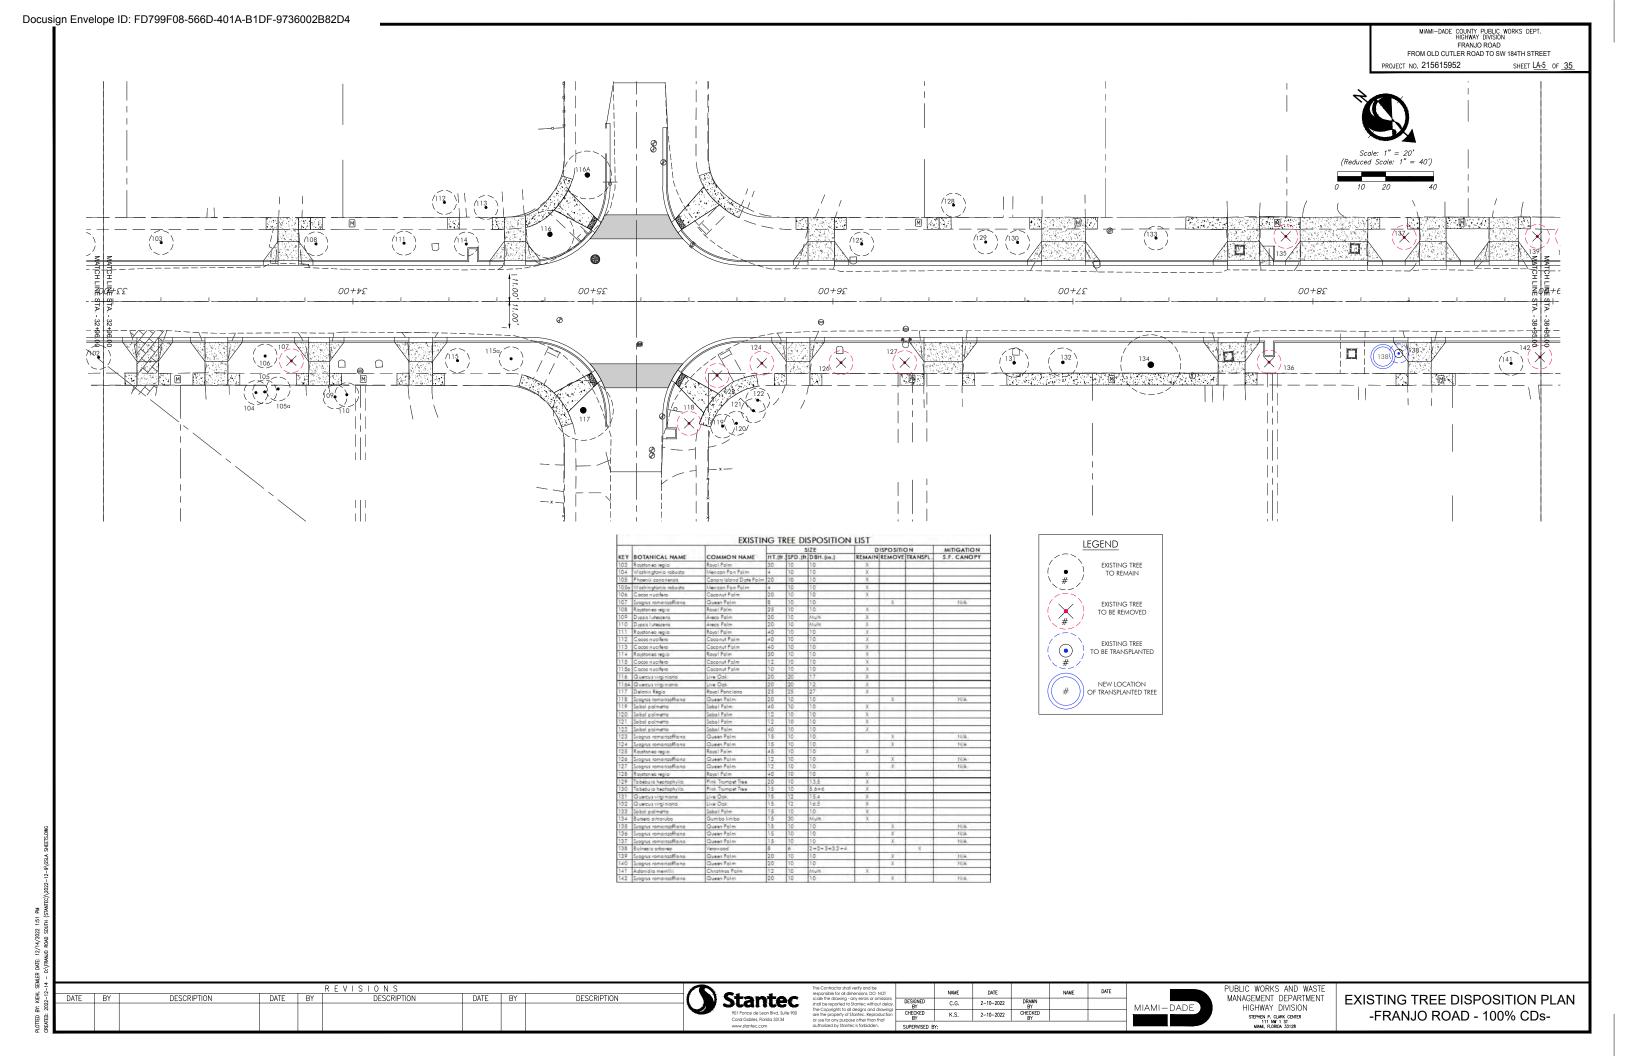


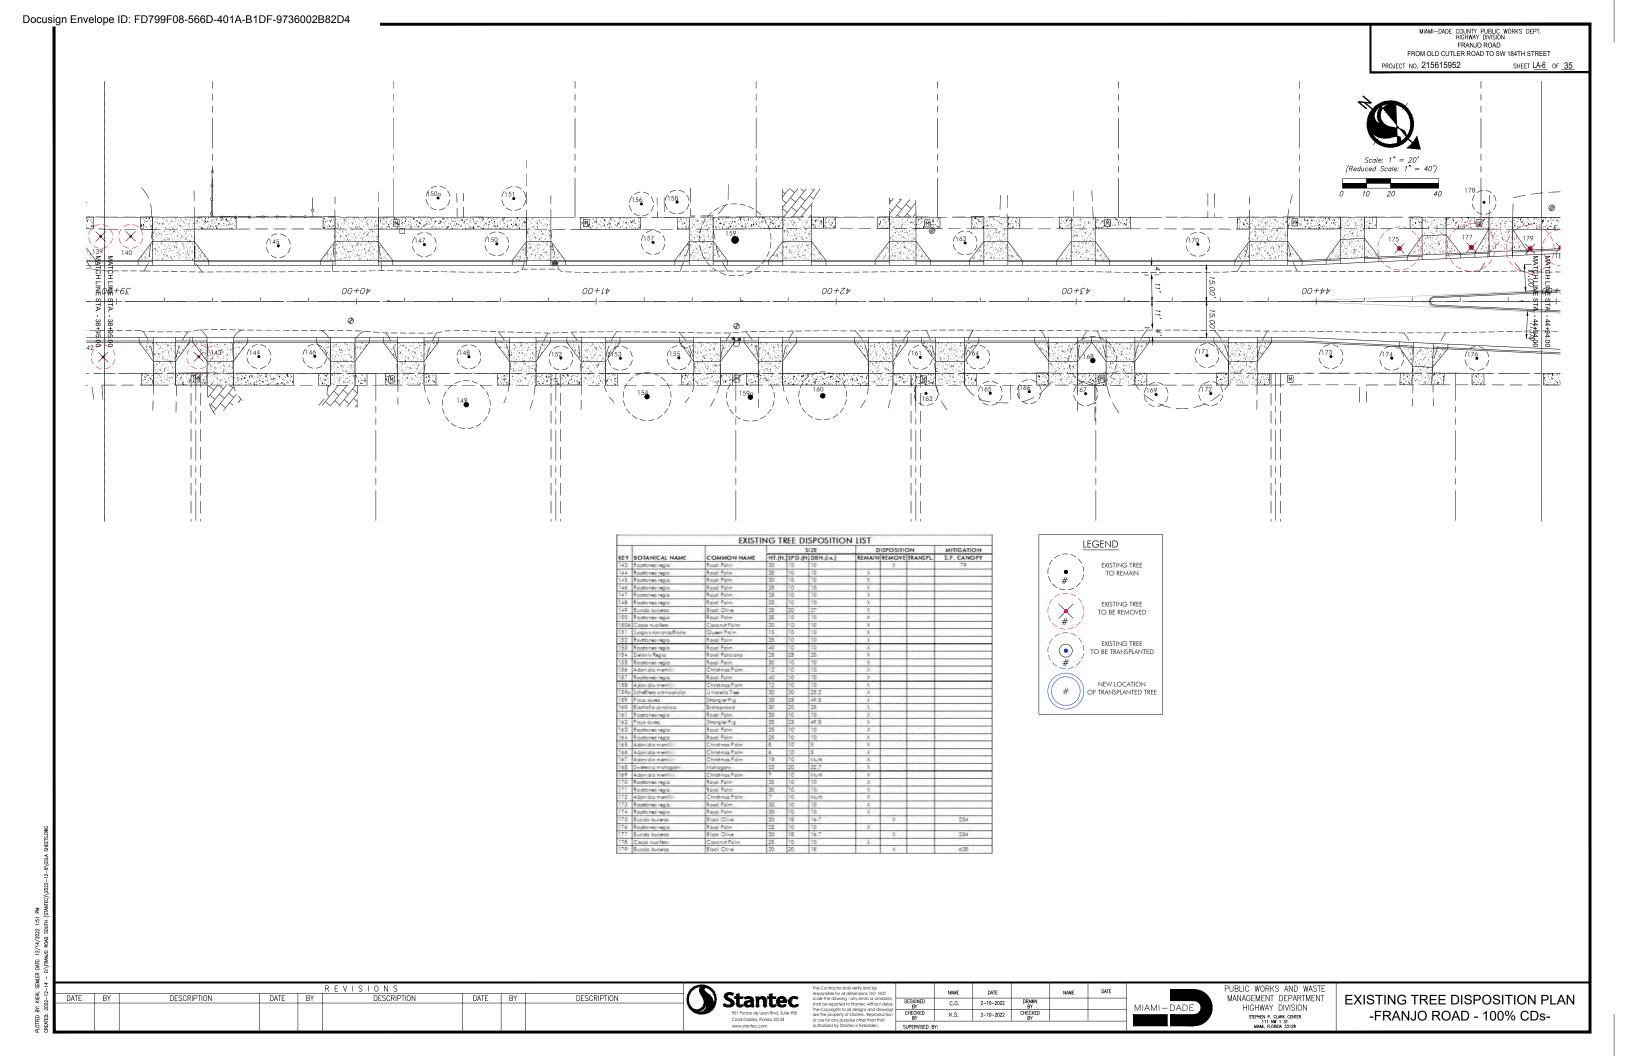


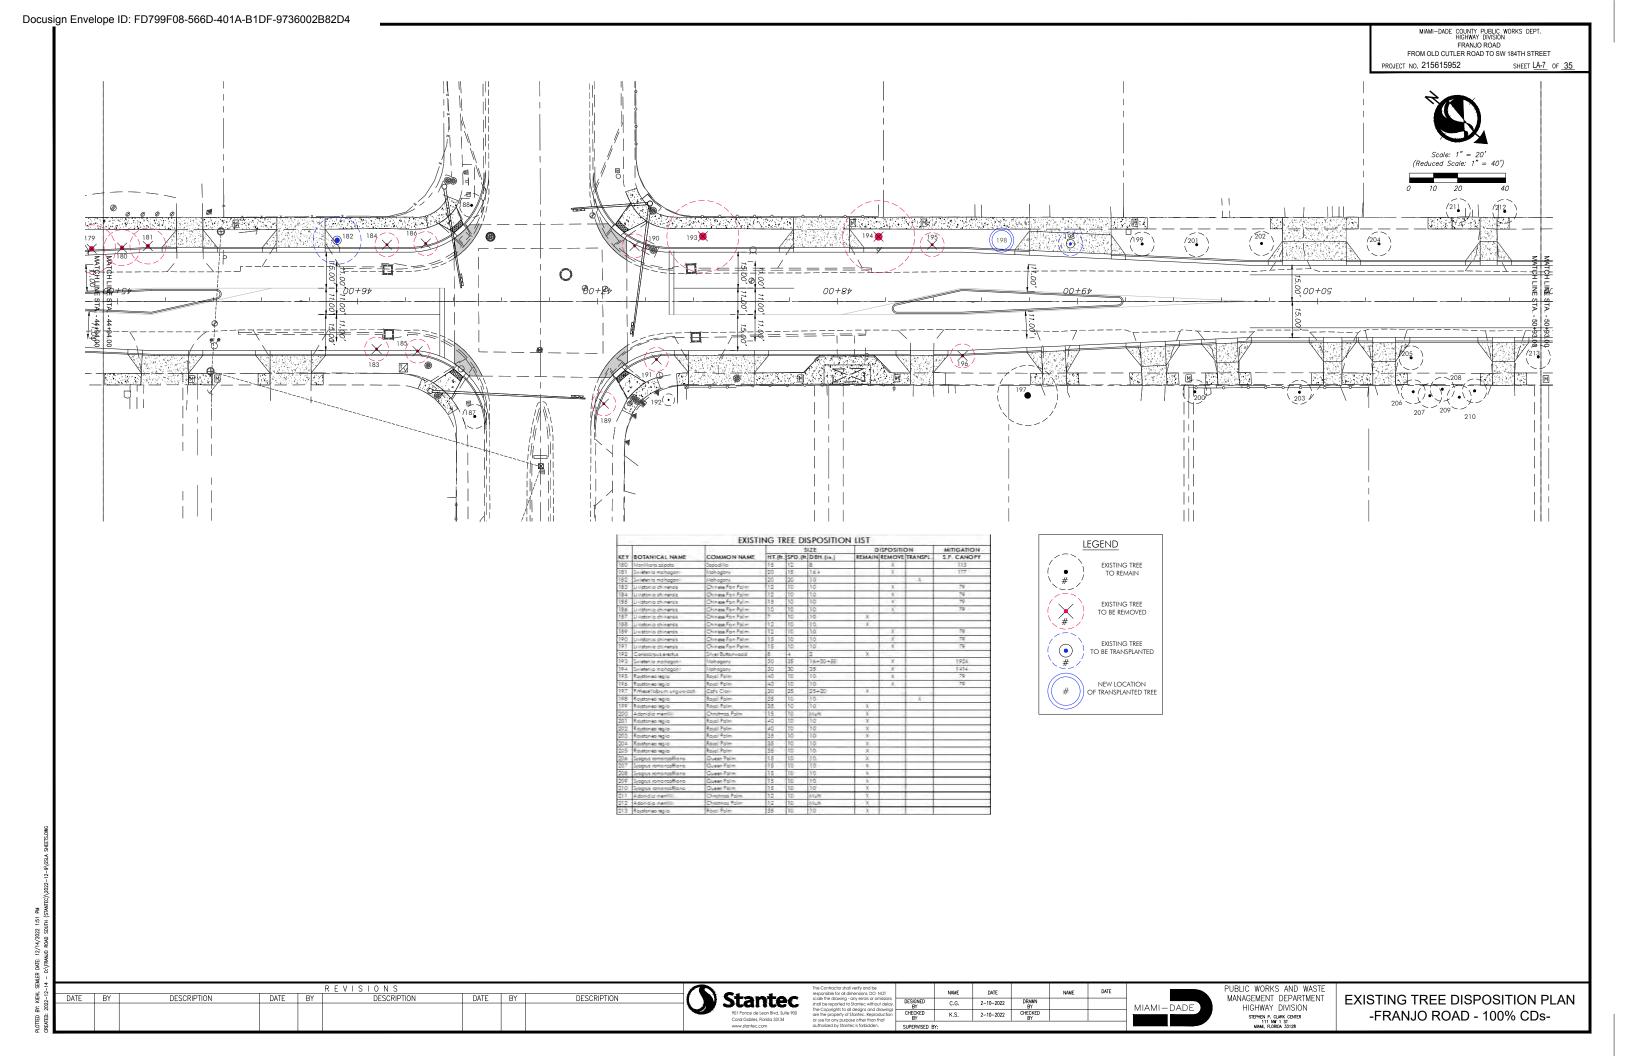


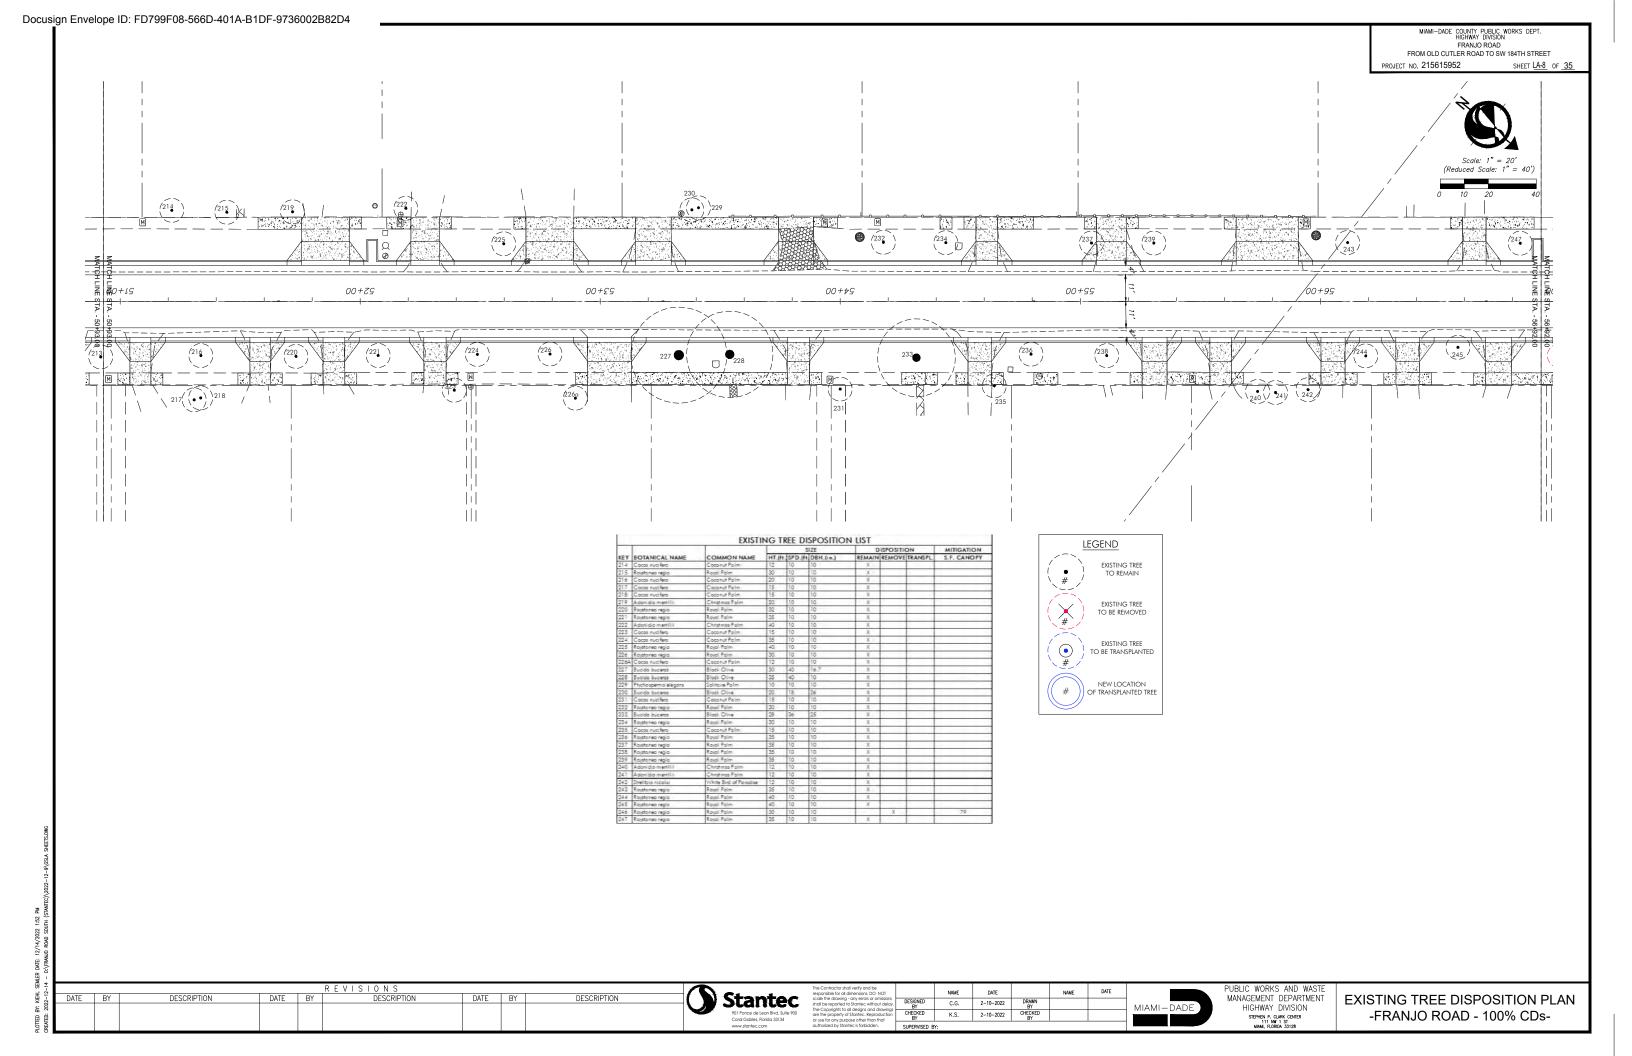


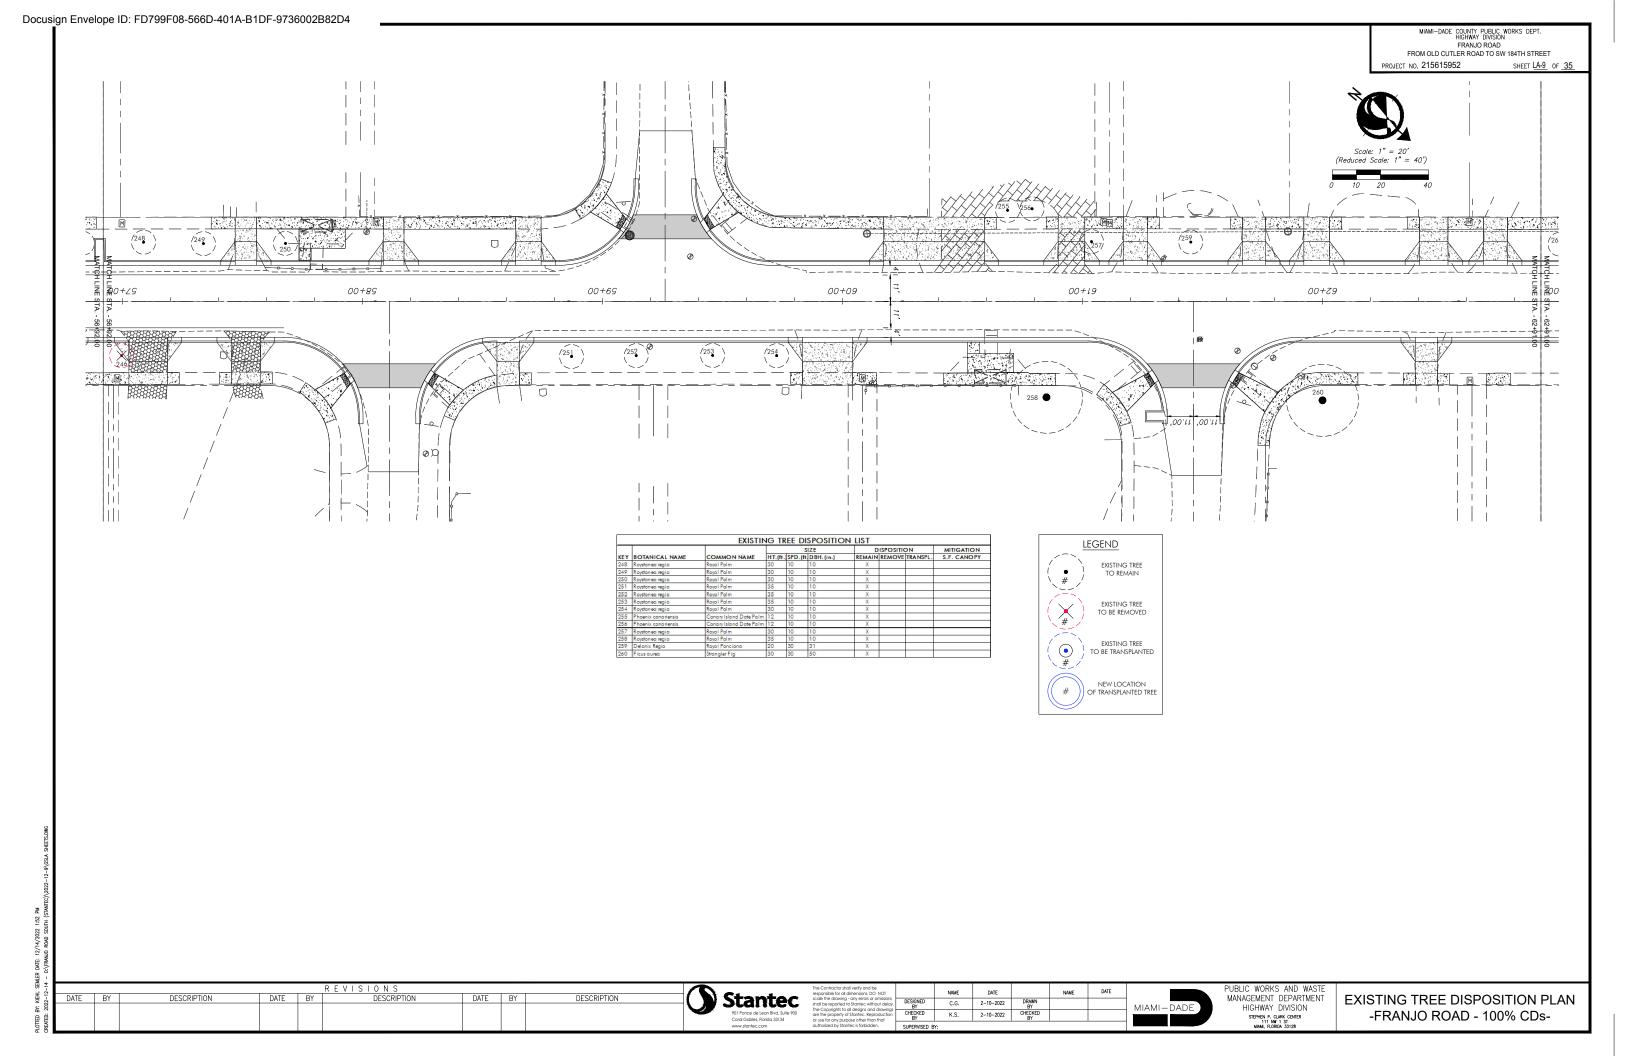


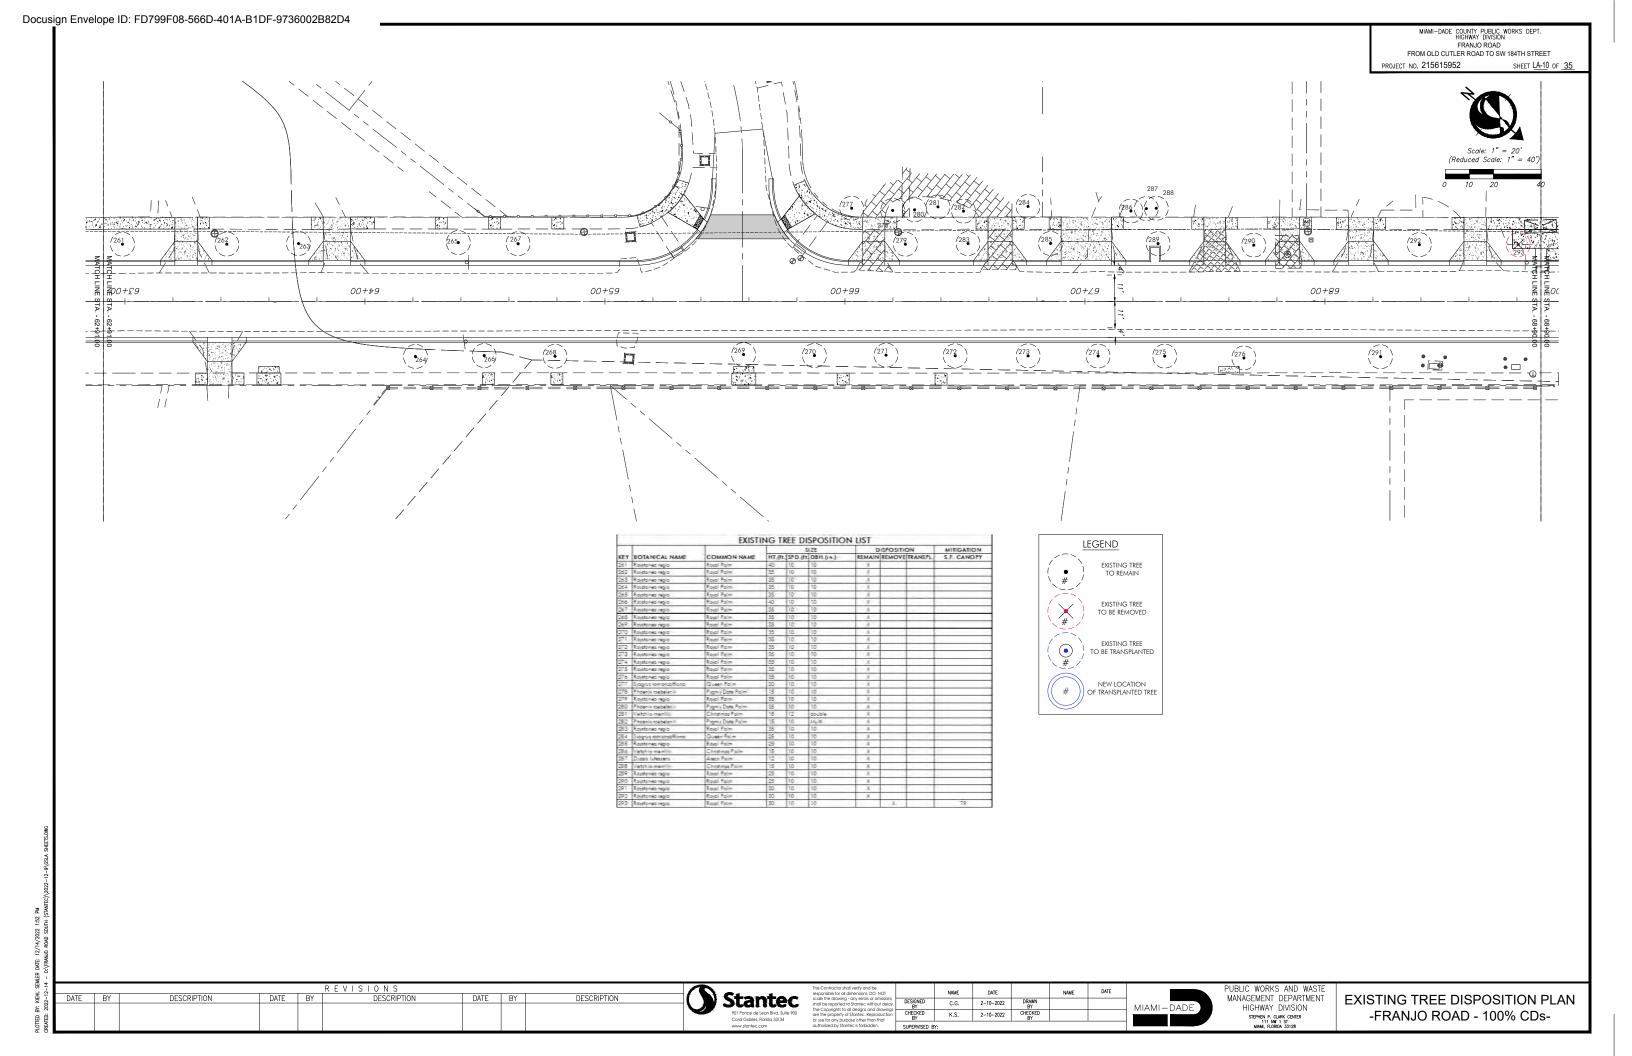


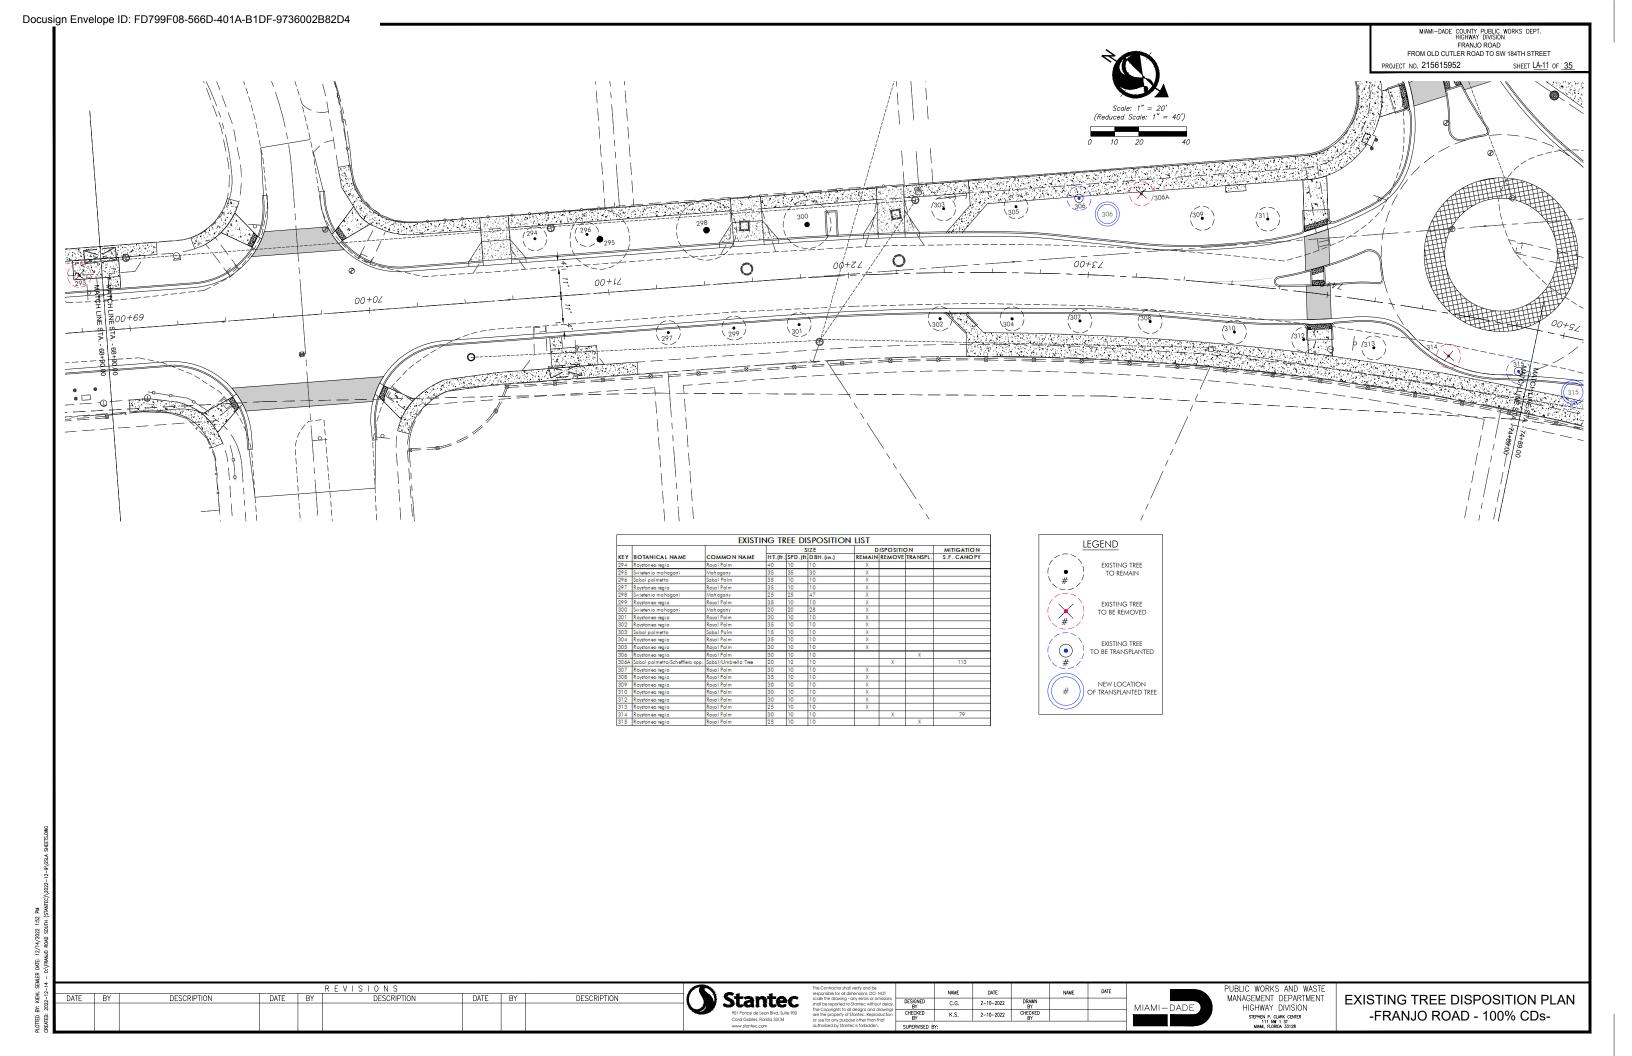

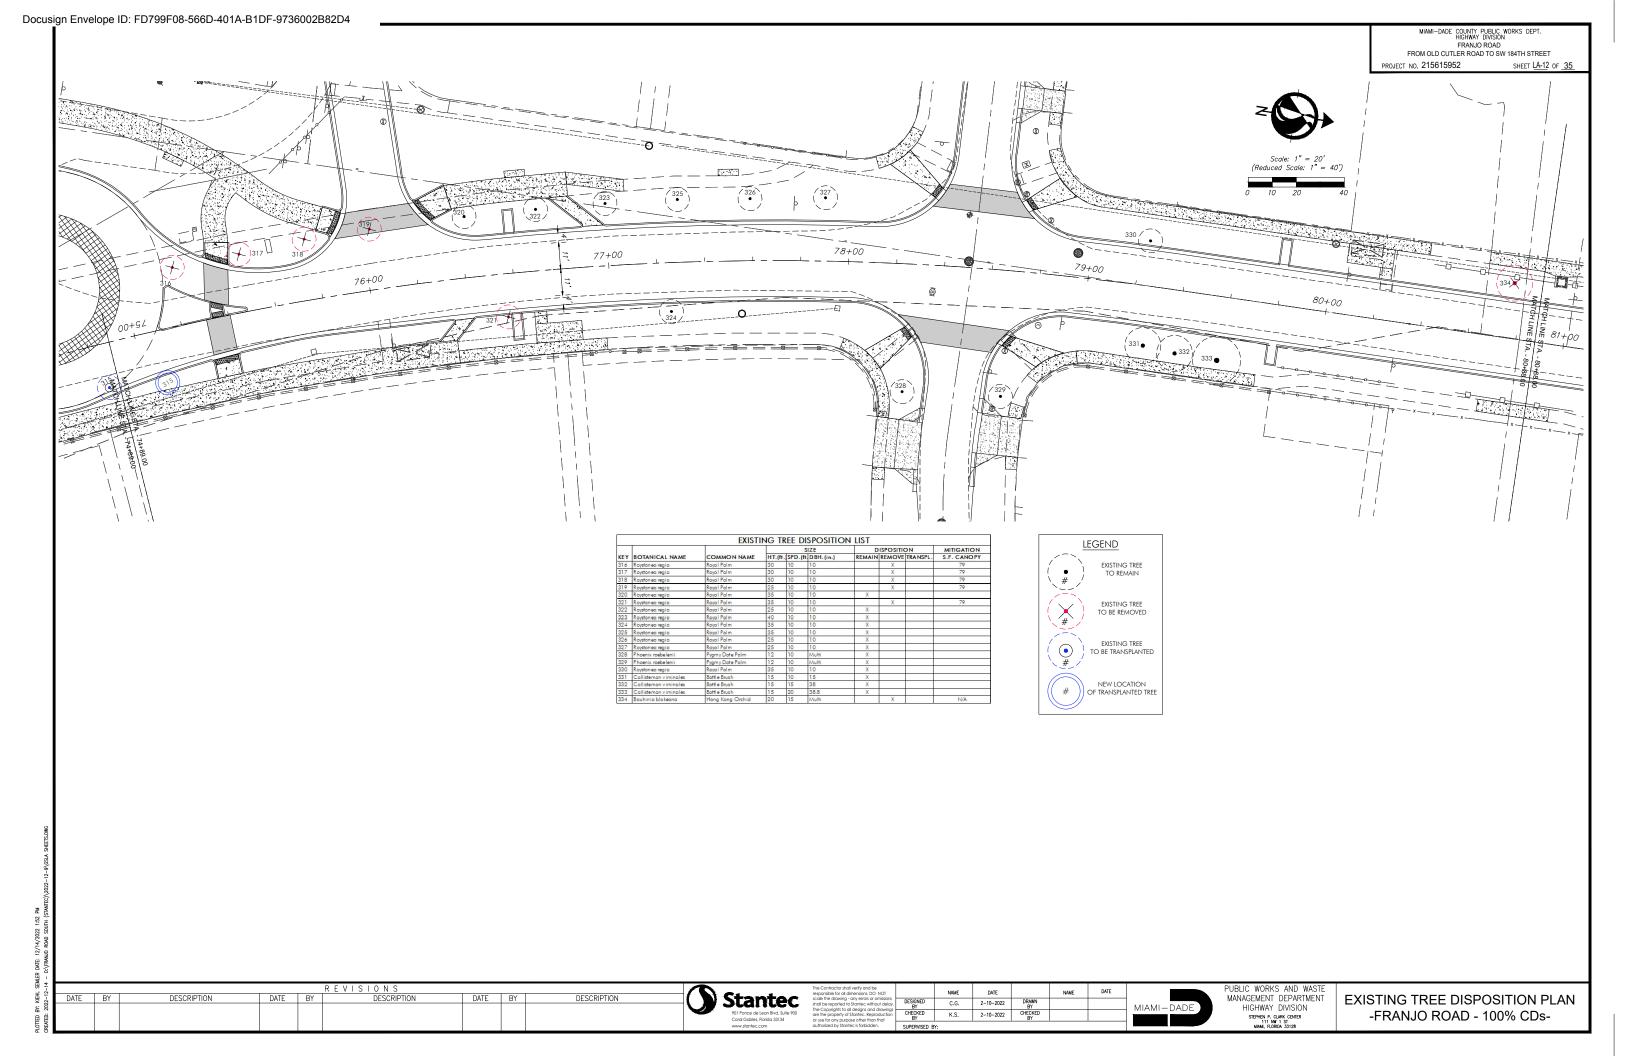

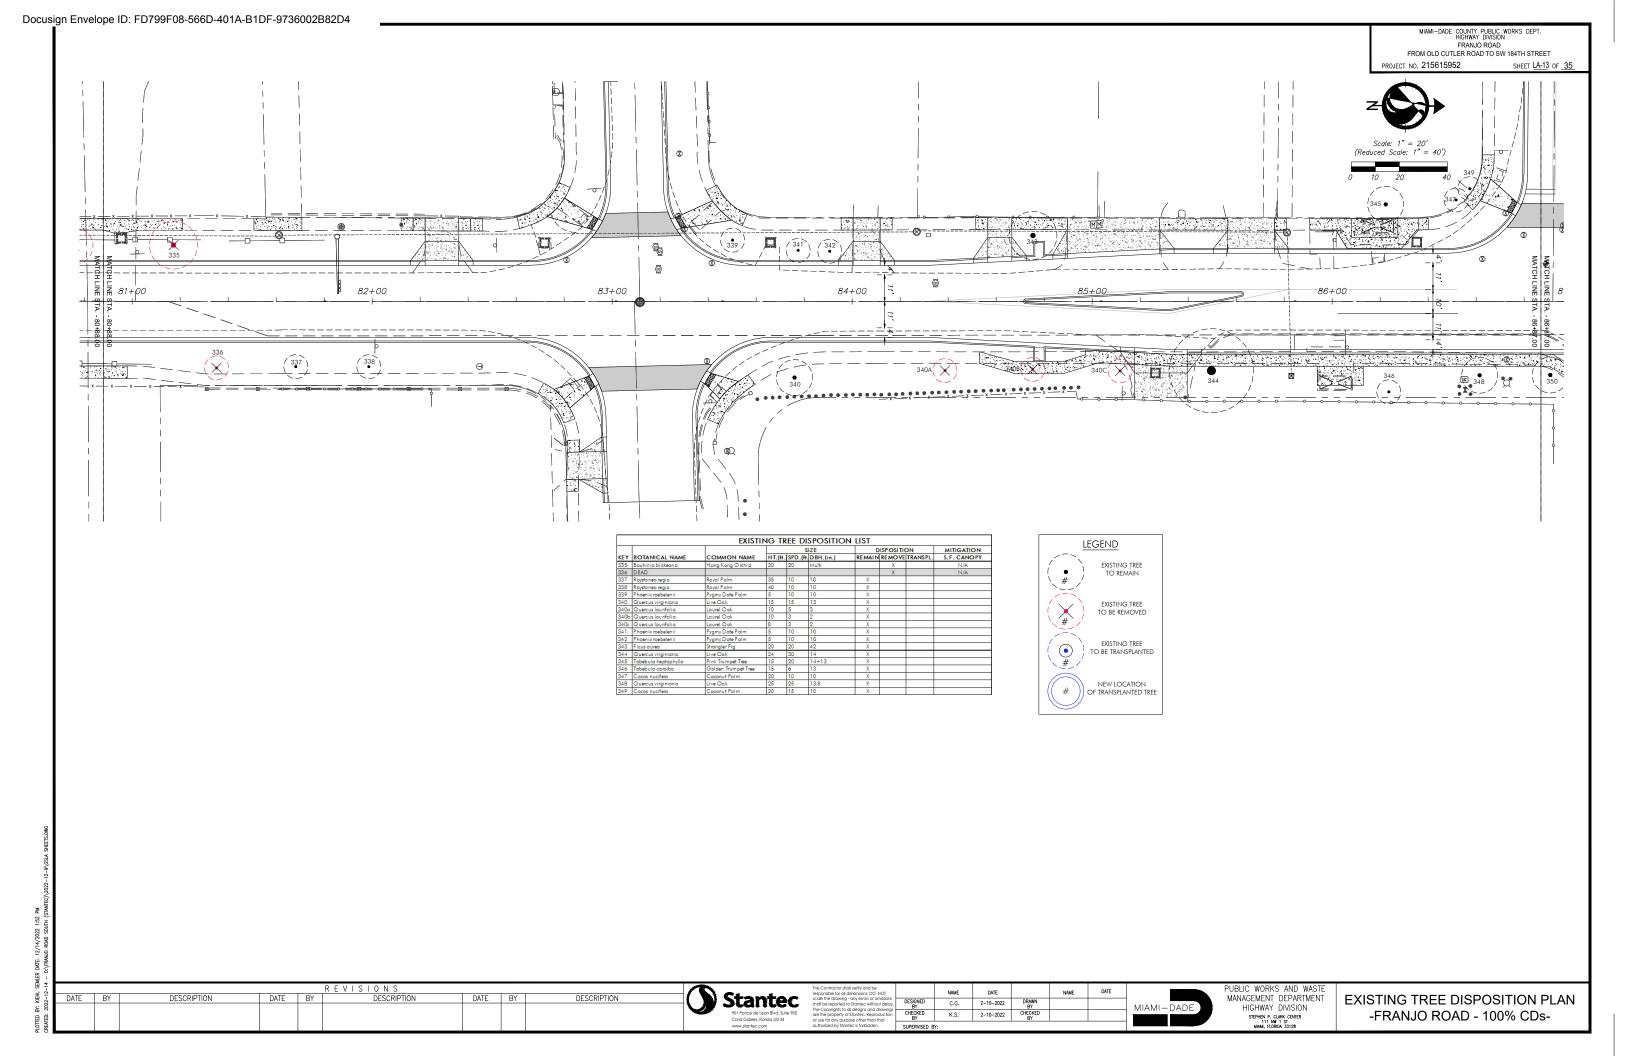

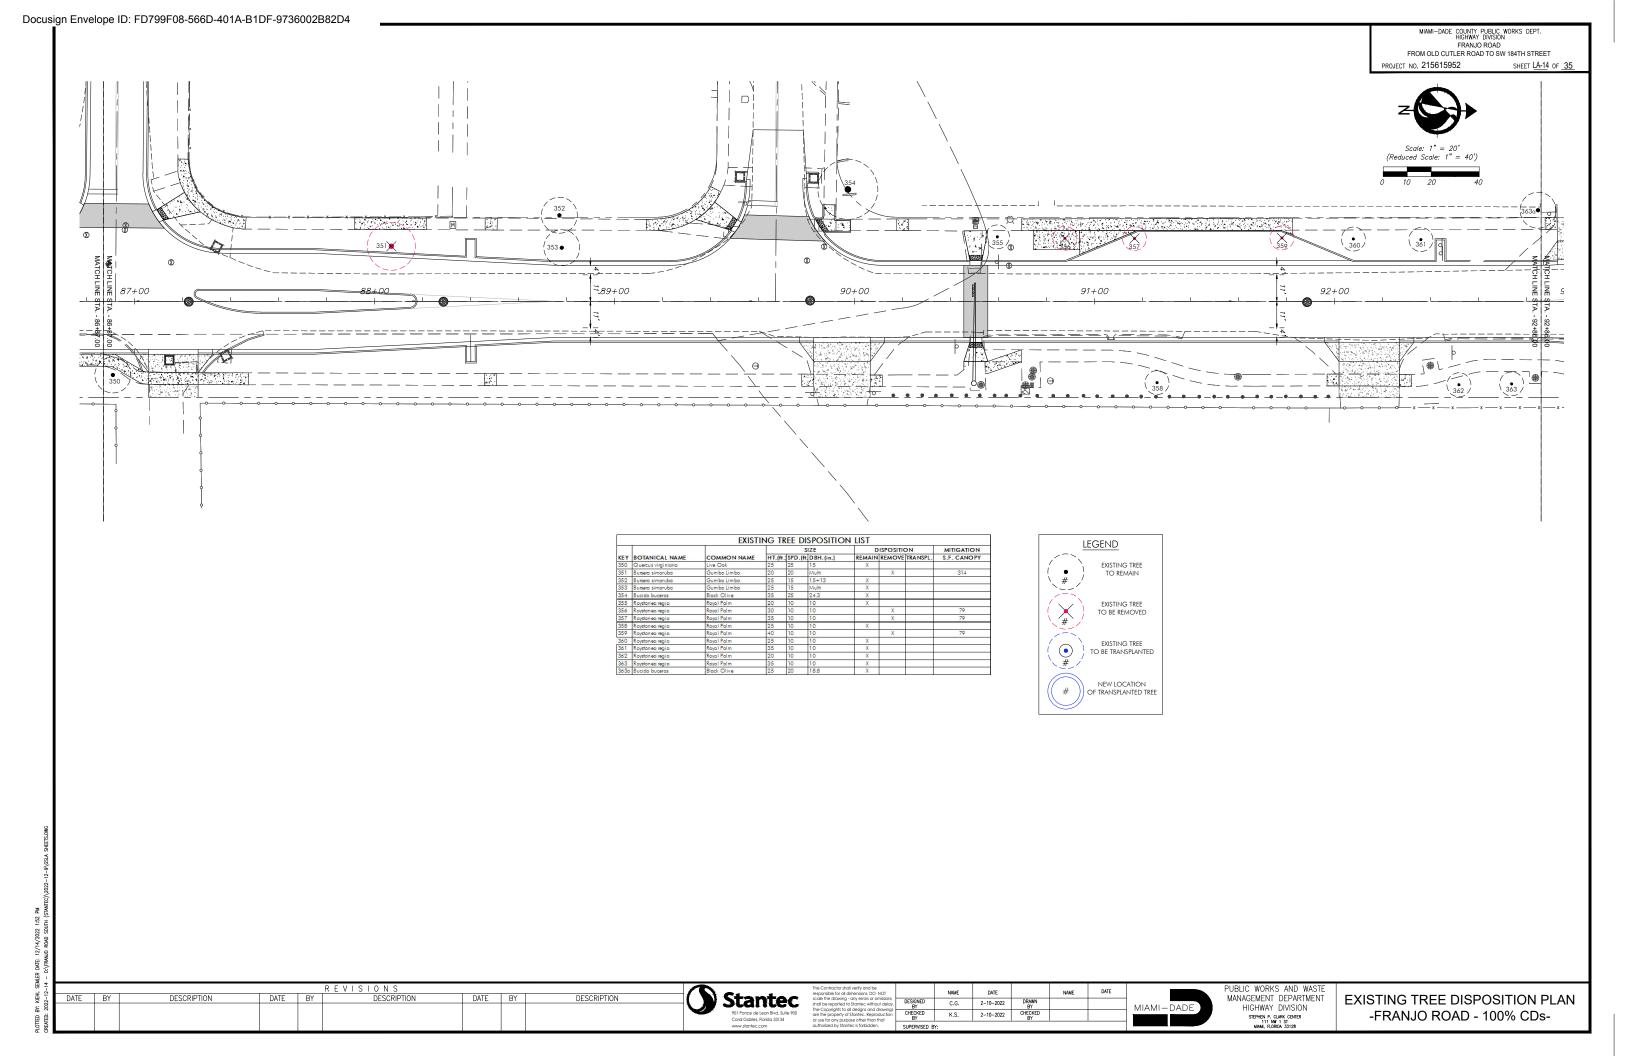

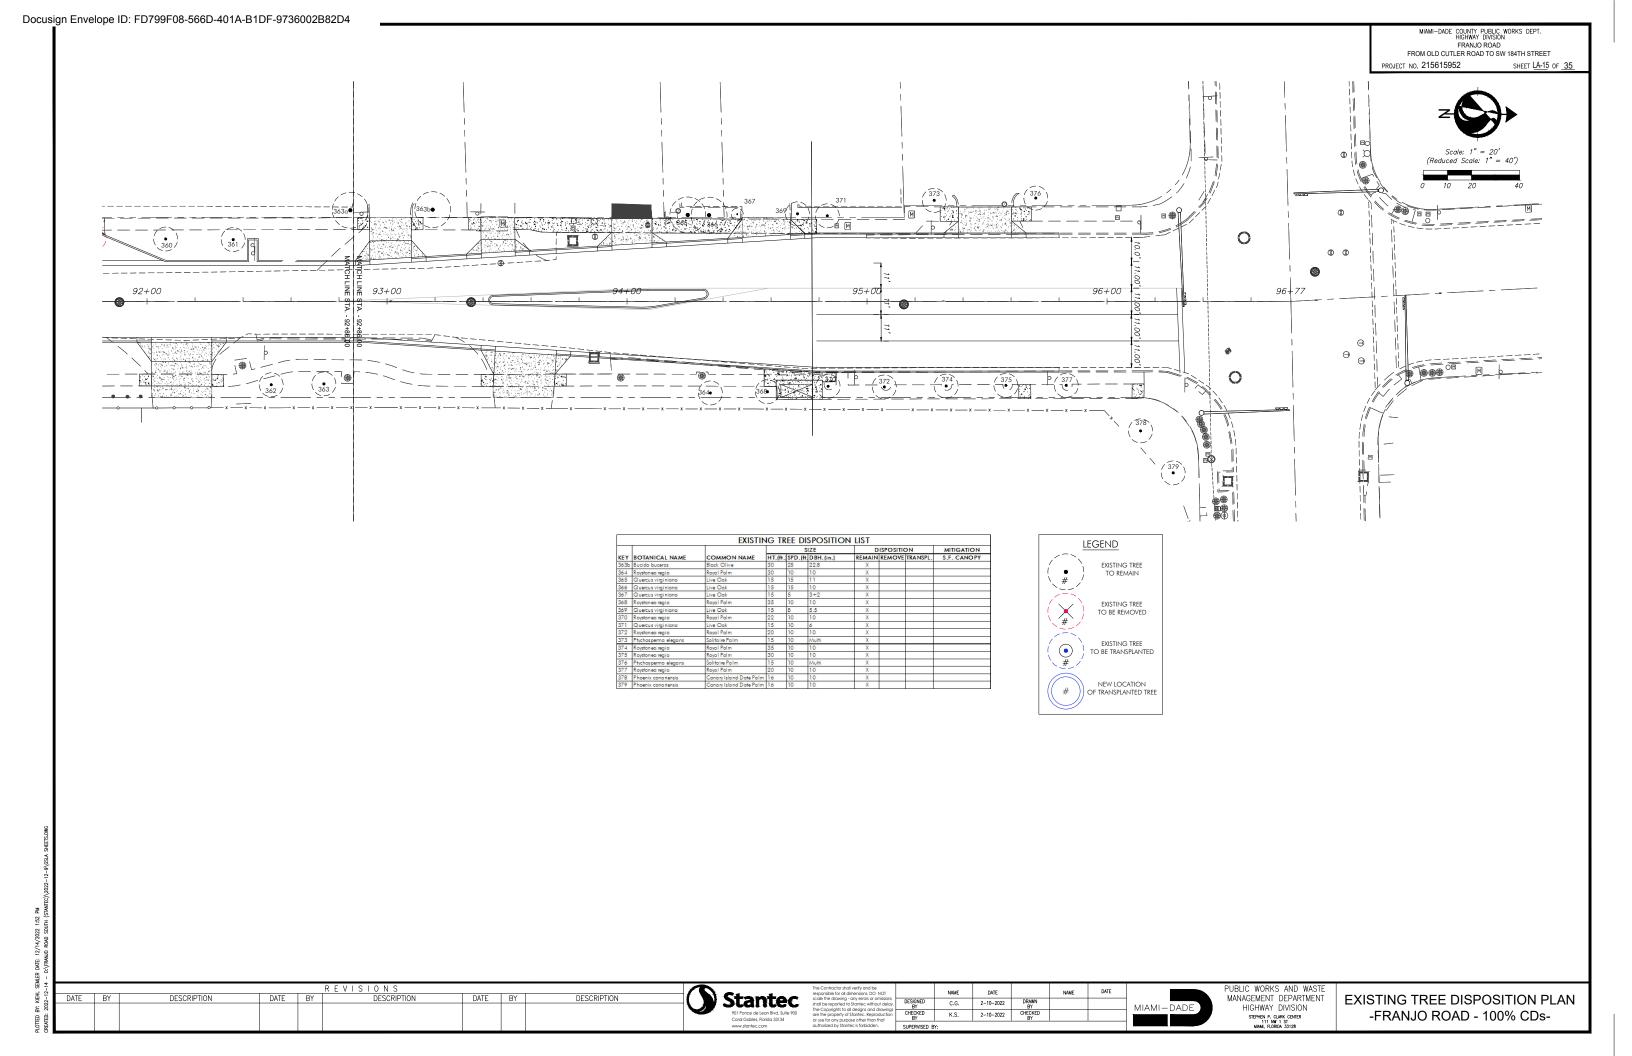

Docusign Envelope ID: FD799F08-566D-401A-B1DF-9736002B82D4

MIAMI-DADE COUNTY PUBLIC WORKS DEPT. HIGHWAY DIVISION FRANJO ROAD FROM OLD CUTLER ROAD TO SW 184TH STREET SHEET LA-16 OF 35

PROJECT NO. 215615952

TOTAL CANOPY S.F. TO BE REPLACED 15,099								
10,077								
*Mitigation provided (see plant list for species):								
MITIGATION TYPE QTY. MITIGATION EA. (S.F.) TOTAL MITIGATION (S.F.)								
Shade Tree 1	201	500	100500					
Shade Tree 2	107	300	32100					
Palm Tree 1	0	300	0					
Palm Tree 2	187	100	18700					
Small Tree	Small Tree 0 200 0							
GRAND TO	GRAND TOTAL S.F. MITIGATION CANOPY PROVIDED* 151300							

DESCRIPTION DESCRIPTION



The Contractor shall verify and be responsible for all dimensions. DO NOT		NAME	DATE		NAME	DATE	
scale the drawing - any errors or omissions shall be reported to Stantec without delay. The Copyrights to all designs and drawings are the property of Stantec. Reproduction or use for any purpose other than that	DESIGNED BY	C.G.	2-10-2022	DRAWN BY			
	CHECKED BY	K.S.	2-10-2022	CHECKED BY			,
authorized by Stantec is forbidden.	SUPERVISED B	Y:					

1.01 Root Pruning, Watering Before Transplanting

- A. Prior to root pruning and before excavating holes for transplanted trees, check with all local utilities to locate existing underground utilities. If any unknown utilities or sprinkler pipes are in advertently broken, <u>do not</u> cover them up. Immediately notify the utility and/or the Client, and take all necessary steps to repair the break.
- B. Root prune trees a minimum of eight (8) weeks prior to moving them. It is not necessary to root prune palms prior to transplanting unless specifically instructed to do so by the Landscape Architect. Prior to root pruning, thoroughly water the root zone with at least 2"-3" of water.
- C.Root pruning shall be accomplished by digging a trench two-thirds (2/3) of the way around the tree at a minimum of twenty four (24) inches deep. Root prune only with a mechanical root-pruning saw or a trencher with a maximum trench width of 8 inches. This trench shall form a rootball of the minimum following sizes:

Up to 5" caliper 5' diameter
6"-8" caliper 6'-7' diameter
9"-12" caliper 9'-10' diameter
Over 12" caliper 12' diameter

- D. All exposed roots shall be cut off smoothly, with sharp instruments. Backfill trenches with soil consisting of 30% silica sand and 70% mulch. Water them thoroughly immediately after root pruning, and once weekly during the root regeneration period. Every 2 weeks add a soluble fertilizer that has a 20.20.20 analysis at manufacturer's recommended rate, to the watering mix.
- E. It may be necessary to remove curbing and/or paving to complete the root pruning operation. Where this is required, the Contractor shall first cut cleanly with a concrete saw, any section of curb or pavement before cutting the roots. This material shall be removed from the site by the Contractor and the area of pavement cut and removed by the root pruning shall be filled to flush with adjacent pavement.

1.02 Top Pruning and Thinning

A. The amount of general pruning and thinning shall be limited to the minimum necessary to remove dead or injured twigs or branches and to compensate for the loss of roots as a result of transplanting operations. Approximately 1/3 of the mass of the canopy shall be removed unless otherwise instructed by the Landscape Architect. Pruning and thinning shall be done in such a manner as not to change the natural habit or shape of a plant. For very large trees that must be transported on public R.O.W.'s or where obstacles require it, additional pruning may be allowed at time of transport; cut back trees to the maximum size which can be transported after limbs are tied in as much as possible. The Landscape Architect shall be contacted prior to performing any major pruning or thinning.

1.03 Bracing and Guying of Trees After Root Pruning

A. Bracing and Guying shall be provided to assure the trees' stability during the root regeneration period, if required by the Landscape Architect.

1.04 Balling and Burlapping

A. Plant material which is in a soil of a loose texture, which does not readily adhere to the root system, especially in the case of large plants or trees, shall have the rootball wrapped in burlap and then wire, if directed by the Landscape Architect.

1 05 Transplanting Plant Material

- A. Movement of plants on public R.O.W.'s shall comply with all ordinances, codes and safety requirements, etc.
- B. Transport materials on vehicles large enough to allow plants to not be crowded and damaged. Plants shall be covered to prevent wind damage during transit.
- C. Protect plant material during transporting to prevent damage to the root system and desiccation of leaves. Trees shall be protected by tying in the branches and covering all exposed branches as necessary. Do not bend or bind-tie plant material in such a manner as to damage bark, break branches or alter the natural shape.
- D. The Contractor shall exercise care in handling, loading, unloading, storing, and transporting material to prevent damage. The Contractor shall assume full responsibility for protection and safekeeping of materials stored.
- E. Transplanting must be done within 24 hours after being dug. Store plants in shade and keep the root ball and canopy moist.

1.06 Installation

A. Excavation of Holes: Plant holes shall be roughly cylindrical in shape with sides approximately vertical. The depth of the hole shall be equal to the rootball depth plus 12" unless further depth is required to provide adequate drainage. The diameter of the hole shall be a minimum of 24" larger than the rootball diameter.

B. Setting of Plants

1) Plant material shall be planted at their natural and original planting level prior to their placement on this project or job. When lowered into the hole, the plants shall rest on the prepared hole bottom such that the surface roots at the top of the rootball are level or slightly above the level of the top of the hole. Create a saucer, approximately 6" deep to help hold water. The practice of plunging, burying or planting and plant material such that the surface roots at the top of the rootball are below the level of the surrounding final grade will not be permitted unless it is indicated otherwise in these specifications. The plants shall be set straight or plumb or normal to the relationship of their growth prior to transplanting. The Landscape Architect reserves the right to realign any plant material after it has been set.

C. Backfilli

DESCRIPTION

- 1) Use planting soil consisting of 40% silica sand, 40% muck, and 20% well-rotted compost derived from yard wastes.
- 2) Backfill the bottom two-thirds of the planting hole and firmly tamp and settle by watering as backfilling progresses. After having tamped and settled the bottom two-thirds of the hole, thoroughly puddle with water and fill remaining one-third of the hole with planting soil, tamping and watering to eliminate air pockets.

3) Add Diehard" transplant innoculant supplied by Horticultural Alliance, Inc. (800-628-6373) or equal. Mix into top 8-10 inches of planting hole, making sure it is contact with the root ball. Add at a rate of one (1) 8oz. bag per 2 inches of trunk caliper.

1.07 Watering Transplanted Trees:

- A. Once trees have been relocated and well-watered in during the transplanting, provide water for a period of 60 days after transplanting.
- B. Rootball Watering: Maintain a soil moisture in the root zone at an optimum level for growth, by deep watering of the entire rootball area according to the following schedule:

When	Frequency	Amoun
first week	once daily	3" per tree
second week	every other day	2" per tree
following month	twice a week	1" per tree
last 2 weeks	once per week	1" per tree

- C.In addition to the rootball watering, the canopy of the large shade trees (over 12" caliper) shall be watered with an automatic irrigation system spraying the canopy. Spray heads shall be installed near the top of the canopy and spaced so that the entire canopy shall be sprayed. This system shall remain in place until directed by the Landscape Architect to be removed.
- D. If there is no source for water available at the project, such as a hose bib(s) or fire hydrants(s) if approved for use, then the Contractor shall be responsible for supplying water by means of a truck or tank. It is the Contractor's responsibility to pay any fees for water use.

1.08 Mulching of Plant Saucer

A. Spread 3" thick layer of shredded Eucalyptus or Melaleuca mulch over entire area of the rootball.

1.09 Application of Fertilizer

- A. At time of watering root-pruned trees prior to transplanting, drench rootball once per week during the course of watering with a soluble fertilizer that has a 20.20.20 analysis at manufacturer's recommended rate.
- B. Three (3) weeks after transplanting, and after mulching, apply on the surface, evenly spread over the area of the entire rootball, FEC (Florida East Coast Fertilizer Co) #5231 (12-6-8) or equal at the rate of one (1) pound per inch of trunk diameter.

1.10 Staking Trees

A. Stake all trees and palms at the new site with new timbers with a minimum 2" x 4" dimension as per the details enclosed, or in the case of obstacle, in another manner which will support the trees.

1.11 Clean-Up

- A. Disposal of Waste: All waste and other objectionable material created through planting operations and landscape construction shall be removed completely on a daily basis from the job or as directed by the Landscape Architect. Any paved areas, including curbs and sidewalks which have been strewn with soil, sod waste, fertilizer or other waste shall be thoroughly swept. The Client is not required to supply areas or facilities for storage or removal of waste on-site.
- B. The Contractor shall remove and dispose of stakes and battens and untie any tied-up canopies when it is determined by the Landscape Architect that sufficient time has elapsed for the plants to root stabilizing the plant. This shall be done even if the project has been completed and given final acceptance.
- C. Backfilling shall be done immediately after tree removal, or suitable barricades shall be provided to prevent injuries. The Contractor shall backfill holes with clean fill to a level flush with adjacent grade.

1.12 Maintenance of Traffic

A. During all transplanting operations, the Contractor is responsible to maintain the safe flow of vehicular and pedestrian traffic around hazardous areas. The Contractor shall provide barricades, cones, signal boards, etc. as necessary to adequately warn traffic and maintain flow of traffic around or through construction zones. Work shall be performed in such a manner that minimizes the amount of time traffic is impeded by construction activities. Coordinate with Landscape Architect

1.13 Guarantee and Replacement

A. Plant material which is on the site and scheduled to be transplanted is not covered by the guarantee, except in the case of Contractor's negligence or work that has been done in an unworkmanlike manner. If it is determined by the Landscape Architect that the Contractor's negligence or unworkmanlike operations has severely damaged or poses a threat to the health of material to be transplanted or already transplanted, then the Contractor shall be required to replace the tree at a size equal to the transplanted tree, at his cost, and water it as per 1.07.

The Contractor shall verify and be responsible for all dimensions. DO NOT		NAME	DATE		NAME	
scale the drawing - any errors or omissions shall be reported to Stantec without delay. The Copyrights to all designs and drawings	DESIGNED BY	C.G.	2-10-2022	DRAWN BY		
are the property of Stantec. Reproduction or use for any purpose other than that	CHECKED BY	K.S.	2-10-2022	CHECKED BY		
authorized by Stantec is forbidden.	CHDEDWICEN D	ν.				



MIAMI-DADE COUNTY PUBLIC WORKS DEPT


FRANJO ROAD FROM OLD CUTLER ROAD TO SW 184TH STREET

SHEET LA-17 OF 35

PROJECT NO. 215615952

FRANJO ROAD
FROM OLD CUTLER ROAD TO SW 184TH STREET SHEET LA-18 OF 35

PROJECT NO. 215615952

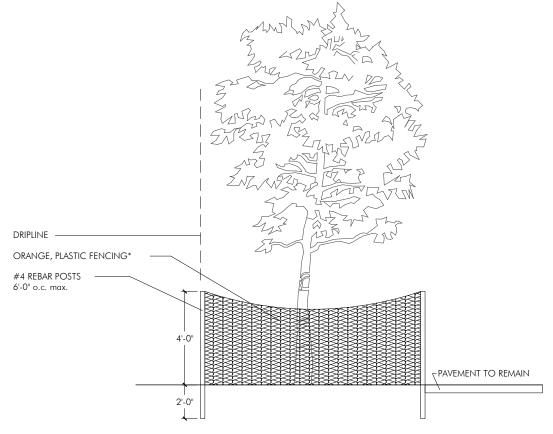

*LIMITS OF TREE PROPECTION ARE TO BE ESTABLISHED BASED ON ANSI A300 ROOT MANAGEMENT STANDARDS. AS A GENERAL RULE THE TREE PROTECTION ZONE MUST EXTEND 10" PER 1" OF TREE DBH. -PLACE ORANGE, PLASTIC FENCING (BY TENSAR OR OTHER APPROVED EQUAL) AROUND INDIVIDUAL TREES AND TREE CLUMPS TO REMAIN ON SITE IN ANY AREAS WITHIN THE LIMITS OF CONSTRUCTION. BARRIER SHALL BE MAINTAINED IN AN UPRIGHT POSITION AT ALL TIMES.

TREE PROTECTION DETAIL

N.T.S.

	R E V I S I U N S										
DATE BY DESCRIPTION DATE BY DESCRIPTION DATE BY DESCRIPTION								DESCRIPTION			
			I	l		l	I				

(Stantec 901 Ponce de Leon Blvd. Suite 900 Coral Gobles, Florida 33134	1

The Contractor shall verify and be responsible for all dimensions. DO NOT		NAME	DATE		NAME	DATE
scale the drawing - any errors or omissions shall be reported to Stantec without delay. The Copyrights to all designs and drawings	DESIGNED BY	C.G.	2-10-2022	DRAWN BY		
are the property of Stantec. Reproduction or use for any purpose other than that	CHECKED BY	K.S.	2-10-2022	CHECKED BY		
authorized by Stantec is forbidden.	SUPERVISED BY	r:				

PUBLIC WORKS AND WASTE MANAGEMENT DEPARTMENT HIGHWAY DIVISION

TREE PROTECTION DETAIL -FRANJO ROAD - 100% CDs-

MIAMI-DADE COUNTY PUBLIC WORKS DEPT. HIGHWAY DIVISION FRANJO ROAD FROM OLD CUTLER ROAD TO SW 184TH STREET SHEET LA-19 OF 35

		020	00.22.	٠.
PROJECT	NO.	2156	15952	


TDEEC	PLAN [*]	LIOI		
TREES KEY	DIANT NAME	IOTY	Lit	C17E
	PLANT NAME	QTY.	UT.	SIZE
BUAR	Bulnesia arborea	25	ea.	12' tall x 5' spread, 2 1/2" cal.,
01.101	Verawood			4' CT min
BUSI	Bursera simaruba	30	ea.	12' tall x 5' spread, 2 1/2" cal.,
	Gumbo Limbo			4' CT min
CESP	Ceiba speciosa	1	ea.	12' tall x 5' spread, 2 1/2" cal.,
	Silf Floss Tree			4' CT min
COES	Conocarpus erectus "Sericeus"	18	ea.	12' tall x 5' spread, 2 1/2" cal.,
<u> </u>	Silver Buttonwood			4' CT min
LCA	llex cassine	73	ea.	12' tall x 5' spread, 2 1/2" cal.,
	Dahoon Holly		1	4' CT min
LAIN	Lagerstroemia indica "Muscogee"	20	ea.	12' tall x 5' spread, 2 1/2" cal.,
77.1	Crepe Myrtle			4' CT min, Purple Flowers
LYLA	Lysiloma latisiliquum	79	ea.	12' tall x 5' spread, 2 1/2" cal.,
	Wild Tamarind		11,5	4' CT min
QUVI	Quercus virginiana	68	ea.	12' tall x 5' spread, 2 1/2" cal.,
1/-1/-	Live Oak		-11	4' CT min
PALMS	Charles In the Control of the Contro	_ Ville		500-90-9
KEY	PLANT NAME	QTY.	UT.	SIZE
SSA	Pseudophoenix sargentii	27	ea.	4' CW
7.701	Buccaneer Palm		2.55	
SAPA	Sabal palmetto	79	ea.	22' tall OA, smooth trunks,
	Sabal Palm	7.9	-	hurricane cut
THRA	Thrinax radiata	86	ea.	7' tall OA
11.11.0	Thatch Palm	00	00.	7 1011 071
SHPLIE	SS AND GROUNDCOVERS	_	-	
KEY	PLANT NAME	QTY.	UT.	SIZE
AEBL	Aechmea blanchetiana "Orange Form"	60	ea.	24"x18", install 24" o.c.
ALDL.	Orange Bromeliad	00	ea.	24 x 10 , Ilisidii 24 O.C.
CHIH	Chrysobalanus icaco "Horizontalis"	1943	ea.	12"x18", install 24" o.c.
CHIII	Horizontal Cocoplum	1943	ea.	12 x 18 , Insidii 24 O.C.
FIGI	Ficus microcarpa "Green Island"	2688	-	18"x18", install 24" o.c.
101	Green Island Ficus	2000	ea.	18 x 18 , Insidii 24 O.C.
LADE	Lantana depressa	152	12	18"-18" : 1 18"
LADE	Pineland Lantana	152	ea.	18"x18", install 18" o.c.
LOCH		486		101-101 : 0.041
LOCH	Loropetalum chinensis "Rubrum"	480	ea.	18"x18", install 24" o.c.
MUCA	Fringeflower	0450	-	2 and some full install 0.4
VIUCA	Muhlenbergia cappilaris	2653	ea.	3 gal cans, full, install 24" o.c.
DUILI	Muhly Grass	2225		100.100 :- 1-0.00
RHIN	Rhaphiolepis indica	1115	ea.	18"x18", install 24" o.c.
74011	Indian Hawthorne	10/5		101 101
ZAPU	Zamia pumila	1265	ea.	18"x18", install 24" o.c.
	Coontie			Particular strains of the state
MISCE	LLANEOUS			
sod	St. Augustine "Citrablue"	as req.	s.f.	solid sod, patch as required
	Planting Soil	as req.	c.y.	excavate and backfill 12" in al
	70% Silica Sand		i in	shrub beds
	20% Everglades Muck			THE PROPERTY OF THE PARTY OF TH
	10% Shredded Pinebark			
	Shredded Melaleuca Mulch	as req.	c.y.	2" layer in all shrub beds


	SHEETS.
	ED: 2022-12-14 - 0:\FRANJO ROAD SOUTH (STANTEC)\2022-12-9\GSLA SHEETS.
5 PM	(STANTEC
22 1:5	SOUTH
/14/20	ROAD
ED BY: KIEHL SEMLER DATE: 12/14/2022 1:52 PM	:\FRANJO
SEMLER	-14 - (
Y: KEH	2022-12
8	ä

R E V I S I O N S DESCRIPTION DESCRIPTION DESCRIPTION



	The Contractor shall verify and be responsible for all dimensions. DO NOT		NAME	DATE		NAME	DATE	Γ
-	scale the drawing - any errors or omissions shall be reported to Stantec without delay. The Copyrights to all designs and drawings	DESIGNED BY	C.G.	2-10-2022	DRAWN BY			
00	are the property of Stantec. Reproduction or use for any purpose other than that	CHECKED BY	K.S.	2-10-2022	CHECKED BY			
	authorized by Stantec is forbidden.	SUPERVISED BY	r:					Ì

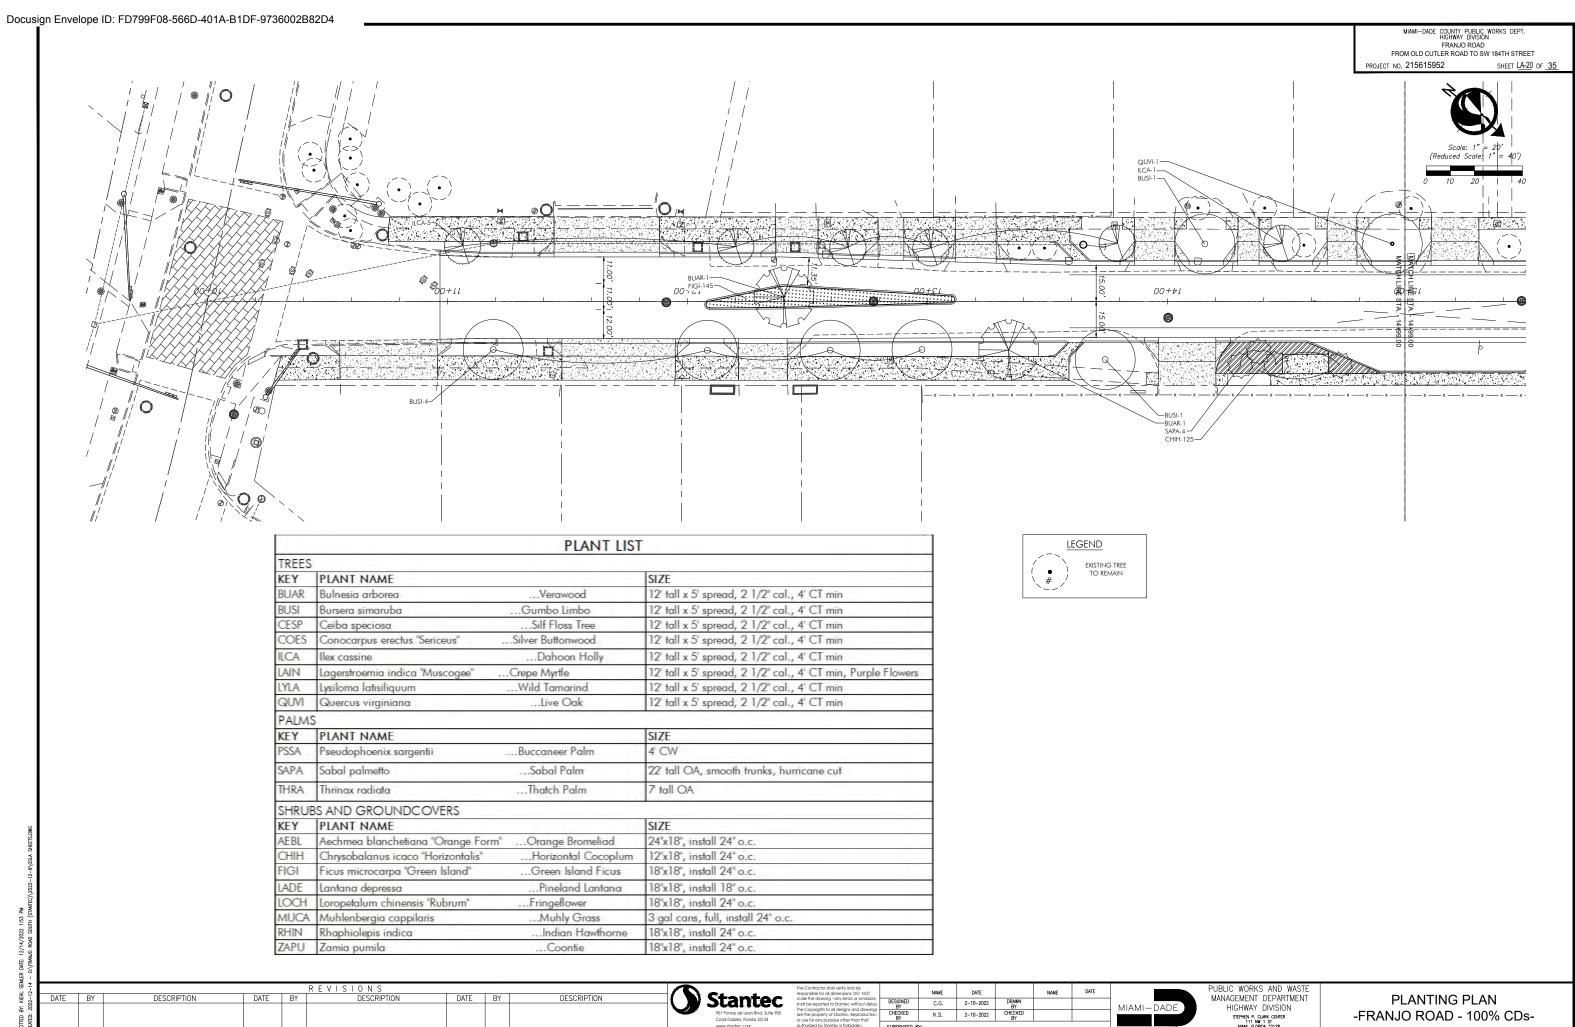

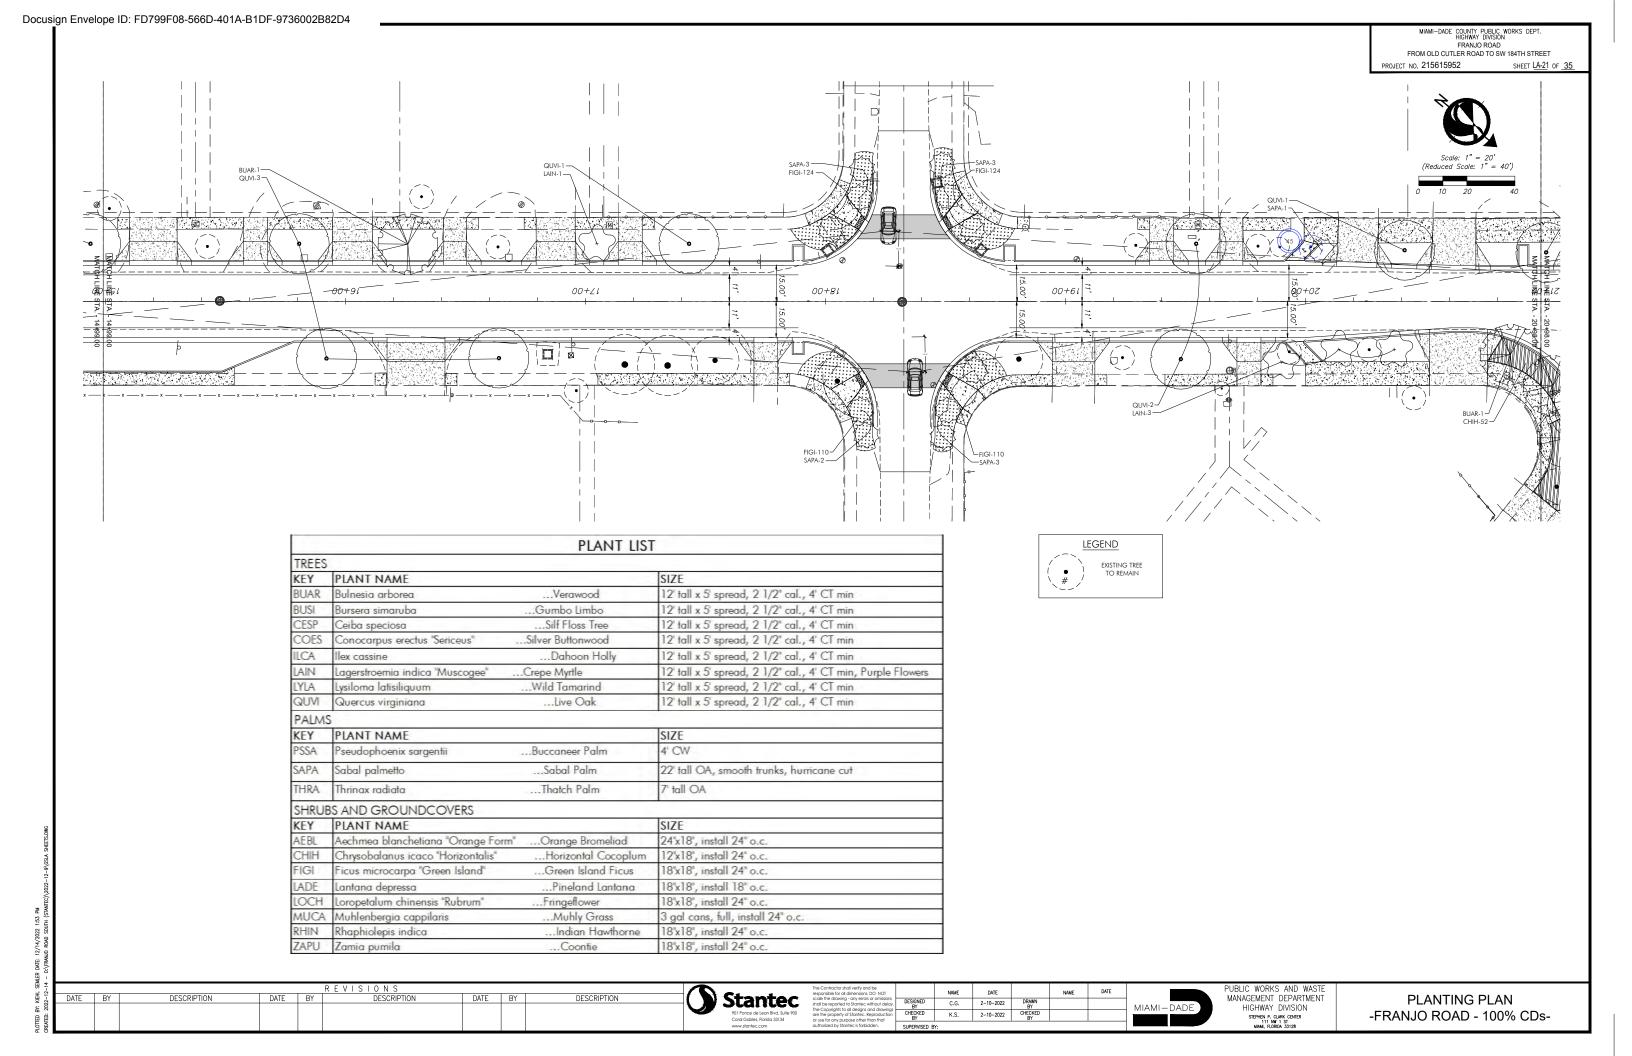

		PLANT LIST	
TREES			
KEY	PLANT NAME		SIZE
BUAR	Bulnesia arborea	Verawood	12' tall x 5' spread, 2 1/2" cal., 4' CT min
BUSI	Bursera simaruba	Gumbo Limbo	12' tall x 5' spread, 2 1/2" cal., 4' CT min
CESP	Ceiba speciosa	Silf Floss Tree	12' tall x 5' spread, 2 1/2" cal., 4' CT min
COES	Conocarpus erectus "Sericeus"	Silver Buttonwood	12' tall x 5' spread, 2 1/2" cal., 4' CT min
ILCA	llex cassine	Dahoon Holly	12' tall x 5' spread, 2 1/2" cal., 4' CT min
LAIN	Lagerstroemia indica "Muscogee" .	Crepe Myrtle	12' tall x 5' spread, 2 1/2" cal., 4' CT min, Purple Flowers
LYLA	Lysiloma latisiliquum	Wild Tamarind	12' tall x 5' spread, 2 1/2' cal., 4' CT min
QUVI	Quercus virginiana	Live Oak	12' tall x 5' spread, 2 1/2" cal., 4' CT min
PALMS			
KEY	PLANT NAME		SIZE
PSSA	Pseudophoenix sargentii	Buccaneer Palm	4' CW
SAPA	Sabal palmetto	Sabal Palm	22' tall OA, smooth trunks, hurricane cut
THRA	Thrinax radiata	Thatch Palm	7' tall OA
SHRUE	SS AND GROUNDCOVERS		
KEY	PLANT NAME	7 7 7 7 1	SIZE
AEBL	Aechmea blanchetiana "Orange Form"	Orange Bromeliad	24"x18", install 24" o.c.
CHIH	Chrysobalanus icaco "Horizontalis"	Horizontal Cocoplum	12'x18", install 24" o.c.
FIGI	Ficus microcarpa "Green Island"	Green Island Ficus	18"x18", install 24" o.c.
LADE	Lantana depressa	Pineland Lantana	18"x18", install 18" o.c.
LOCH	Loropetalum chinensis "Rubrum"	Fringeflower	18'x18', install 24" o.c.
MUCA	Muhlenbergia cappilaris	Muhly Grass	3 gal cans, full, install 24" o.c.
RHIN	Rhaphiolepis indica	Indian Hawthorne	18'x18", install 24" o.c.
ZAPU	Zamia pumila	Coontie	18"x18", install 24" o.c.

DESCRIPTION



DATE BY DESCRIPTION DATE BY DESCRIPTION

DATE BY DESCRIPTION

Stantec
90 Fonce de Leon Byd. Sulfe 900
Cord Gobles, Rivido 33134
www.thatee.com

The Contractor ball verify and be responsible for of dimensions. Do INOT scale the drowing-rany error of ornisions, that De reported to Statese, without disky, the Copyright to all design and drowing are the properly of Statese. Reported for than that outhorised by Statese is fordischen.

State of any purpose other than that outhorised by Statese is fordischen.


Suppose the property states is fordischen.


MIAMI-DADE


PUBLIC WORKS AND WASTE MANAGEMENT DEPARTMENT HIGHWAY DIVISION STEPHEN P. OLARK CENTER 111 MR 15 T.


PLANTING PLAN -FRANJO ROAD - 100% CDs-

MIAMI-DADE COUNTY PUBLIC WORKS DEPT. HIGHWAY DIVISION FRANJO ROAD FROM OLD CUTLER ROAD TO SW 184TH STREET

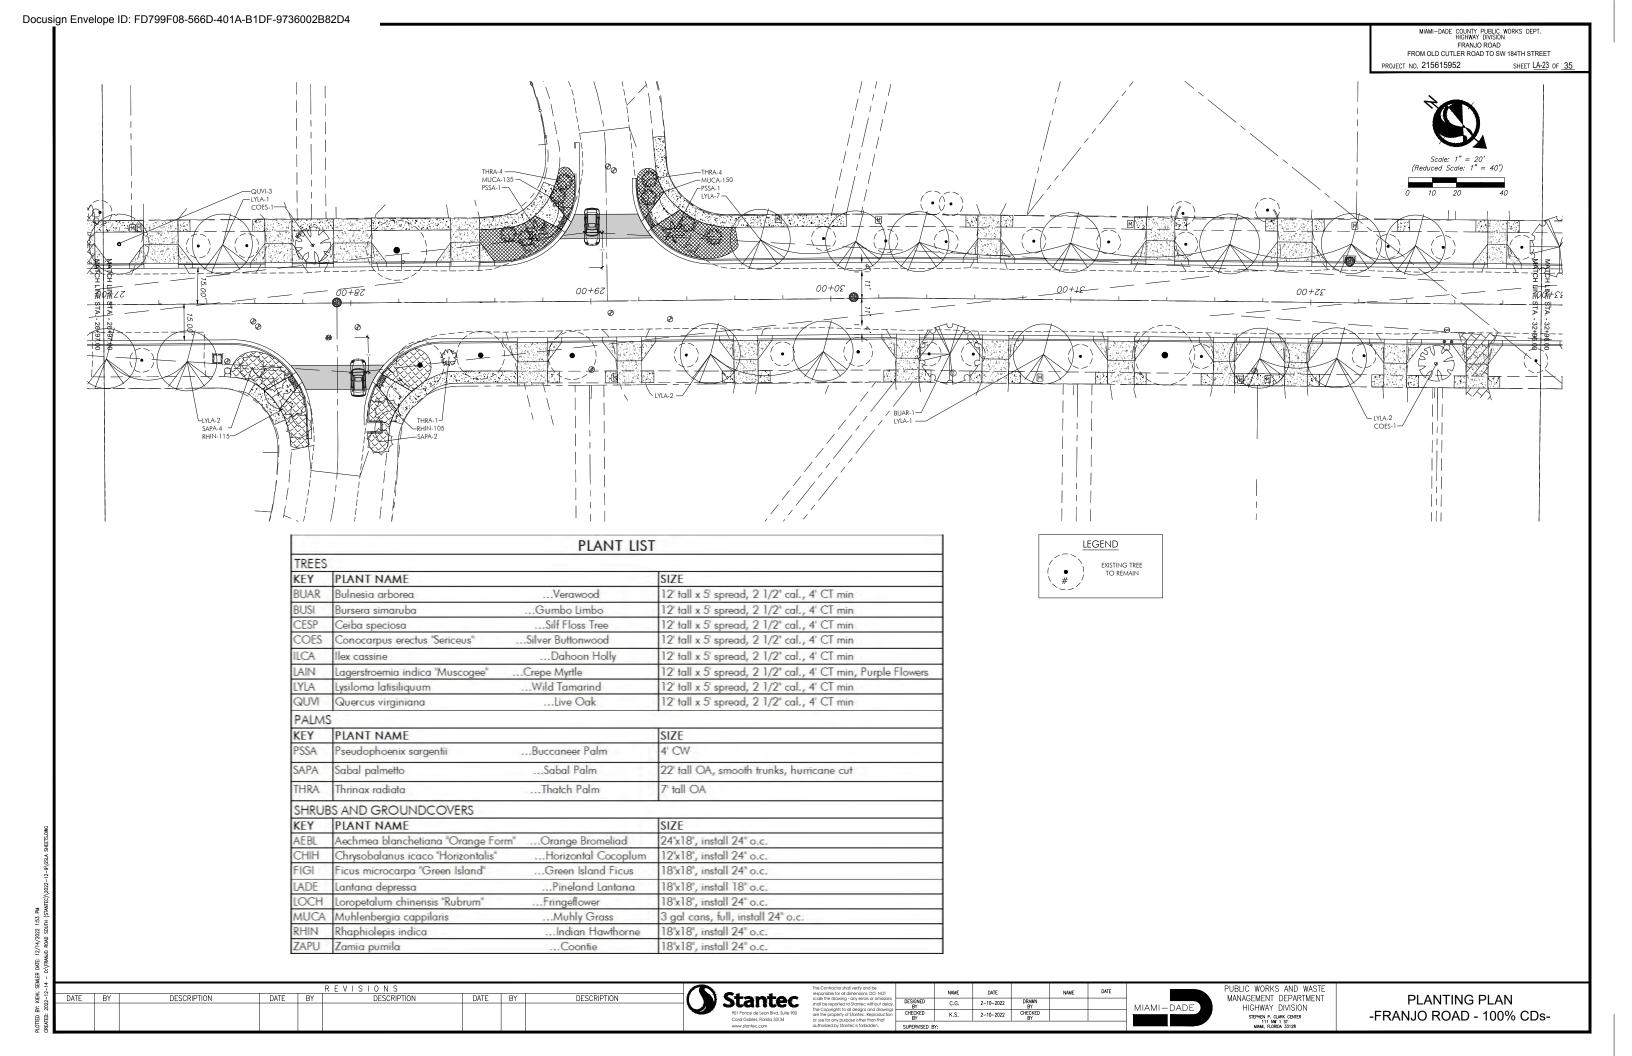

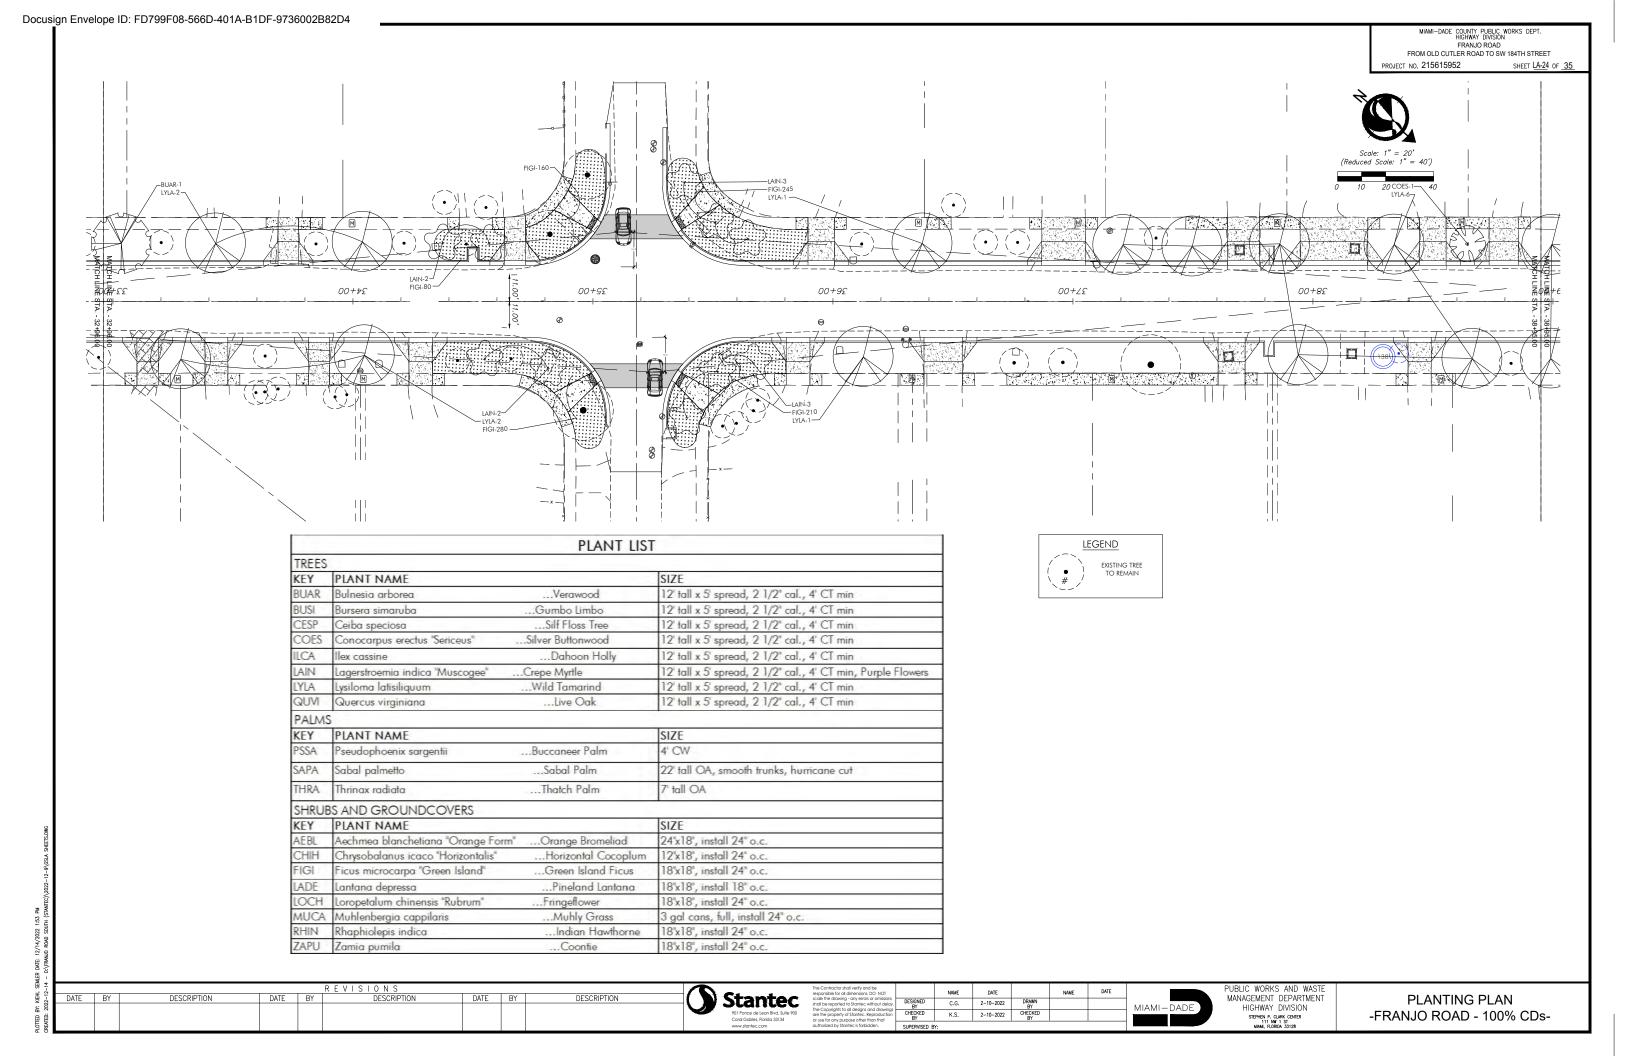

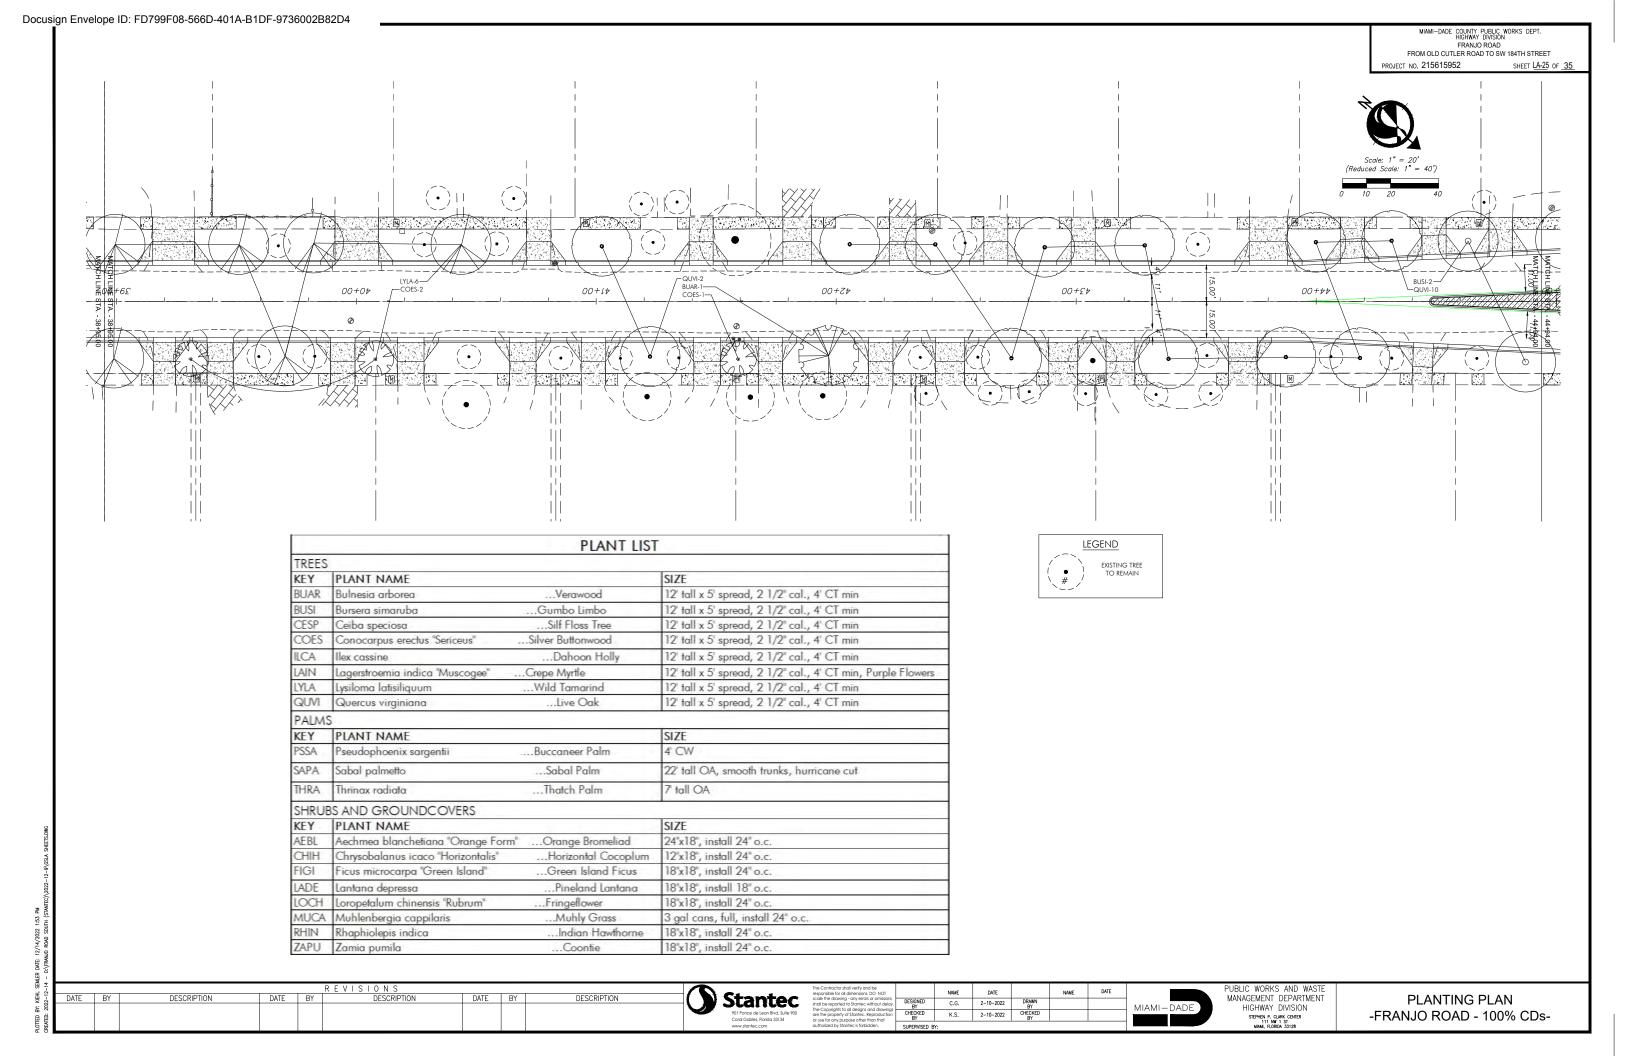

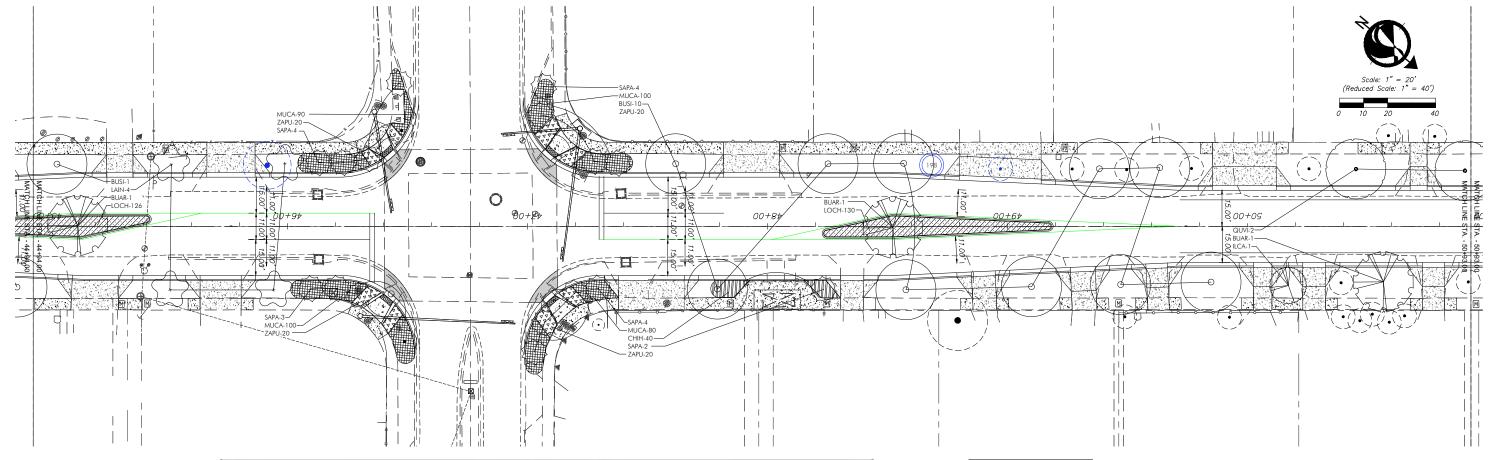

		PLANT LIST	
TREES			
KEY	PLANT NAME		SIZE
BUAR	Bulnesia arborea	Verawood	12' tall x 5' spread, 2 1/2" cal., 4' CT min
BUSI	Bursera simaruba	Gumbo Limbo	12' tall x 5' spread, 2 1/2" cal., 4' CT min
CESP	Ceiba speciosa	Silf Floss Tree	12' tall x 5' spread, 2 1/2" cal., 4' CT min
COES	Conocarpus erectus "Sericeus" .	Silver Buttonwood	12' tall x 5' spread, 2 1/2" cal., 4' CT min
ILCA	llex cassine	Dahoon Holly	12' tall x 5' spread, 2 1/2" cal., 4' CT min
LAIN	Lagerstroemia indica "Muscogee"	.Crepe Myrtle	12' tall x 5' spread, 2 1/2" cal., 4' CT min, Purple Flowers
LYLA	Lysiloma latisiliquum	Wild Tamarind	12' tall x 5' spread, 2 1/2" cal., 4' CT min
QUVI	Quercus virginiana	Live Oak	12' tall x 5' spread, 2 1/2" cal., 4' CT min
PALMS			
KEY	PLANT NAME		SIZE
PSSA	Pseudophoenix sargentii	Buccaneer Palm	4' CW
SAPA	Sabal palmetto	Sabal Palm	22' tall OA, smooth trunks, hurricane cut
THRA	Thrinax radiata	Thatch Palm	7' tall OA
SHRUB	S AND GROUNDCOVERS		
KEY	PLANT NAME		SIZE
AEBL	Aechmea blanchetiana "Orange Form"	Orange Bromeliad	24"x18", install 24" o.c.
CHIH	Chrysobalanus icaco "Horizontalis"	Horizontal Cocoplum	12'x18", install 24" o.c.
FIGI	Ficus microcarpa "Green Island"	Green Island Ficus	18"x18", install 24" o.c.
LADE	Lantana depressa	Pineland Lantana	18"x18", install 18" o.c.
LOCH	Loropetalum chinensis "Rubrum"	Fringeflower	18'x18", install 24" o.c.
MUCA	Muhlenbergia cappilaris	Muhly Grass	3 gal cans, full, install 24" o.c.
RHIN	Rhaphiolepis indica	Indian Hawthorne	18"x18", install 24" o.c.
ZAPU	Zamia pumila	Coontie	18"x18", install 24" o.c.



DESCRIPTION DESCRIPTION Stantec


The Contractor shall verify and be responsible for all dimensions. DO NOT		NAME	DATE		NAME	DATE
scale the drawing - any errors or omissions shall be reported to Stantec without delay. The Copyrights to all designs and drawings	DESIGNED BY	C.G.	2-10-2022	DRAWN BY		
are the property of Stantec. Reproduction or use for any purpose other than that	CHECKED BY	K.S.	2-10-2022	CHECKED BY		
authorized by Stantec is forbidden.	SUPERVISED B	Y:				


MIAMI-DADE


PUBLIC WORKS AND WASTE MANAGEMENT DEPARTMENT HIGHWAY DIVISION


PLANTING PLAN -FRANJO ROAD - 100% CDs-


SHEET LA-26 OF 35

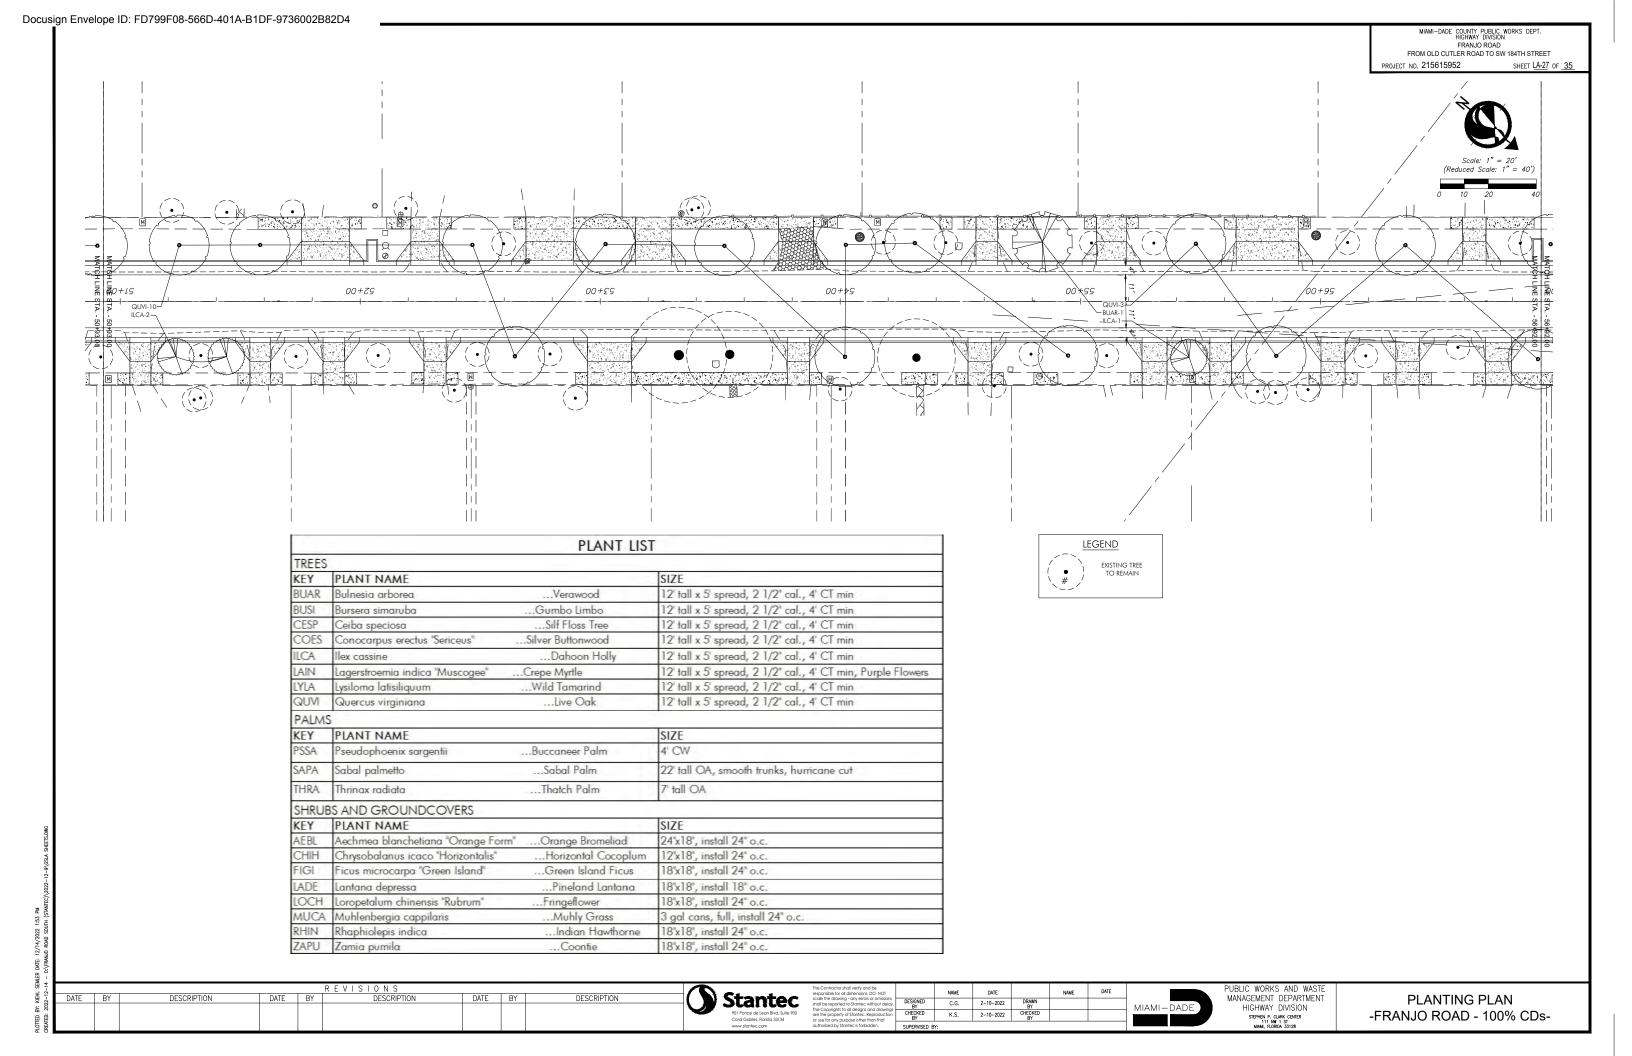


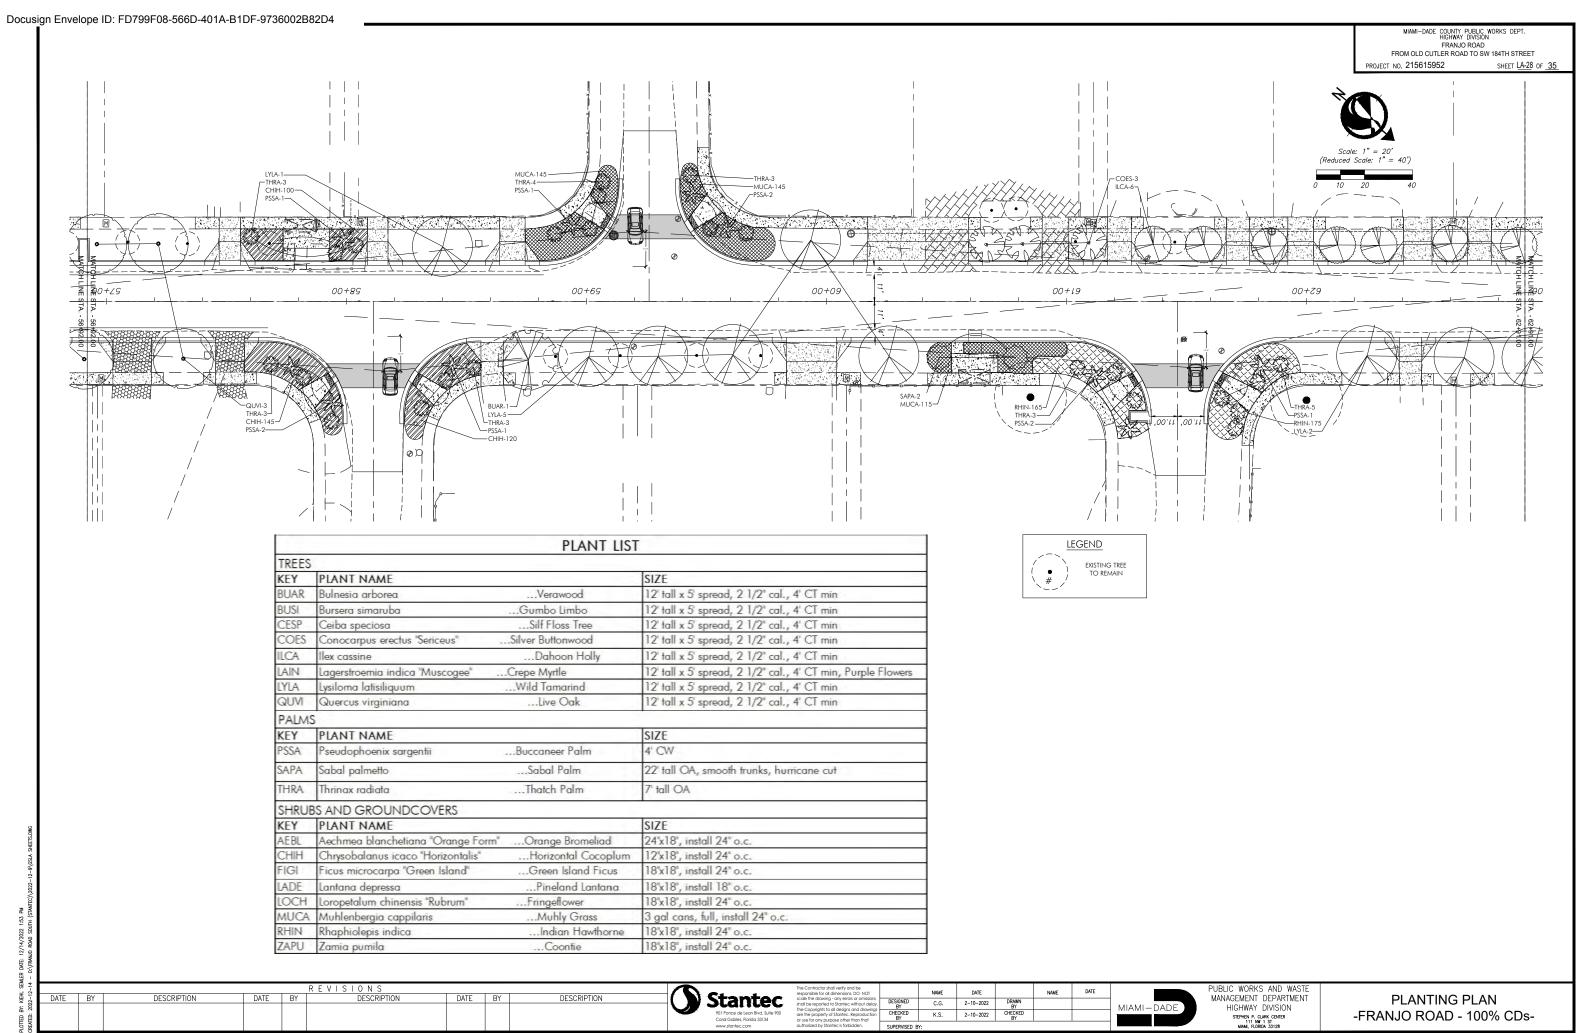


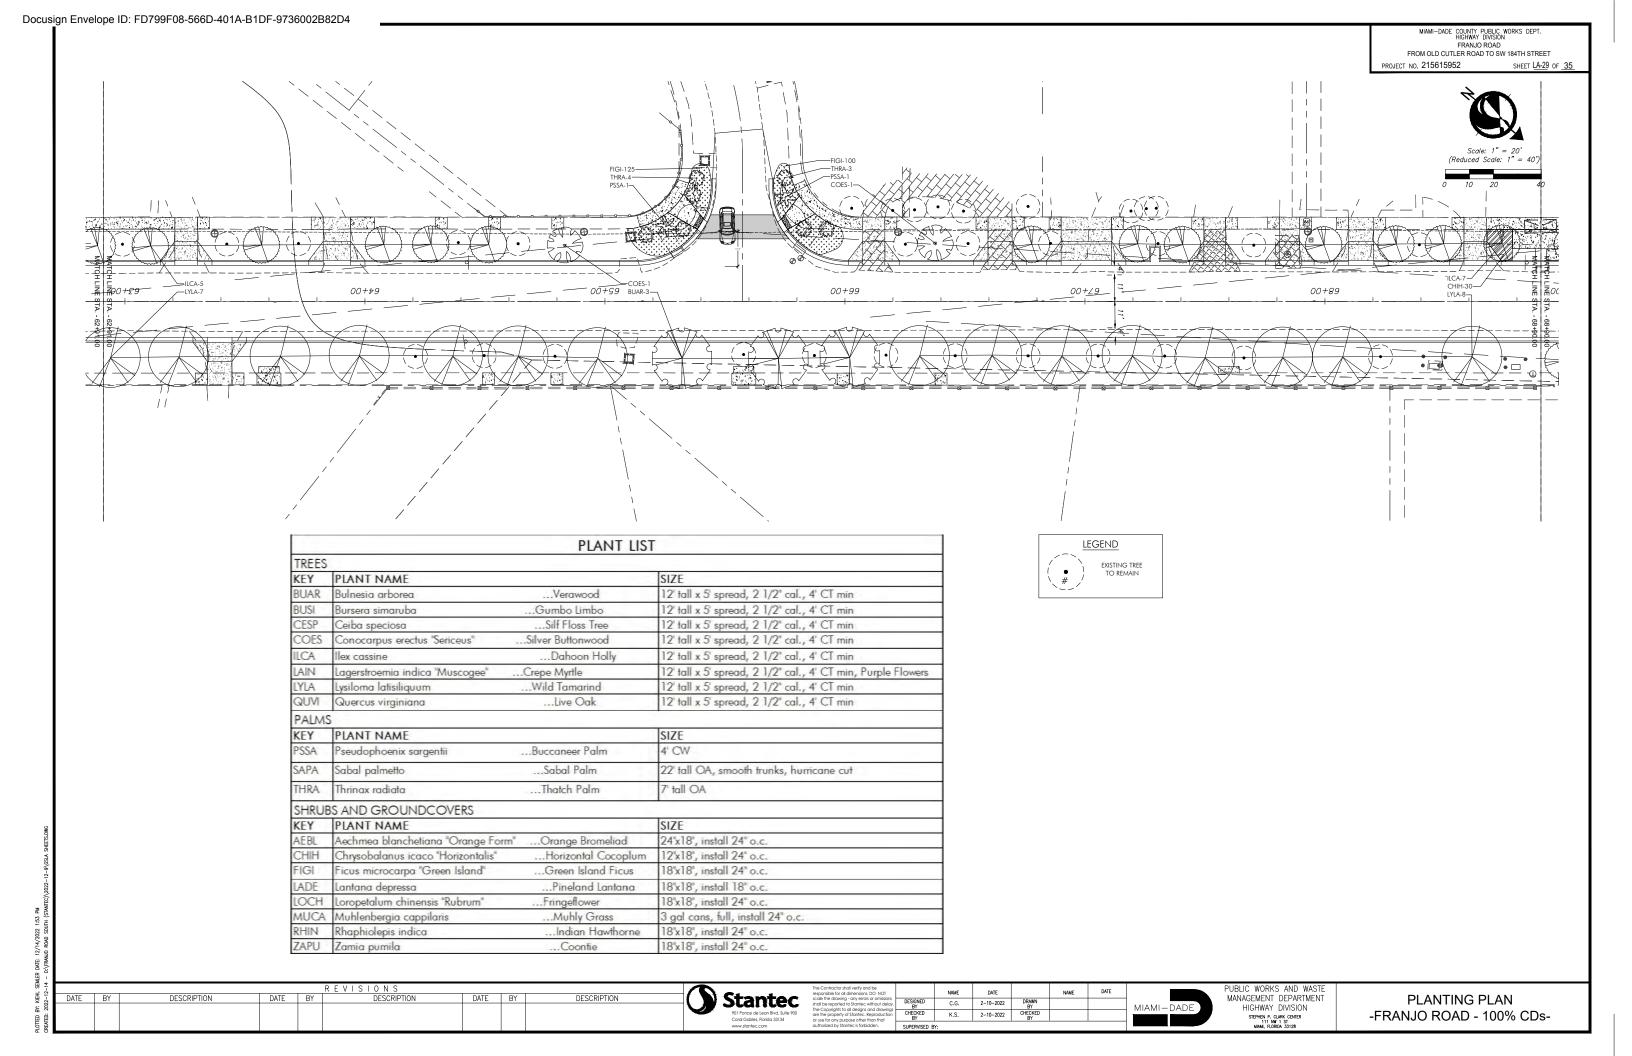

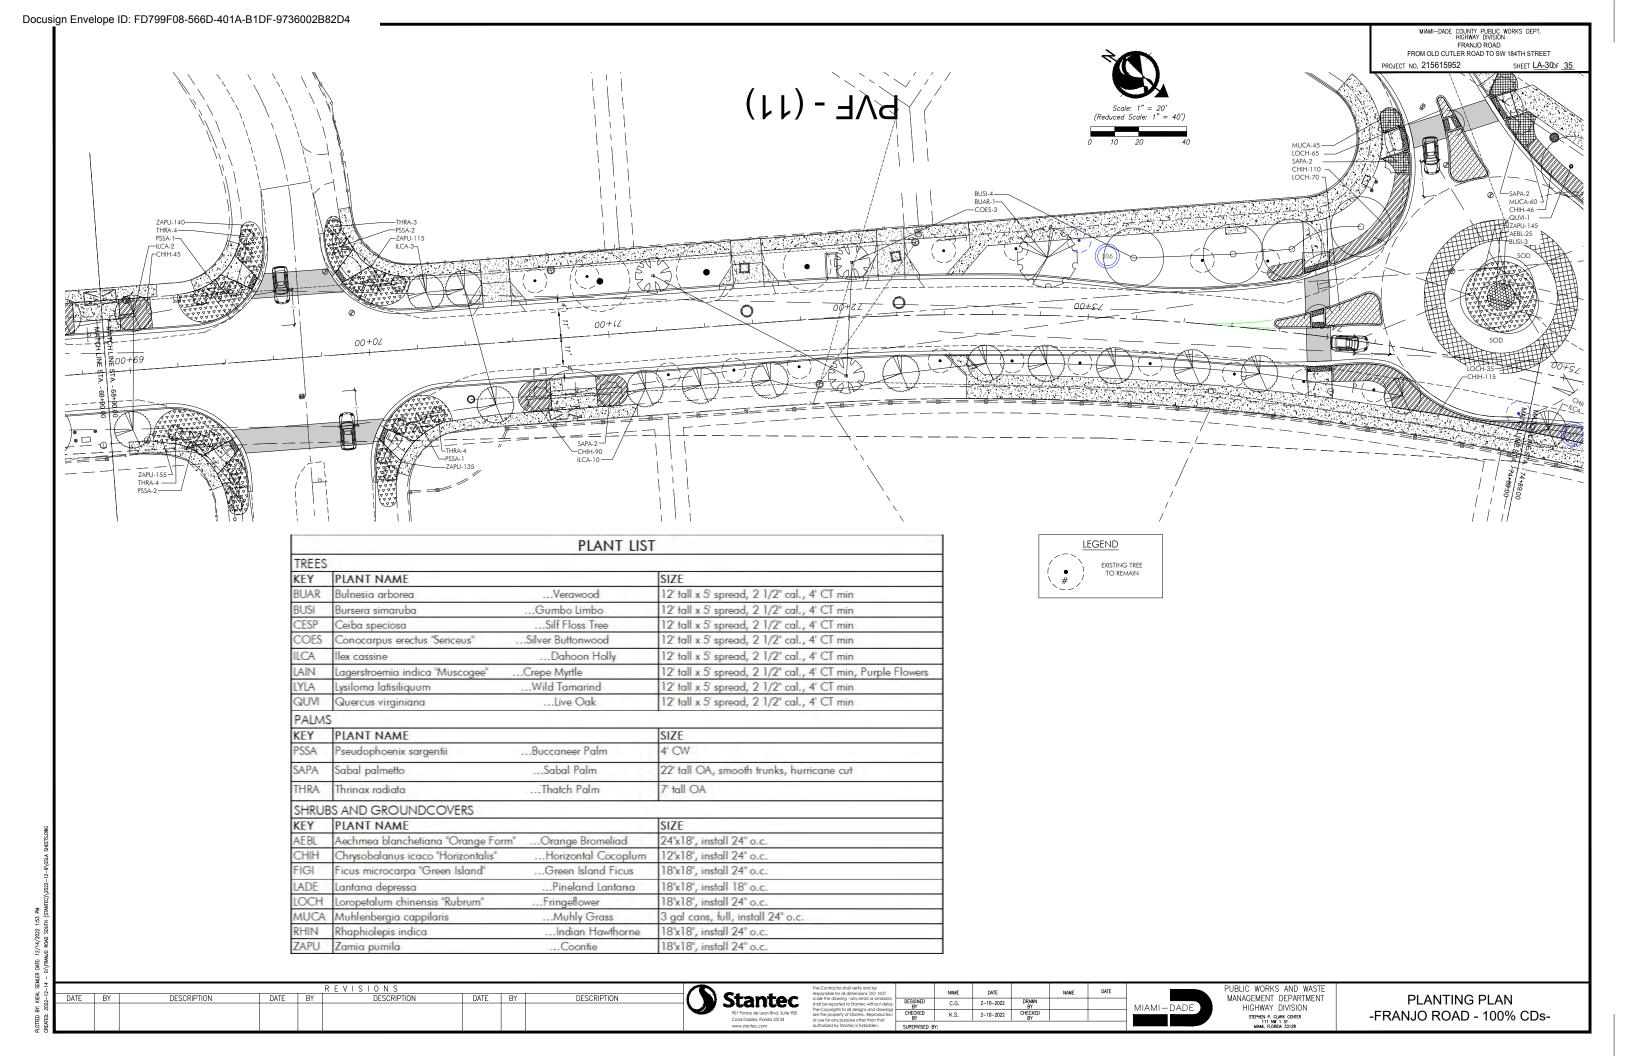

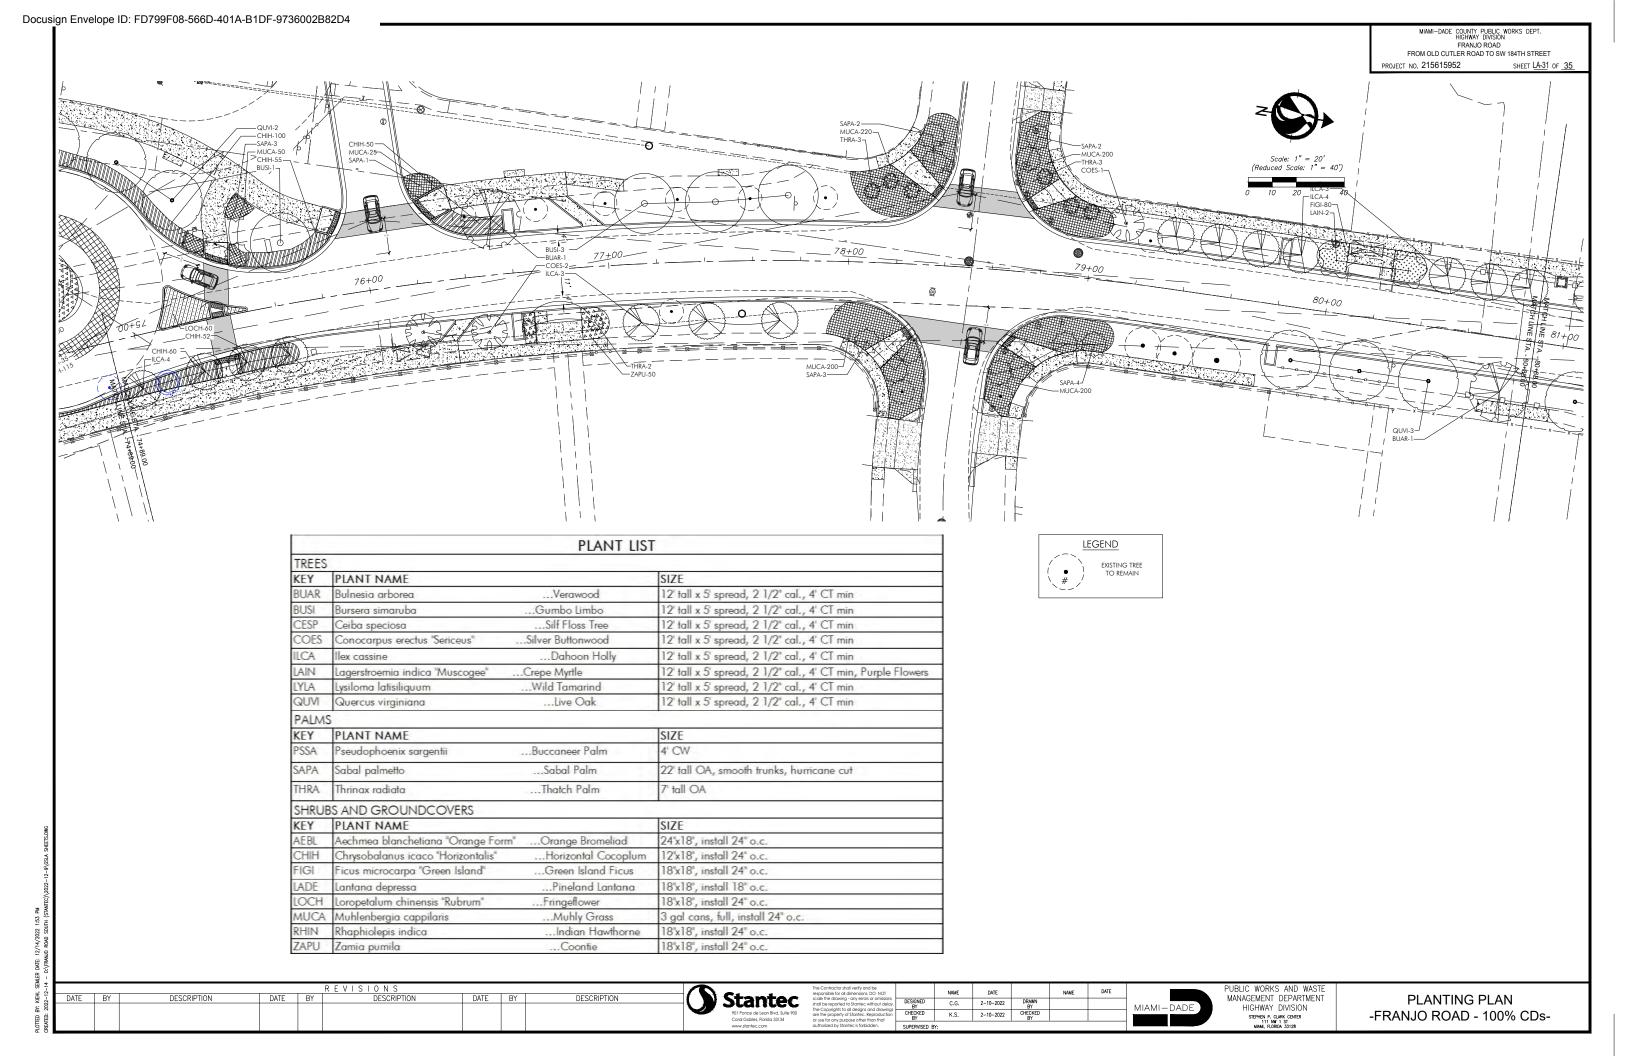


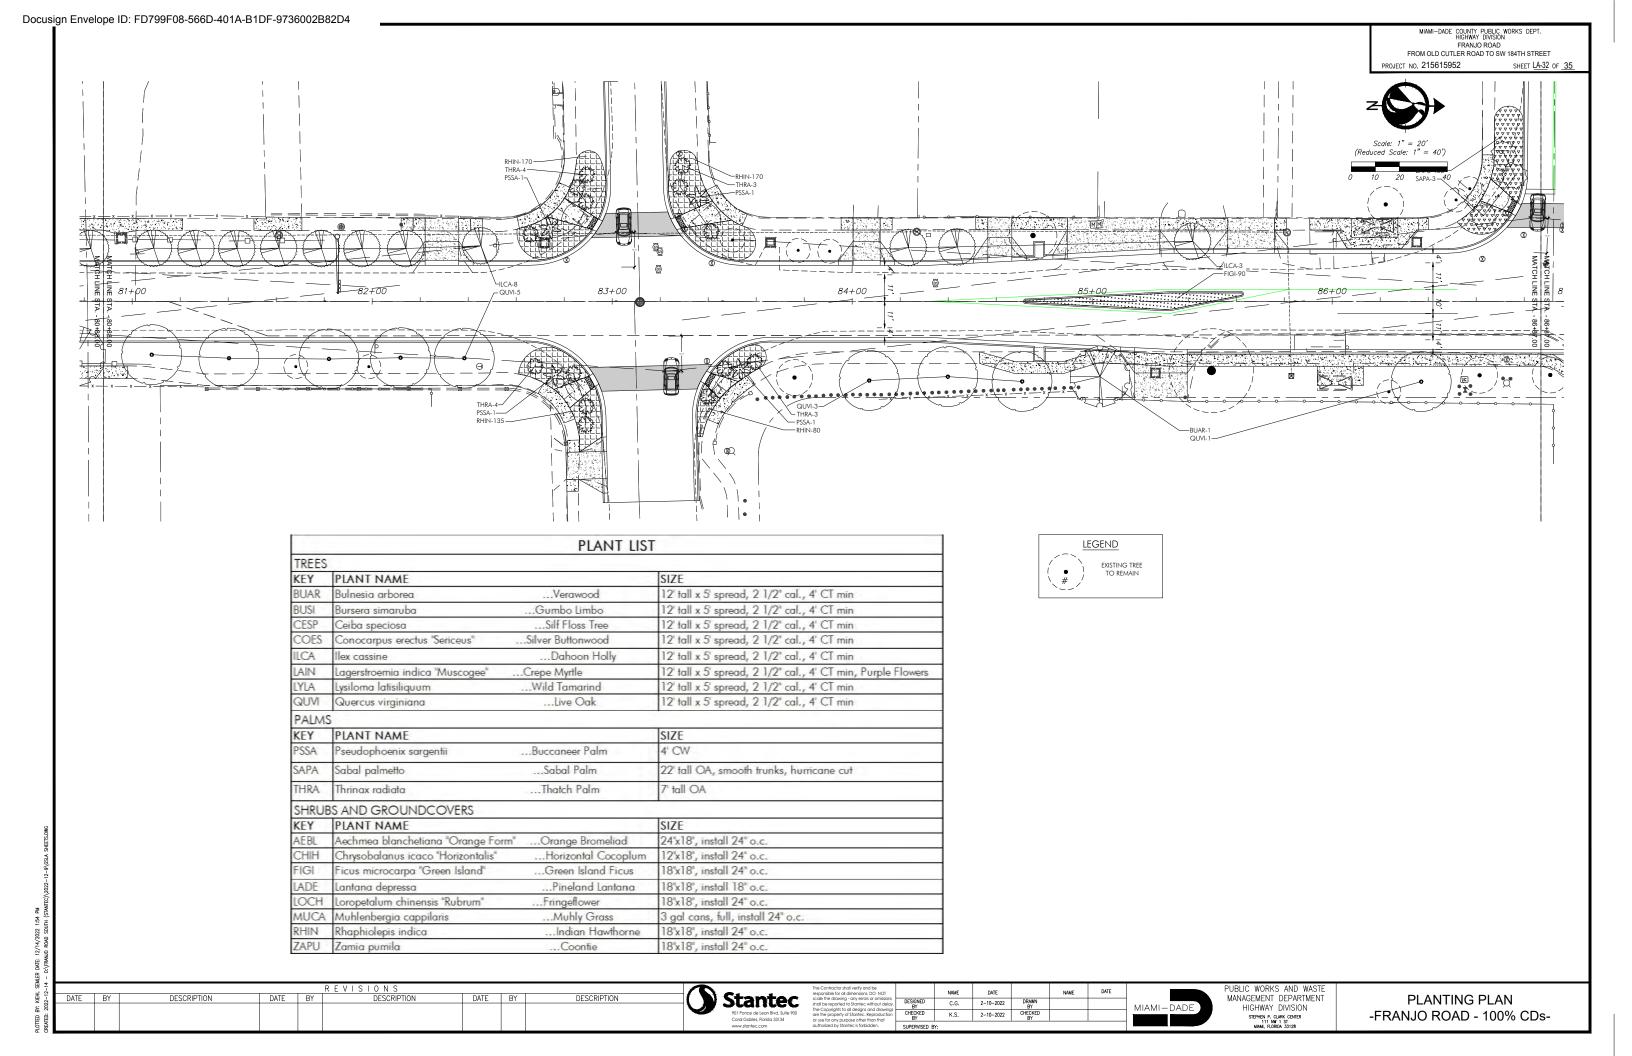

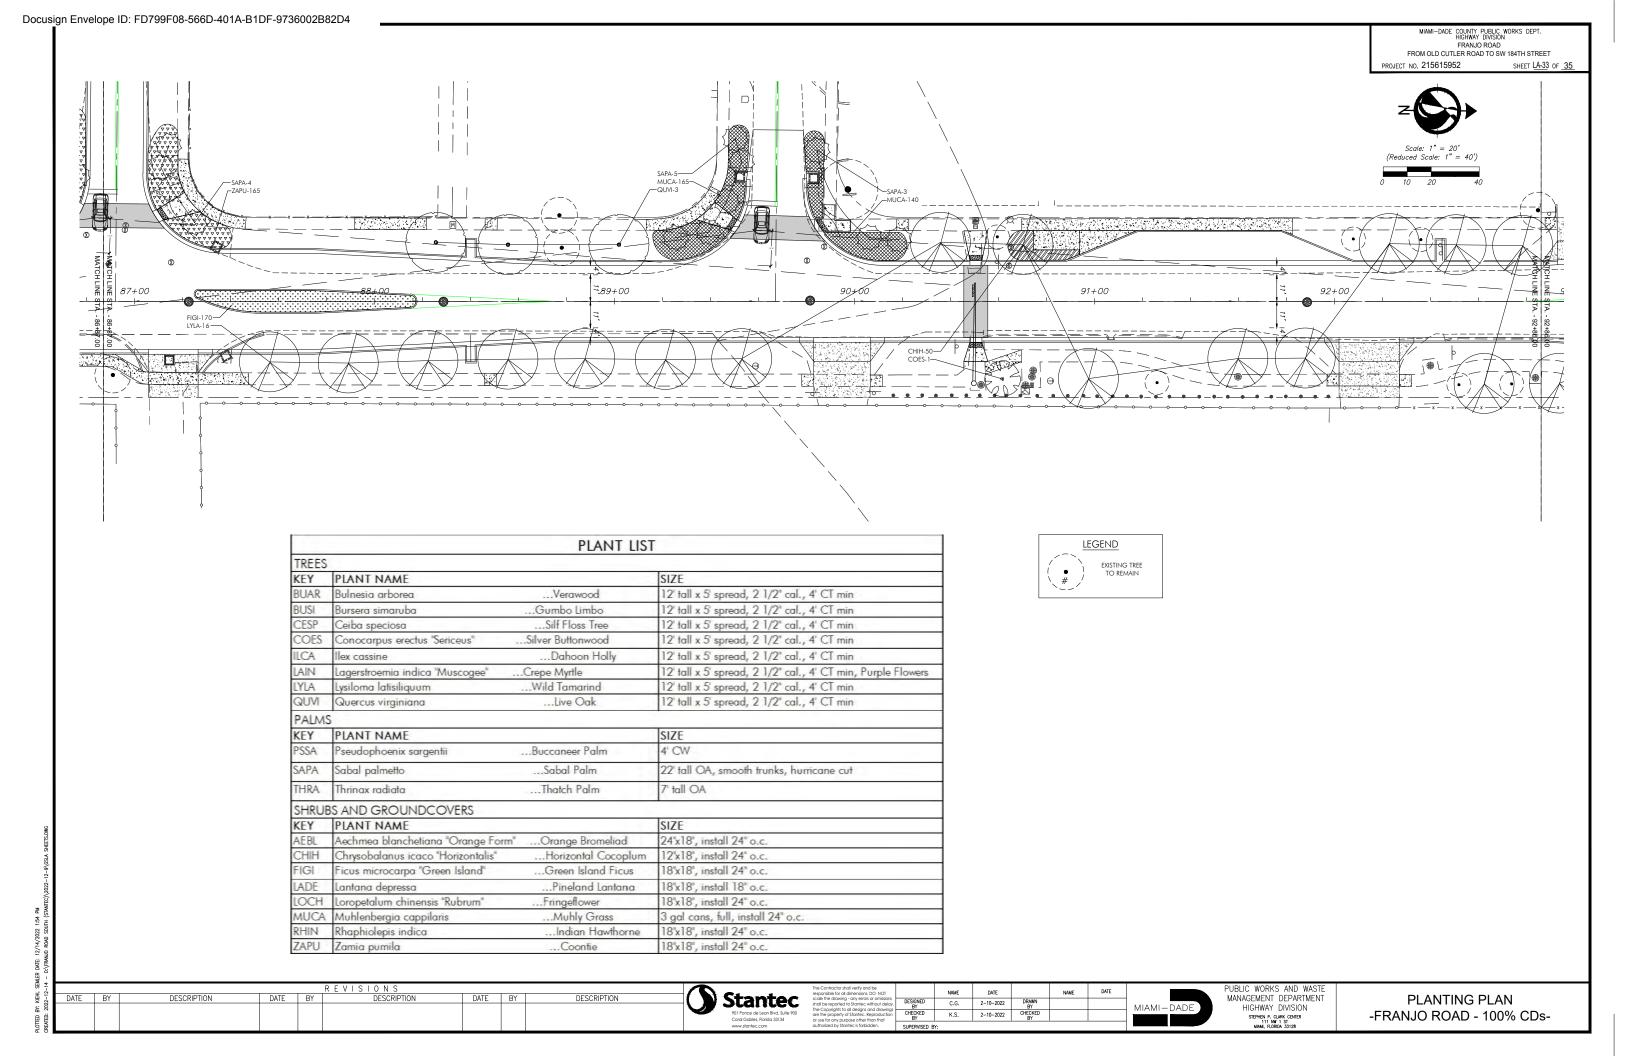

MIAMI-DADE COUNTY PUBLIC WORKS DEPT. HIGHWAY DIVISION FRANJO ROAD FROM OLD CUTLER ROAD TO SW 184TH STREET

PROJECT NO. **215615952** SHEET LA-34 OF 3

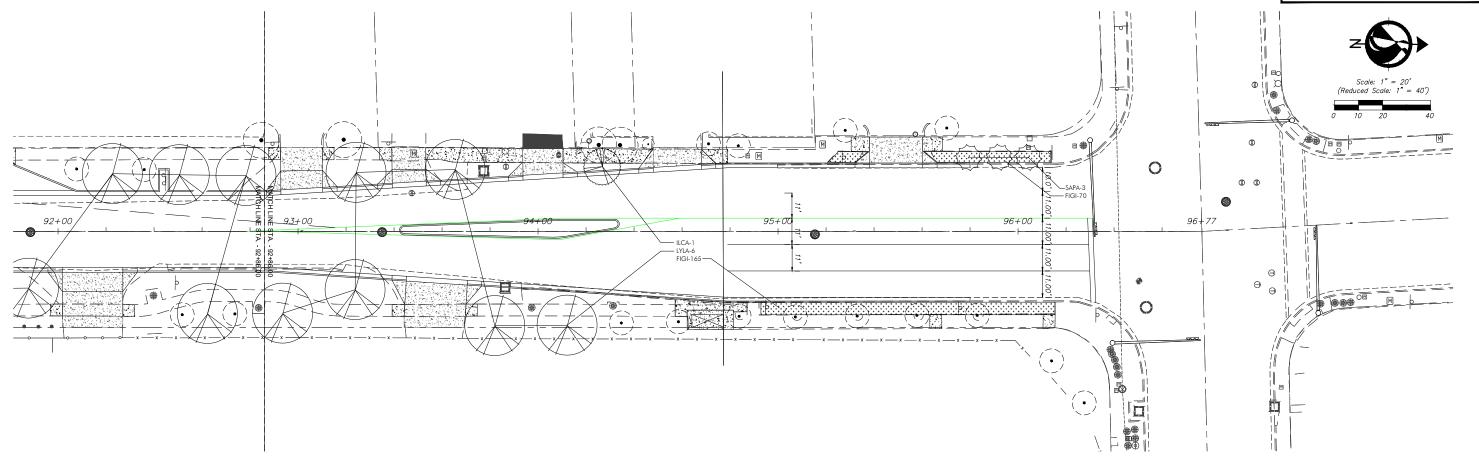

		PLANT LIST	
TREES			
KEY	PLANT NAME		SIZE
BUAR	Bulnesia arborea	Verawood	12' tall x 5' spread, 2 1/2" cal., 4' CT min
BUSI	Bursera simaruba	Gumbo Limbo	12' tall x 5' spread, 2 1/2" cal., 4' CT min
CESP	Ceiba speciosa	Silf Floss Tree	12' tall x 5' spread, 2 1/2" cal., 4' CT min
COES	Conocarpus erectus "Sericeus" .	Silver Buttonwood	12' tall x 5' spread, 2 1/2" cal., 4' CT min
ILCA	llex cassine	Dahoon Holly	12' tall x 5' spread, 2 1/2" cal., 4' CT min
LAIN	Lagerstroemia indica "Muscogee"	.Crepe Myrtle	12' tall x 5' spread, 2 1/2" cal., 4' CT min, Purple Flowers
LYLA	Lysiloma latisiliquum	Wild Tamarind	12' tall x 5' spread, 2 1/2" cal., 4' CT min
QUVI	Quercus virginiana	Live Oak	12' tall x 5' spread, 2 1/2" cal., 4' CT min
PALMS			
KEY	PLANT NAME		SIZE
PSSA	Pseudophoenix sargentii	Buccaneer Palm	4' CW
SAPA	Sabal palmetto	Sabal Palm	22' tall OA, smooth trunks, hurricane cut
THRA	Thrinax radiata	Thatch Palm	7' tall OA
SHRUE	S AND GROUNDCOVERS		
KEY	PLANT NAME		SIZE
AEBL	Aechmea blanchetiana "Orange Form"	Orange Bromeliad	24"x18", install 24" o.c.
CHIH	Chrysobalanus icaco "Horizontalis"	Horizontal Cocoplum	12'x18", install 24" o.c.
FIGI	Ficus microcarpa "Green Island"	Green Island Ficus	18"x18", install 24" o.c.
LADE	Lantana depressa	Pineland Lantana	18'x18", install 18" o.c.
LOCH	Loropetalum chinensis "Rubrum"	Fringeflower	18'x18', install 24" o.c.
MUCA	Muhlenbergia cappilaris	Muhly Grass	3 gal cans, full, install 24" o.c.
RHIN	Rhaphiolepis indica	Indian Hawthorne	18"x18", install 24" o.c.
ZAPU	Zamia pumila	Coonfie	18"x18", install 24" o.c.



R E V I S I O N S

ATE BY DESCRIPTION DATE BY DESCRIPTION DATE BY DESCRIPTION

Stantec
901 Ponce de Leon Blvd. Suite 900
Cord Godles, Florida 33134

The Contracts that welly not be responsible for all dimensions. Do Not scale the drawing - only entant of entant personal between the strategy of the drawing - only entant of entant personal between the strategy of the str

MIAMI-DADE

PUBLIC WORKS AND WASTE
MANAGEMENT DEPARTMENT
HIGHWAY DIVISION
STEPHEN P. CURK CENTER
MAN 1 F 1987 1 37 78

PLANTING PLAN
-FRANJO ROAD - 100% CDs-

A. Contractor shall provide all labor, materials, equipment, supervision, and related work necessary to complete the landscape work in accordance with the intent of the landscape plans, schedules and these specifications. The extent of work is shown on the drawings which are a part of this document.

A. Landscape installed advantancement by a Contractor Certified by the Florida Nursenymen, Growers and Landscape Association (FNGLA) as a Certified Landscape Contractor. Any pruning to be supervised by an Arborist, certified by the International Society of Arborischultre (ISA) and Idensel di County where work is performed.

1.3 INVESTIGATION OF UTILITIES
A. Prior to beginning work, the Contractor shall be responsible to locate existing underground utilities. Check with all utility companies and Sunshine State, call (811).

A. An journ sizes strain equal or exceed the minimum sizes as specified. The properties of the range of size, installed materials shall overage the mean of the range specified. Plants shall be measured folk with branches in normal position. All necessary pruning shall be done at the time of planting.

. All plant material shall be equal to or better than Florida No. 1 as classified by "Grades and Standards for Nurser Plants" by the Division of Plant Industry, Florida Department of Agriculture. They shall have a growth habit that is normal for the species; healthy, vigorous, free from insects, disease and injury.

- B. The Owner or Landscape Architect reserves the right to refuse any plant material which does not conform to the intent of
- C. CIRCLING ROOTS FOUND ON CONTAINER-GROWN MATERIAL WILL NOT BE ACCEPTED UNLESS REMEDIAL ROOT PRUNING, APPROVED BY THE LANDSCAPE ARCHITECT IS DONE BEFORE PLANTING.

- A. Fertilizer: The Contractor shall submit to the Owner and Landscape Architect documentation the project is of the analysis specified and placed at the rates specified in section 2.2 FERTILIZER.
- B. Planting soil: The Contractor shall submit a sample of the planting soil (approximately 1 cu. Ft.) for approval by the Landscape Architect prior to delivery to the site.
- 1.10 CLEAN-UP & MAINTENANCE OF TRAFFIC
 A. Follow procedures in FDOT Index 600 for maintenance of traffic during construction
- B. At the end of each work day, the Contractor shall remove debris and shall barricade the un-filled holes in a manner

- "ACCEPTANCE OF INSTALLATION"
- Plants: Begin maintenance immediately following the final plant installation operation for each plant and continue until all plant installation is complete and accepted. Maintenance shall include watering all plants, weeding, mulching, pest and disease control, lightening and repoiring of gusy, repoir of braces, removed of dead growth, resetting of plants to proper grade or up-right position, restoration of plant soucer, litter pick-up in plant beds and other necessary operations to assure
- 2. Turf Areas: Begin maintenance of turf immediately following the placement of sod and continue until sod installations complete and accepted. Maintenance shall include but not be limited to, watering, leveling, nowing, weed and pest control, fungus and disease control and other necessary operations as determined by the Landscope Architect and good nursery

3. Re-setting or straightening trees and palms: The Contractor shall re-set and/or straighten trees and palms as required at no additional cost to the Owner unless caused by sustained winds of 75 mph or more. Then, the costs of the operations may be charged to the owner. Re-set trees within 48 hours.

ALCEPTANCE OF INSTALLATION
specifor. Inspection of the work, to determine completion of contract work, exclusive of the possible replacement of sand turt, will be made by the Landscape Architect at the conclusion of the maintenance period. Written notice esting such an insepection and submitted by the Contractor at least net (1) (0) days prior to the anticipated date.

1.3 GUARANTEE A. Guarantee all plants for a period of one year (CCD). Guarantee shall commence from the date of written acceptance 'lant material which is on the site and scheduled to be relocated is not covered by the guarantee except in the case of controctor's negligence or work that has been done in an unworkman-like manner. The Contractor's not responsible for loss due to acts of god, (i.e.) sustained winds of 75 mph or more, floods, frost, lightning, vandalism or theft.

- 1.1.4 KPLVLCHENI

 A. Replacement shall be made during the guarantee period as directed by the Landscape Architect within ten (10) days from time of notification. For all replacement plant material, the guarantee period shall extend for an additional forty-five (45) days beyond the original guarantee period. The Contractor shall be responsible to provide water to the replacement plants in sufficient quantity to aid in their establishment. At the end of the guarantee period, inspection will be made by the Landscape Architect, upon written notice requesting such inspection and submitted by the Contractor all least five (5) days before the anticipated date. Replacement plants must meet the requirements of Florida No. 1 at time of inspection. Remove from the site all plants that are dead or in a state of unsatisfactory growth, as determined by the Landscape Architect. Replace these and any plants missing due to the Contractor's negligence as soon as conditions permit.
- ost of Replacements: A sum sufficient to cover the estimated cost of possible replacements, including material and will be retained by the Owner and paid to the Contractor after all replacements have been satisfactorily made an wed by the Landscope Architect.

- A. Planting soil for trees, shrubs and ground covers shall be of the composition noted on the plans, measured by volume

2.2 FIX.ILLEE.

A. Fertilizer for trees, palms, shrubs, and groundcovers shall be as follows: LESCO Palm Special 13-3-13 or equal, Sulfur coated with iron and other minor elements and maximum of 2% chlorine, or brand with equal analysis. The fertilizer shall be uniform in composition, dry and free flowing and shall be delivered to the site in the original unopened containiers, bearing the manufacturer's guaranteed analysis. Fertilizer for sod and seeded areas shall be 8-6-8, 50% organically derived

2.3 WALEK A. The Contractor shall provide potable water on site, available from the start of planting. The Contractor is responsible to ascertain the location and accessibility of the water source. The Contractor is responsible to provide the means of distribution (i.e. water truck, hoses, etc.) for distribution of water to the planting areas.

A. Mulch shall be as specified on the Plant List.

2.5 ROOT BARRIER MATERIAL

A. Root barrier material shall be 24" deep polypropolylene panels by DeepRoot or approved equal

DESCRIPTION

PART 3 - INSTALLATION PROCEDURES

3.1 LAYOUT

A. Verify location of all underground utilities and obstructions prior to excavation

HERBICIDE TREATMENT

- 3.2 FERBICULE IRCAIMENI
 A. In all areas infected with weed and/or grass growth, a systemic herbicide shall be applied per manufacturer's rates.
 When it has been established where work will be done, the systemic herbicide shall be applied in a locardance with
 manufacturer's lobeling to kill all all associates growths. Contractor shall schedule his work to allow more than one application to
 obtain a least 95% kill of undesirable growth. If necessary, Contractor shall conduct a test to establish suitability of product
 and applicator be used on this project, prior to execution of the full application.
- 3.3 PLANT PIT EXCAVATION AND BACKFILLING
 A. Trees: See the Planting and Bracing Details and note:
- B. All planting holes shall be hand dug where machine dug holes may adversely affect utilities or improve
- D. Watering of field-grown plants: Thoroughly puddle in water to remove any air pockets in the plant hole

3.4 WALTENING

A. The Controctor is responsible to provide the water for all new plants and transplants and means of distribution (i.e. hand watering or water truck) during the maintenance period and extending into the period after acceptance until the full schedule as lated below is complete. Water for trees and other large field grown plants shall be supplemented by hand or water truck, in addition to the irrigation system, (if one is provided). Contractor can adjust watering schedule during heavy rain season

or trees up to 5 inch caliper - 5 gallons

From 5 to 8 inch caliper - 25 gallons 9 inch and up caliper - 50 gallons

- A. Add fertilizer on top of the surface of shrubs beds and tree and palms root balls two (2) months after installation. Fertilize sod within two (2) days after installing after planting of each segment of the job. Fertilizer shall be applied after soil has been well moistened. Fertilizer shall be washed off of plant leaves and stems immediately after application. Apply at the following
- 1. Trees and Large Shrubs: One (1) pound per inch of trunk diameter, spread evenly over the root ball area
- 2. Shrubs: One half (1/2) handful per shrub, spread evenly over the root ball area.
- 3. Groundcover: Twelve (12) pounds per 100 sq. ft. of bed area.
- 4. Sod: Twelve (12) pounds per 1,000 sq. ft. Wash fertilizer off blades immediately after sprea

A. Spread mulch two [2] inches thick uniformly over the entire surface of shrubs and groundcover beds, depth measured after settling, unless otherwise specified in the plans. Provide 36° diameter bed of mulch, measured from outer edge of the trunk, for all tress and palms planted in soci areas. Keep mulch away from contact with the trunk. Create a 6° high ring of mulch at the outer edge of tree and palm holes.

3.7 GUYING AND BRACING

A. See the details bound herewith or made part of the plans.

- the sub-soil surface. Excavate existing non-conforming soil as required so that the finish grade of sod is flush with adjacent pavement or top of curb as well as adjacent sod in the case of sod patching.
- C. Keep edge of sod bed a minimum of 18" away from groundcover beds and 24" away from edge of shrub beds and 36" from trees, measured from the edge of plant or tree trunk.
- E. Apply fertilizer to the sod as specified in Section 3.5.
- F. Excavate and remove excess soil so top of sod is flush w/top of curb or adjacent pavement, or adjacent existing sod

PLANT BED PREPARATION NOTES

- 1. In all areas where new sod and shrub and groundcover masses are to be planted, kill all existing weeds by treating with systemic herbicide prior to beginning soil preparation.
- 2. In all shrub and groundcover beds, excavate and backfill soil as described in "Plant List(s)". If no specific preparation is noted, prepare soil as described below for either condition, over the entire area to be planted:

Consumer II fany compacted road base or asphalt or rocky soil is encountered, remove compacted material entirely to allow an 18' depth of planting soil per plant list unless otherwise stated. Backfill the entire area of the shrub and groundcover beds with 18' planting soil (as specified in Plans) to within 2 inches of the adjacent pavement or top of curb. Remove all debris and rocks and pebbles larger than 2 inches in size and level the grade before planting.

Where no compacted soil is encountered, thoroughly mix 6 inches of planting soil per plant list into the existing soil to a depth of 18 inches unless otherwise stated. If required, excavate and remove the existing soil to lower the grade, so that the prepared mix is finished to a minimum of 2 inches below top of curb or adjacent walkway. Remove all debris and rocks and pebbles larger than 2 inches in size and level the grade before planting.

For all sod areas, spread a 2" deep layer of lawn sand prior to sodding. Remove all debris and rocks and pebbles larger than 2 inchs in size and level the grade before sodding. Remove, if required, existing soil so that


For Trees and shrubs larger than 7 gallon, Add Diehard" transplant innoculant supplied by Horticultural Alliance, Inc. (800-628-6373) or equal. Mix into top 8-10 inches of planting hole, making sure it is contact with the root ball. Add at a rate specified by manufacturer (typically 4cz. per 1 inches of trunk caliper or 7 gallon can).

SPACING OF PLANTS (SEE PLANT SPACING DETAIL)


1. Plants shall be planted sufficiently away from edges of pavements or curbs, to allow for growth toward the edges of the bed.

 The Contractor shall be responsible to protect existing trees and shrubs in and adjacent to the area of work.
 Erect barriers as necessary to keep equipment and materials, any toxic material, away from the canopy drip lin of trees and shrubs. Do NOT PILE SOIL OR DEBRIS AGAINST TREE TRUNKS OR DEPOSIT NOXIOUS BUILDING SUPPLIES OR CHEMICALS WITHIN THE DRIP LINE


DESCRIPTION




PLANT BED EDGING DETAIL




SHRUB SPACING DIAGRAM



SHRUB INSTALLATION DETAIL






ROOT BARRIER INSTALLATION DETAIL

Stantec

ne Contractor shall verify and be sponsible for all dimensions. DO NOT cale the drawing - any errors or omissions		NAME	DATE		NAME	DATE
call be reported to Stantec without delay. The Copyrights to all designs and drawings	DESIGNED BY	C.G.	2-10-2022	DRAWN BY		
te the property of Stantec. Reproduction use for any purpose other than that	CHECKED BY	K.S.	2-10-2022	CHECKED BY		
uthorized by Stantec is forbidden.	SUPERVISED B	Y:				



MIAMI-DADE

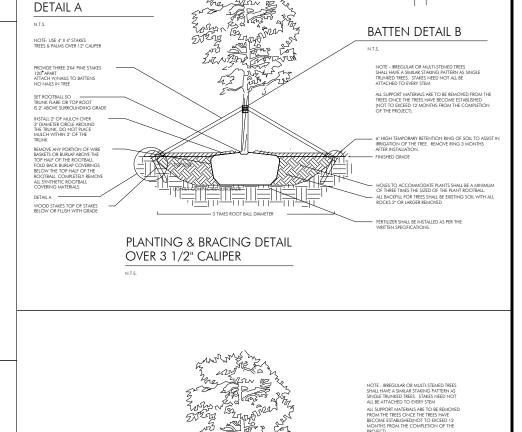

MIAMI-DADE COUNTY PUBLIC WORKS DEPT

FROM OLD CUTLER ROAD TO SW 184TH STREET

SHEET LA-34 OF 35

PROJECT NO. 215615952

PLANTING & BRACING DETAIL UNDER 3 1/2" CALIPER

> MANAGEMENT DEPARTMENT HIGHWAY DIVISION

PLANTING SPECS & DETAILS -FRANJO ROAD - 100% CDs-


6" HIGH TEMPORARY RETENTION RING OF SOIL TO ASSIST IN IRRIGATION OF THE TREE. REMOVE RING 3 MONTHS AFTER INSTALLATION.

ALL BACKFILL FOR TREES SHALL BE AS EXISTING SOIL WITH ALL ROCKS 2" OR LARGER REMOVED

FERTILIZER SHALL BE INSTALLED AS PER THE WRITTEN SPECIFICATIONS.

MIAMI-DADE COUNTY PUBLIC WORKS DEPT. HIGHWAY DIVISION FRANJO ROAD

FRANJO ROAD FROM OLD CUTLER RD TO SW 184th STREET PROJECT NO. 20190519 SHEET A-01 OF 82

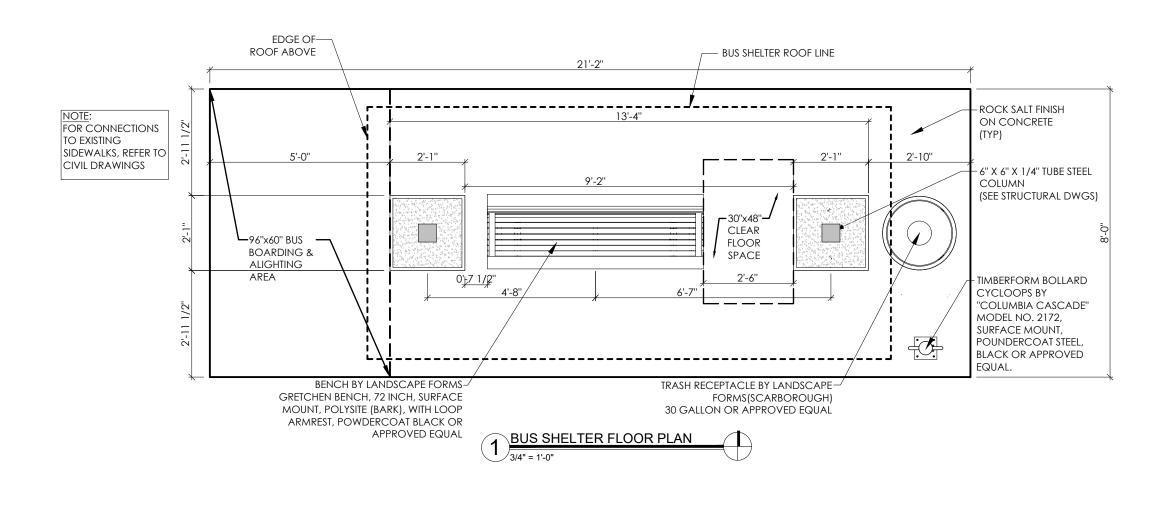


R E V I S I O N S								
DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION
1			l				l	
			l				ı	




	The Contractor shall verify and be responsible for all dimensions, DO NOT		NAME	DATE		NAME	DATE	
•	scale the drawing - any errors or omissions shall be reported to Stantec without delay. The Copyrights to all designs and drawings				DRAWN BY			MIAMI-DADE
	are the property of Stantec. Reproduction or use for any purpose other than that	CHECKED			CHECKED BY			COUNTY
	authorized by Stantec is forbidden.	SUPERVISED B	Y:					COORTT


4" X 2" X 1/4" TUBE BEAM -DRIP EDGE FOR STONE CAP SEE DETAIL THIS SHEET $\frac{1}{2}$ " THICK CEMENT BACKERBOARD ATTACHED TO STEEL COLUMN WITH STAINLESS STEEL SCREWS @12" CORAL ROCK CLADDING 6" X 6" X 1/4" TUBE STEEL
COLUMN (SEE
STRUCTURAL DWGS.)

COLUMN DETAIL

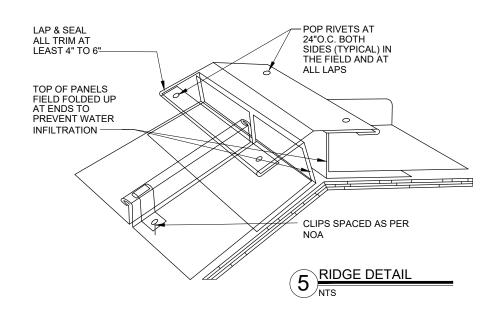


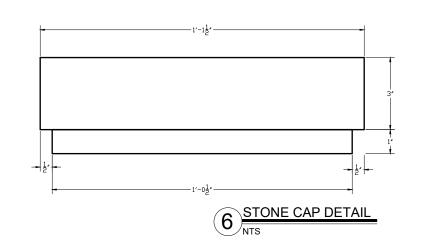


MIAMI-DADE COUNTY PUBLIC WORKS DEPT. FRANJO ROAD FROM OLD CUTLER RD TO SW 184th STREET PROJECT NO. 20190519 SHEET $\frac{A-02}{5}$ of $\frac{82}{5}$

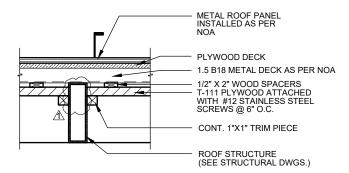



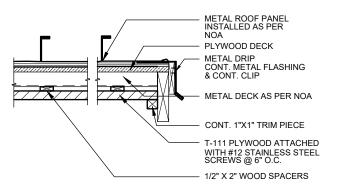



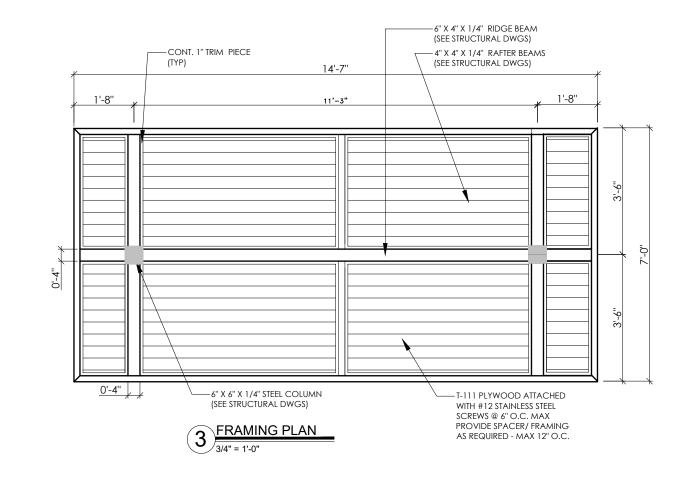

А мг	CBS				REVISIONS					
DATE	BY	DESCRIPTION	DXIE.	BY	DESCRIPTION	DATE	BY	DESCRIPTION		Stant
										901 Ponce de Leon Blvd
										Coral Gables, Florida 33
						l			1	www.stantec.com



The Contractor shall verify and be responsible for all dimensions. DO NOT		NAME	DATE		NAME	DATE		h
scale the drawing - any errors or omissions shall be reported to Stantec without delay. The Copyrights to all designs and drawings	ВТ			DRAWN BY			MIAMI-DADE	1
are the property of Stantec, Reproduction or use for any purpose other than that	CHECKED BY			CHECKED BY			COLINTY	4
authorized by Stantec is forbidden.	SUPERVISED B	ny:					000111	

MIAMI-DADE COUNTY PUBLIC WORKS DEPT. HIGHWAY DIVISION

FRANJO ROAD FROM OLD CUTLER RD TO SW 184th STREET SHEET S 01 0F 82 PROJECT NO. 20190519

1. THE GOVERNING CODE FOR THIS PROJECT IS THE FLORIDA BUILDING CODE, 2020 EDITION. THIS CODE PRESCRIBES WHICH EDITION OF EACH REFERENCED STANDARD APPLIES TO THIS PROJECT.

2.TO THE BEST OF OUR KNOWLEDGE. THE STRUCTURAL DRAWINGS COMPLY WITH THE APPLICABLE REQUIREMENTS OF THE GOVERNING BUILDING CODE

3. CONSTRUCTION IS TO COMPLY WITH THE REQUIREMENTS OF THE GOVERNING BUILDING CODE AND ALL OTHER APPLICABLE FEDERAL. STATE. AND LOCAL CODES. STANDARDS, REGULATIONS AND LAWS.

4 THE STRUCTURAL DOCUMENTS ARE TO BE USED IN CONJUNCTION WITH THE CIVIL DOCUMENTS. IF A CONFLICT EXISTS. THE MORE STRINGENT GOVERNS.

5. DETAILS LABELED "TYPICAL" APPLY TO ALL SITUATIONS THAT ARE THE SAME OR SIMILAR TO THOSE SPECIFICALLY REFERENCED, WHETHER OR NOT THEY ARE KEYED IN AT EACH LOCATION. QUESTIONS REGARDING THE APPLICABILITY OF TYPICAL DETAILS SHALL BE RESOLVED BY THE ENGINEER.

6.CONTRACTORS WHO DISCOVER DISCREPANCIES, OMISSIONS OR VARIATIONS IN THE CONTRACT DOCUMENTS DURING BIDDING SHALL IMMEDIATELY NOTIFY THE ENGINEER. THE ENGINEER WILL RESOLVE THE CONDITION AND ISSUE A WRITTEN

7.THE GENERAL CONTRACTOR SHALL COORDINATE ALL CONTRACT DOCUMENTS WITH FIELD CONDITIONS AND DIMENSIONS AND PROJECT SHOP DRAWINGS PRIOR TO CONSTRUCTION. DO NOT SCALE DRAWINGS; USE ONLY PRINTED DIMENSIONS. REPORT ANY DISCREPANCIES IN WRITING TO THE ENGINEER PRIOR TO PROCEEDING WITH WORK. DO NOT CHANGE SIZE OR LOCATION OF STRUCTURAL MEMBERS WITHOUT WRITTEN INSTRUCTIONS FROM THE STRUCTURAL ENGINEER OF

8.THE CONTRACTOR SHALL PROTECT ADJACENT PROPERTY, HIS OWN WORK AND THE PUBLIC FROM HARM. THE CONTRACTOR IS SOLELY RESPONSIBLE FOR CONSTRUCTION MEANS AND METHODS, AND JOBSITE SAFETY INCLUDING ALL OSHA

9.THE STRUCTURE IS DESIGNED TO BE STRUCTURALLY SOUND WHEN COMPLETED. PRIOR TO COMPLETION, THE CONTRACTOR IS RESPONSIBLE FOR STABILITY AND TEMPORARY BRACING, INCLUDING, BUT NOT LIMITED TO, MASONRY WALLS. WHEREVER THE CONTRACTOR IS UNSURE OF THESE REQUIREMENTS, THE CONTRACTOR SHALL RETAIN AN ENGINEER LICENSED IN THE STATE WHERE THIS PROJECT IS LOCATED TO DESIGN AND INSPECT THE TEMPORARY BRACING AND STABILITY OF THE STRUCTURE.

10. DESIGN WIND LOADS

a GOVERNING CODE ASCF 7-16 b BUILDING RISK CATEGORY c UI TIMATE DESIGN WIND SPEED VULT = 175 MPH (3 SECOND GUST d. NOMINAL DESIGN WIND SPEED VASD = 136 MPH (3 SECOND GUST) e MEAN ROOF HEIGHT KD = 0.85 KZT = 1.0 C DIRECTIONALITY FACTOR a. TOPOGRAPHIC FACTOR i. ENCLOSURE CLASSIFICATION INTERNAL PRESSURE COEFFICIENT

SHOP DRAWINGS

1. TWENTY WORKING DAYS PRIOR TO SUBMITTING SHOP DRAWINGS, THE CONTRACTOR SHALL SUBMIT FOR EOR'S REVIEW A SCHEDULE WHICH DETAILS THE ESTIMATED DUANTITY OF SHOP DRAWINGS AND THE DATE THE SHOP DRAWINGS WILL BE RECEIVED BY THE ARCHITECT. THE FINAL SHOP DRAWING SCHEDULE SHALL BE DEVELOPED AND SUBMITTED TO THE EOR, BY ACCORDANCE WHITH THE SHOP DRAWING SCHEDULE, THE FOR WILL RETURN THE SHOP DRAWING SCHEDULE.

2. SUBMIT SPECIFIC COMPONENTS, SUCH AS COLUMNS, FOOTINGS, ETC., IN A SINGLE PACKAGE. SUBMIT SIMILAR FLOORS TOGETHER.

3.0N FIRST SUBMITTAL, CLEARLY FLAG AND CLOUD ALL DIFFERENCES FROM THE CONTRACT DOCUMENTS. ON RESUBMITTALS, FLAG AND CLOUD ALL CHANGES AND ADDITIONS TO PREVIOUS SUBMITTAL; ONLY CLOUDED ITEMS WILL BE REVIEWED.

4.THE GENERAL CONTRACTOR IS RESPONSIBLE FOR CONFIRMING AND CORRELATING DIMENSIONS AT THE JOB SITES, FOR TOLERANCES, CLEARANCES, QUANTITIES, FABRICATION PROCESSES AND TECHNIQUES OF CONSTRUCTION, TION OF THE WORK WITH OTHER TRADES AND FULL COMPLIANCE WITH THE CONTRACT DOCUMENTS.

5.THE GENERAL CONTRACTOR/CONSTRUCTION MANAGER SHALL REVIEW AND APPROVE SUBMITTALS AND SHALL SIGN AND DATE EACH DRAWING PRIOR TO SUBMITTING TO THE ARCHITECT. THIS APPROVAL IS TO CONFIRM THAT THE SUBMITTAL IS COMPLETE, COMPLIES WITH THE SUBMITTAL REQUIREMENTS AND IS COORDINATED WITH FIELD DIMENSIONS, OTHER TRADES, ERECTION SEQUENCING AND CONSTRUCTABILITY

6.THE STRUCTURAL ENGINEER REVIEWS SUBMITTALS TO CONFIRM THAT THE SUBMITTAL IS IN GENERAL CONFORMANCE WITH THE DESIGN CONCEPT PRESENTED IN THE CONTRACT DOCUMENTS. QUANTITIES AND DIMENSIONS ARE NOT CHECKED. NOTATIONS ON SUBMITTALS DO NOT AUTHORIZE CHANGES TO THE CONTRACT SUM. CHECKING OF THE SUBMITTAL BY THE STRUCTURAL ENGINEER SHALL NOT RELIEVE THE CONTRACTOR OF RESPONSIBILITY FOR DEVIATIONS FROM THE CONTRACT DOCUMENTS AND FROM ERRORS OR OMISSIONS IN THE SUBMITTAL.

A.THE CONTRACTOR MAY REQUEST CAD FILES OF THE STRUCTURAL DRAWINGS, WHICH MAY BE PROVIDED - AT THE STRUCTURAL ENGINEER'S DISCRETION - UPON A WRITTEN AGREEMENT BETWEEN THE STRUCTURAL ENGINEER AND THE

8. THE FOLLOWING ITEMS ARE SHOP DRAWINGS THAT SHALL BE SUBMITTED FOR REVIEW:

a REINFORCING STEFI

a REINFORCING STEEL

COMPRETEDROUT MIXES

COMPACTION REPORTS

PRODUCT DATACCESSORIES

E MAREDOPED TEMS

L'UTILITY PENETRATIONS THROUGH STRUCTURAL MEMBERS

G. MAREDDED UTILITIES IN STRUCTURAL MEMBERS

1.FOOTING SIZES AND REINFORCING ARE BASES ON AN ASSUMED ALLOWABLE SOIL BEARING CAPACITY OF 2,000 PSF. ALL FOOTINGS SHALL BEAR ON NATURAL SOIL OR ROCK COMPACTED TO 98% OF MAXIMUM DRY DENSITY AS DETERMINED BY MODIFIED PROCTOR ASTIM D-1557.

2. SUBGRADE PREPARATION SHALL BE FIELD CONTROLLED AND TESTED. PROVIDE COMPACTION REPORTS TO THE ENGINEER FOR RECORD.

3.CENTER ALL FOOTINGS UNDER THEIR RESPECTIVE COLUMNS OR WALLS, UNO.

1. THE CONTRACTOR IS SOLELY RESPONSIBLE FOR ALL EXCAVATION PROCEDURES INCLUDING LAGGING, SHORING, AND PROTECTION OF ADJACENT PROPERTY, STRUCTURES, STREETS AND UTILITIES IN ACCORDANCE WITH THE REQUIREMENTS OF THE LOCAL BUILDING DEPARTMENT AND OSHA REGULATIONS. DO NOT EXCAVATE WITHIN ONE FOOT OF THE ANGLE OF REPOSE OF ANY SOIL BEARING FOUNDATION UNLESS THE FOUNDATION IS PROPERLY AGAINST SETTLEMENT.

2.DO NOT BACKFILL AGAINST WALLS UNTIL? DAYS AFTER THE WALLS ARE BRACED BY THE STRUCTURE OR ARE TEMPORARY BRACED. DO NOT BACKFILL CANTILEVERED RETAINING WALLS UNTIL CONCRETE IS 3 DAYS OLD. DO NOT BACKFILL UNTIL AFTER COMPLETION AND INSPECTION OF ANY WATERPROOFING.

3.THE CONTRACTOR IS RESPONSIBLE FOR THE DISPOSAL OF ALL ACCUMULATED WATER IN A MANNER THAT DOES NOT INCONVENIENCE OR DAMAGE THE WORK

2.PROVIDE STRUCTURAL CONCRETE WITH A MINIMUM ULTIMATE COMPRESSIVE DESIGN STRENGTH OF 4000 PSI IN 28 DAYS.

3.USE NORMAL WEIGHT CONCRETE FOR ALL STRUCTURAL MEMBERS UNO.

4.THE USE OF CALCIUM CHLORIDE AND/OR OTHER CHLORIDE CONTAINING AGENTS IN CONCRETE IS PROHIBITED.

5 CONCRETE MIXES SHALL USE LARGEST COARSE AGGREGATE PRACTICAL FOR MEMBERS BEING CAST

6.PROVIDE ASTM A-615 GRADE 60 REINFORCING STEEL. REINFORCING SHALL BE ACCURATELY PLACED, RIGIDLY SUPPORTED AND FIRMLY TIED IN PLACE, WITH APPROPRIATE BAR SUPPORTS AND SPACERS. LAP CONTINUOUS REINFORCING 48 BAR DIA PROVIDE COVER OVER REINFORCING AS FOLLOWS:

ELEMENT	BOTTOM	TOP	SIDES
FOOTINGS AND PILE CAPS	3"	2"	3"
BEAMS ABOVE GRADE	1 1/2"	1 1/2"	1 1/2"
COLUMNS			1 1/2"
SLABS ON GRADE	2"	1"	2"
SLABS ABOVE GRADE	3/4"	3/4"	1"
SLABS EXPOSED TO WEATHER	1 1/2"	1 1/2"	1 1/2"
WALLS RETAINING FILL		-	2*
WALLS EXPOSED TO WEATHER			1 1/2"
WALLS - ALL OTHERS	-		1"

- 7.UTILITIES SHALL NOT PENETRATE BEAMS OR COLUMNS BUT MAY PASS THROUGH SLABS AND WALLS INDIVIDUALLY, UNO. FOR OPENINGS 24' LONG OR LESS, CUT REINFORCING AND REPLACE ALONGSIDE OPENING WITH SPLICE BARS OF EQUIVALENT AREA WITH 48 BAR DIA. LAP. PREPARE AND SUBMIT SHOP DRAWINGS FOR OPENINGS LONGER THAN 24'. FOR RECTANGULAR OPENINGS 12' LONG OR LONGER, ADD 1#5 X 6' MID DEPTH DIAGONAL AT ALL 4
- 8. WHERE REINFORCING STEEL CONGESTION PERMITS. CONDUIT AND PIPES UP TO 1" DIAMETER MAY BE EMBEDDED IN CONCRETE PER ACI 318. SECTIONS 20.7 AND 26.8. SPACE AT 3 DIAMETERS O/C. PLACE BETWEEN OUTER LAYERS OF REINFORCING. IF CONDUITS ARE SIGNIFICANTLY CONGESTED, ADDITIONAL REINFORCING PERPENDICULAR TO PIPING MAY BE REQUIRED. REQUESTS TO EMBED LARGER PIPES SHOULD BE ACCOMPANIED BY A DETAILED DESCRIPTION AND BE SUBMITTED TO THE ARCHITECT FOR EVALUATION.

9 PROVIDE 3/4" CHAMFER FOR ALL EXPOSED CORNERS

- 10. PROVIDE REINFORCING STEFL PLACER WITH A SET OF STRUCTURAL DRAWINGS FOR FIELD REFERENCE. INSPECT REINFORCING STEFL PLACING FROM STRUCTURAL DRAWINGS.
- 11. SUBMIT SHOP DRAWINGS FOR ALL CONCRETE MIXES INDICATING CONCRETE STRENGTH, SPECIFICATIONS FOR ADMIXTURES, PROPOSED LOCATIONS OF USE AND AMOUNTS OF MIXING WATER TO BE WITHHELD FOR LATER ADDITION AT PROJECT SITE. DO NOT ADD AIR ENTRAINING ADMIXTURES FOR SLABS ON GRADE.
- 12. SUBMIT STEEL REINFORCEMENT SHOP DRAWINGS THAT DETAIL FABRICATION, BENDING AND PLACEMENT. INCLUDE BAR SIZES, LENGTHS, SPACING, MATERIAL GRADE, BAR SCHEDULES, BENT BAR DIAGRAMS, BAR ARRANGEMENT, SPLICES AND LAPS, MECHANICAL CONNECTIONS AND SUPPORTS FOR CONCRETE REINFORCEMENT.
- 13. TEST COMPOSITE SAMPLES OF FRESH CONCRETE OBTAINED ACCORDING TO ASTM C172:
- a OBTAIN AT LEAST ONE COMPOSITE SAMPLE FOR EACH 100 CU, YD, OR FRACTION THEREOF OF EACH CONCRETE MIXTURE PLACED EACH DAY,
- b. OBTAIN ONE SLUMP TEST AT POINT OF PLACEMENT FOR EACH COMPOSITE SAMPLE. BUT NOT LESS THAN ONE TEST FOR EACH DAY'S POUR OF EACH CONCRETE MIXTURE. COMPLY WITH ASTM C143.
- C. CAST AND LABORATORY CURE TWO SETS OF TWO STANDARD SPECIMENS FOR EACH COMPOSITE SAMPLE.
- d. CAST AND FIELD CURE TWO SETS OF TWO STANDARD CYLINDER SPECIMENS FOR EACH COMPOSITE SAMPLE.
- e. TEST ONE LABORATORY-CURED SPECIMEN AT 7 DAYS AND THREE AT 28 DAYS. IF ONE OF THE FIRST TWO 28 DAY TESTS FALLS BELOW SPECIFIED STRENGTH, TEST THE REMAINING SPECIMEN AT 56 DAYS.
 f. WHEN STRENGTH OF FIELD-CURED CYLINDERS IS LESS THAN 85 PERCENT OF COMPANION LABORATORY-CURED CYLINDERS, CONTRACTOR SHALL EVALUATE OPERATIONS AND PROVIDE CORRECTIVE PROCEDURES FOR
- g. TEST RESULTS SHALL BE REPORTED IN WRITING TO ARCHITECT, CONCRETE MANUFACTURER, AND CONTRACTOR WITHIN 48 HOURS OF TESTING.


R E V I S I O N S										C	i.
DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION	()		j
									V	D	ř
									ı		



The Contractor shall verify and be responsible for all dimensions. DO NOT		NAME	DATE		NAME	DATE
scale the drawing - any errors or omissions shall be reported to Stantec without delay. The Copyrights to all designs and drawings	BY	PG	09/27/21	DRAWN By	SB	09/27/21
are the property of Stantec. Reproduction or use for any purpose other than that	CHECKED BY	PG	09/27/21	CHECKED BY	PG	09/27/21
authorized by Stantec is forbidden.	SUPERVISED R	w- PG				



MIAMI-DADE COUNTY PUBLIC WORKS DEPT.
HIGHWAY DIVISION
FROM OLD CUTLER RD TO SW 184th STREET
PROJECT NO. 2231593219 SHEET SO2 OF 82

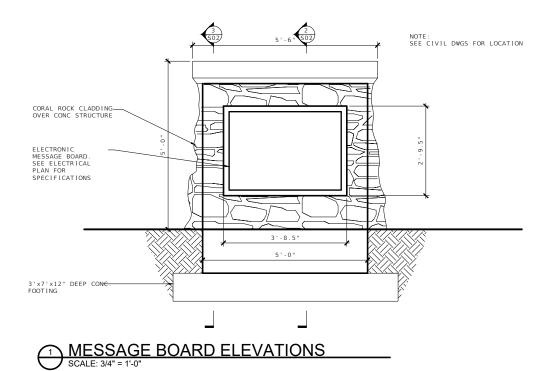


NOTES:


1. THICKNESS OF MORTAR VARIES DUE TO SIZE OF ROCKS. MORTAR SHOULD BE STRUCK AND SHALL BE NO MORE THAN 1" AND NO LESS THAN 1/2".

2. ROCK SIZES SHALL VARY AND BE NO MORE THAN 18" AND NO LESS THAN 4" (MAXIMUM DIMENSIONS).

3. CONTRACTOR TO COORDINATE THIS WORK WITH ELECTRICAL & TELEPHONE PROVISIONS AS SHOWN ON ELECTRICAL LIGHTING PLANS.

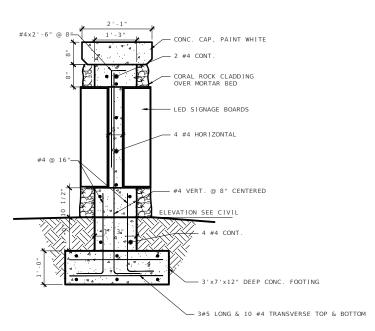

MESSAGE BOARD SECTION AT MIDDLE SCALE: 3/4" = 1'-0"

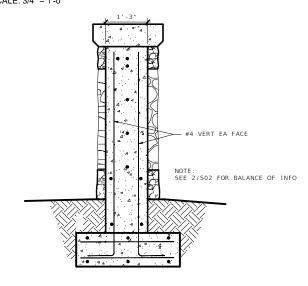





The Contractor shall verify and be responsible for all dimensions. DO NOT		NAME	DATE		NAME	DATE
scale the drawing - any errors or omissions shall be reported to Stantec without delay. The Copyrights to all designs and drawings	DESIGNED By	PG	09/27/21	DRAWN By	SB	09/27/21
are the property of Stantec. Reproduction or use for any purpose other than that	CHECKED	PG	09/27/21	CHECKED BY	PG	09/27/21
or ase for any perpose office main mai						